
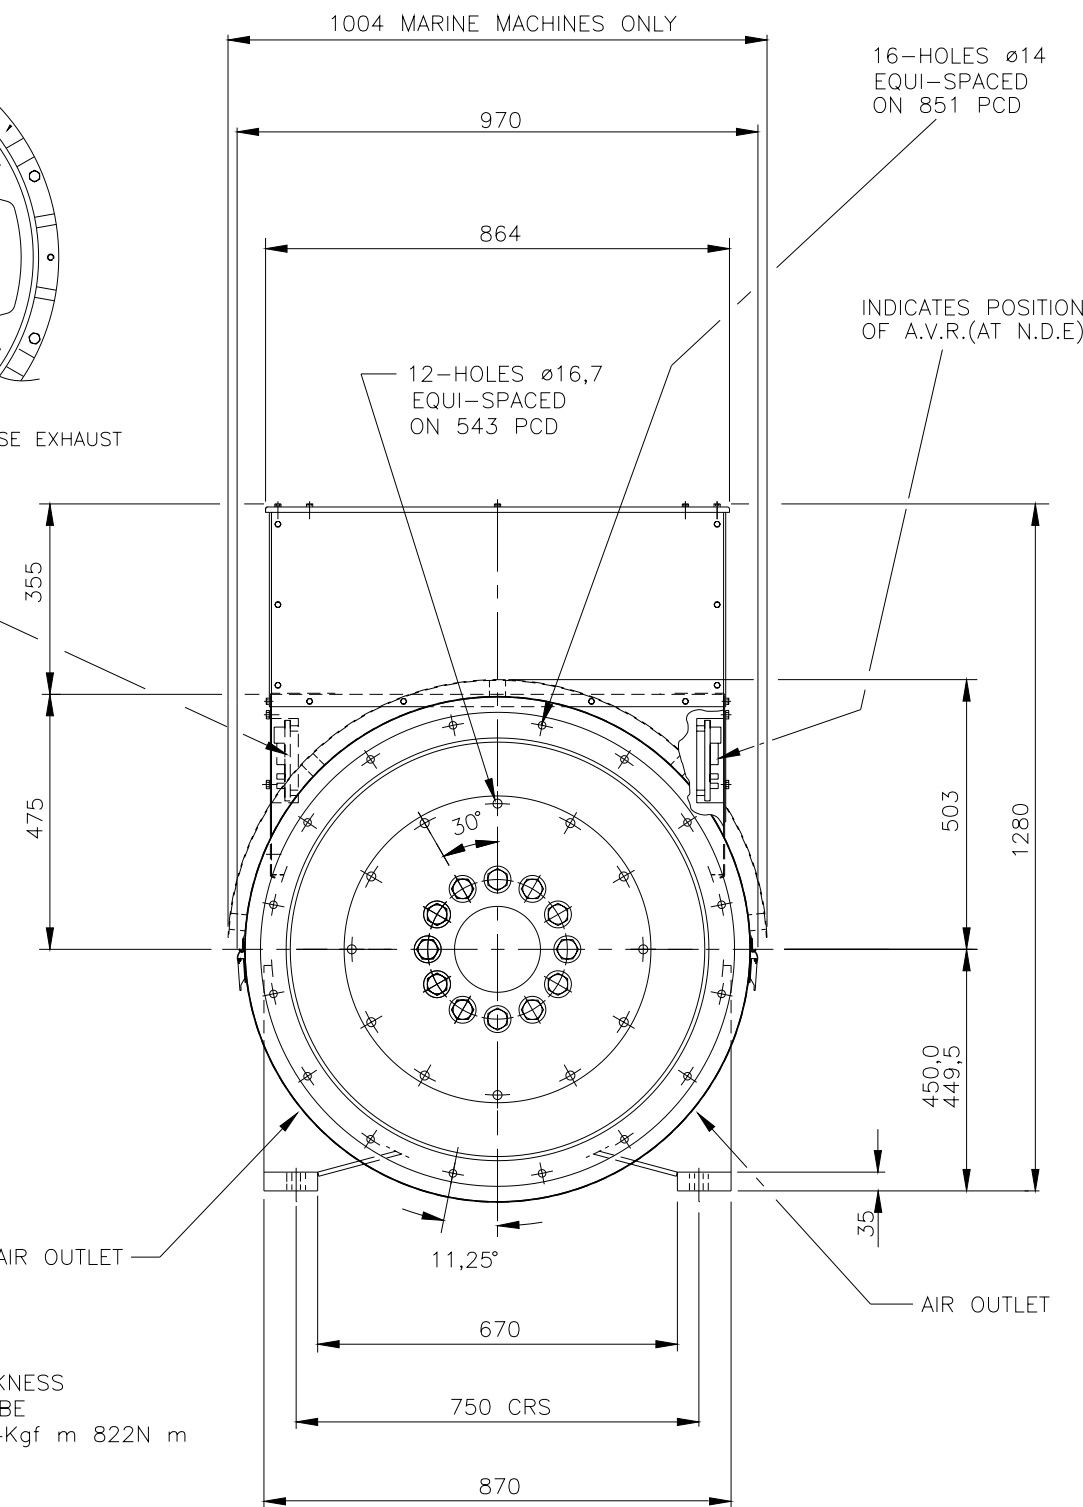


IF IN DOUBT-ASK
DO NOT SCALE

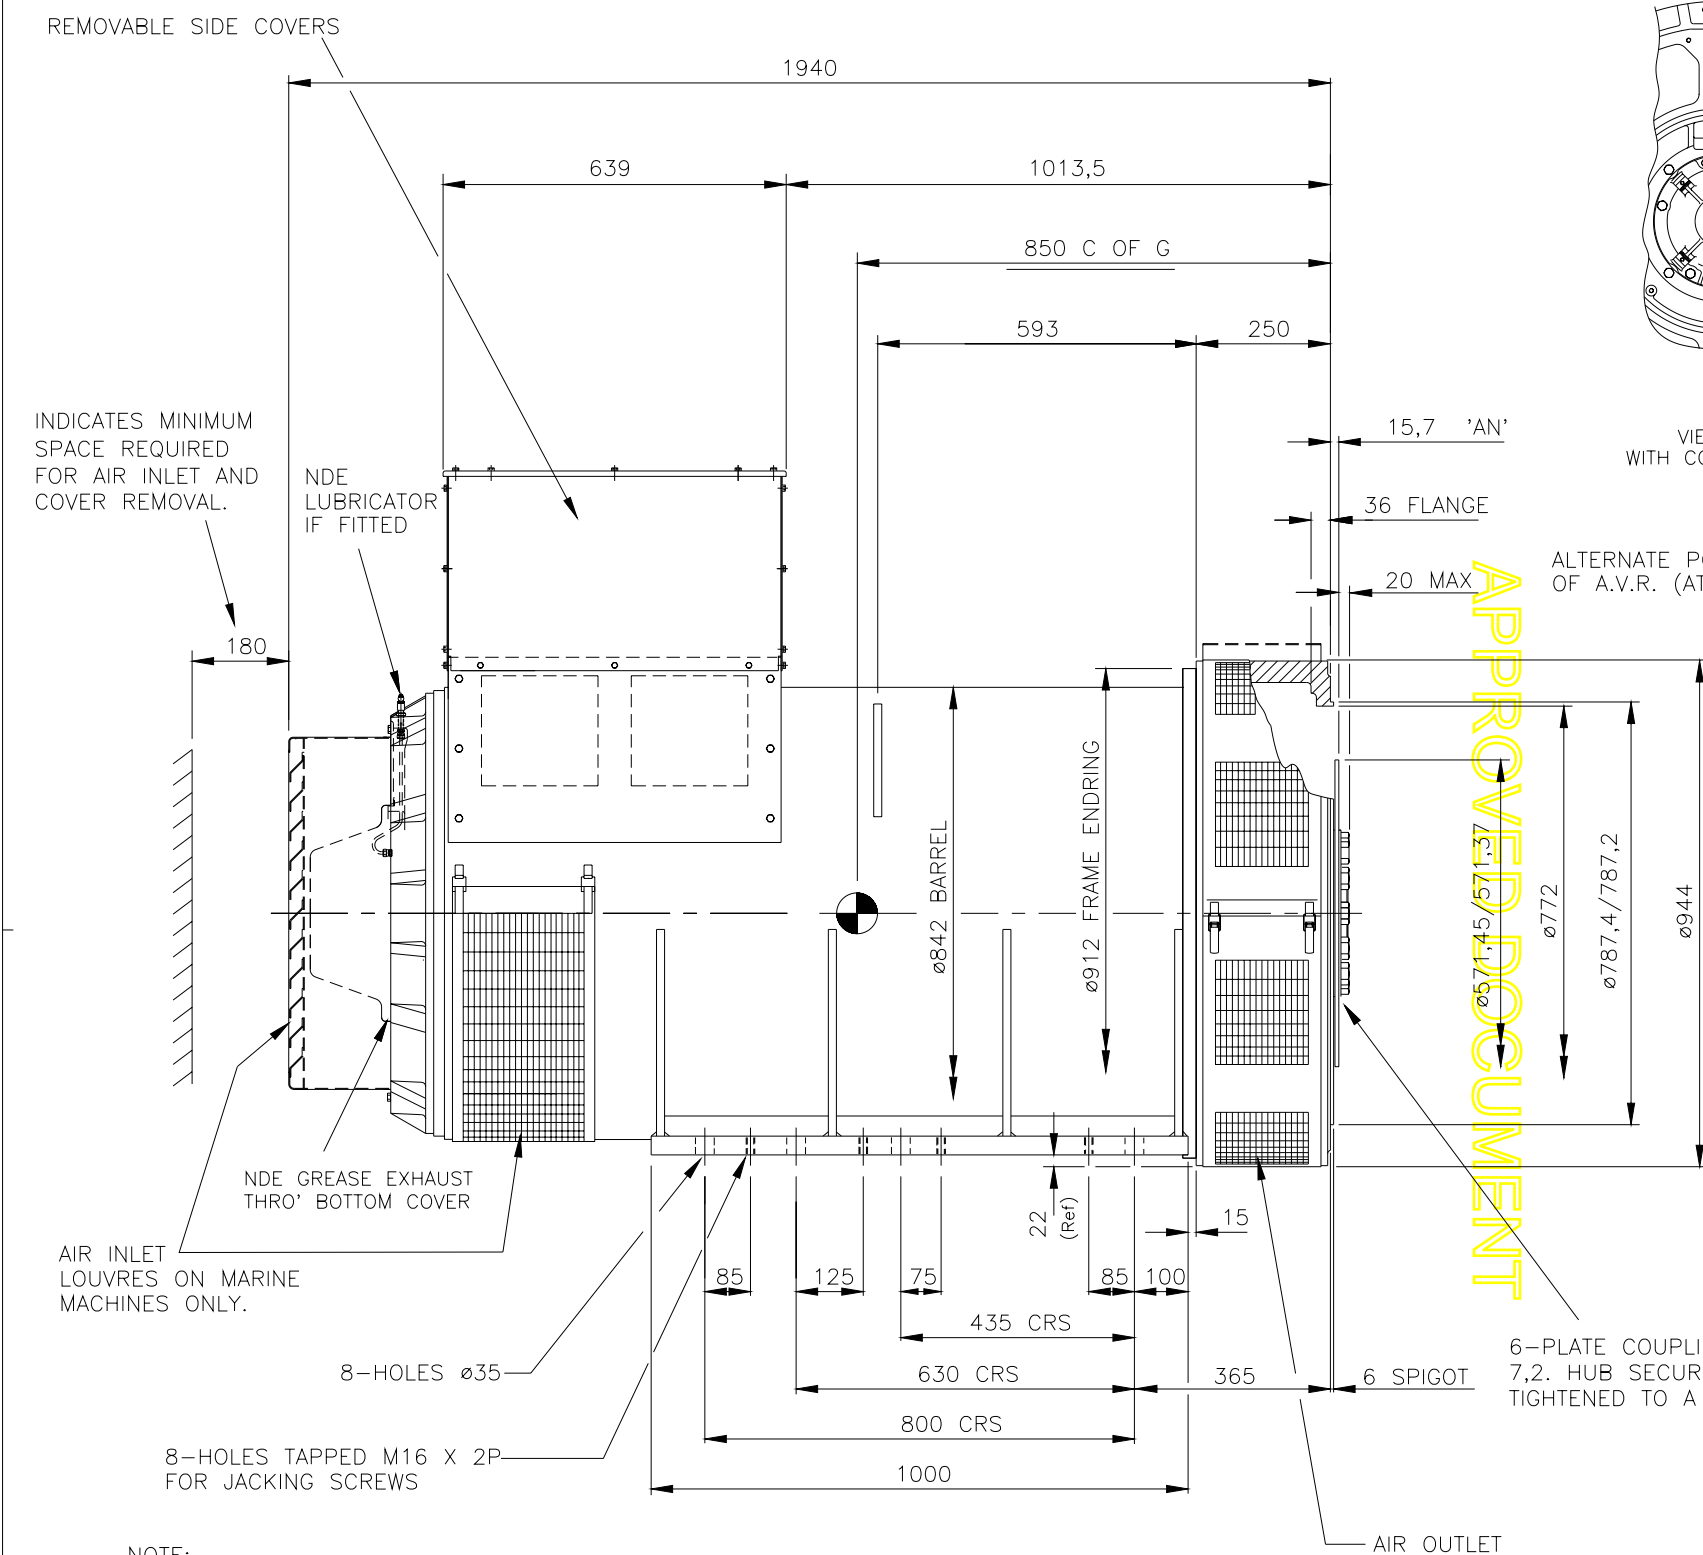

NOTE:-
CUSTOMER MAY CUT CABLE ENTRY HOLES AS REQUIRED IN ANY OF THE FOUR TERMINAL BOX SIDES SUBJECT TO POSITION OF AVR, TERMINALS, ETC.

CUSTOMER MUST ENSURE THAT AIR INLET & OUTLET POSITIONS ARE NOT OBSTRUCTED

MOD.	ISSUE	DRAWN	DATE	ALTERATION
5-0895-01	D	JKB	04/11/10	LUBRICATION DETAILS ADDED TO NDE
4-9430-01	C	DFC	31.01.08	INCORRECT ADAPTOR DIMENSION Ø711 DELETED
4-8664-02	B	USD	14.09.06	CHANGE OF COMPANY NAME
4/7752/01	A	DW	14.03.05	ORIGINAL ISSUE

CERTIFIED PRINT		
ONLY IF SIGNED		
BY		
DATE		
DRAWN	DW	14.03.05
CHECKED	DFC	31.01.08
APPROVED	SFA	31.01.08

P7 G 1-BRG ALTERNATOR
ADAPTOR - SAE No 00
COUPLING - SAE No 18 (12 HOLES)
STD T/BOX - STD FEET

CUMMINS GENERATOR
TECHNOLOGIES LTD.

SCALE	FIRST W.O.
1:10	
UNIT OF MEASUREMENT MILLIMETRES (mm)	
70-1009	ISSUE D
SHEET 1 OF 1	SHEETS