




S7L1M-J4 Wdg.312 - Technical Data Sheet

Standards

STAMFORD industrial alternators meet the requirements of the relevant parts of the IEC EN 60034 and the relevant section of other international standards such as BS5000, VDE 0530, NEMA MG1-32, IEC34, CSA C22.2-100 and AS1359. Other standards and certifications can be considered on request.

Quality Assurance

Alternators are manufactured using production procedures having a quality assurance level to BS EN ISO 9001.

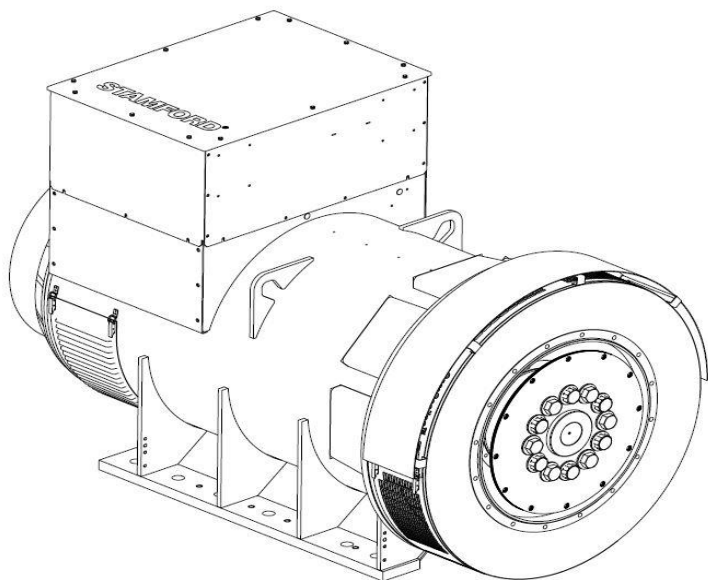

Excitation and Voltage Regulators

Excitation System					
AVR Type	MX322	DECS100	DECS150		
Voltage Regulation	± 0.5%	± 0.25%	± 0.25%		with 4% Engine Governing
AVR Power	PMG	PMG	PMG		

No Load Excitation Voltage (V)	17.8 - 17.3
No Load Excitation Current (A)	0.88 - 0.86
Full Load Excitation Voltage (V)	77
Full Load Excitation Current (A)	3.2
Exciter Time Constant (seconds)	0.165

STAMFORD

S7L1M-J4 Wdg.312

Electrical Data								
Insulation System	H							
Stator Winding	Double Layer Concentric							
Winding Pitch	2/3							
Winding Leads	6							
Winding Number	312							
Number of Poles	4							
IP Rating	IP23							
RFI Suppression	BS EN 61000-6-2 & BS EN 61000-6-4, VDE 0875G, VDE 0875N. Refer to factory for others							
Waveform Distortion	NO LOAD < 1.5% NON-DISTORTING BALANCED LINEAR LOAD < 5.0%							
Short Circuit Ratio	1/Xd							
Steady State X/R Ratio	26.30							
50 Hz					60 Hz			
Telephone Interference	THF<2%				TIF<50			
Cooling Air Flow	3.1 m³/sec				3.72 m³/sec			
Voltage Star (V)	380	400	415	440	416	440	460	480
Voltage Parallel Star (V)	-	-	-	-	-	-	-	-
Voltage Delta (V)	-	-	-	-	-	-	-	-
kVA Base Rating (Class H) for Reactance Values (kVA)	2135	2200	2200	2000	2288	2425	2531	2644
Saturated Values in Per Unit at Base Ratings and Voltages								
Xd Dir. Axis Synchronous	2.23	2.08	1.93	1.56	2.40	2.27	2.17	2.08
X'd Dir. Axis Transient	0.15	0.14	0.13	0.10	0.16	0.15	0.14	0.14
X''d Dir. Axis Subtransient	0.11	0.11	0.10	0.08	0.12	0.12	0.11	0.11
Xq Quad. Axis Reactance	1.72	1.60	1.49	1.20	1.85	1.75	1.67	1.60
X''q Quad. Axis Subtransient	0.22	0.21	0.19	0.16	0.24	0.23	0.22	0.21
XL Stator Leakage Reactance	0.06	0.05	0.05	0.04	0.06	0.06	0.06	0.05
X2 Negative Sequence Reactance	0.15	0.14	0.13	0.10	0.16	0.15	0.14	0.14
X0 Zero Sequence Reactance	0.03	0.03	0.03	0.02	0.03	0.03	0.03	0.03
Unsaturated Values in Per Unit at Base Ratings and Voltages								
Xd Dir. Axis Synchronous	2.68	2.49	2.32	1.87	2.88	2.72	2.60	2.50
X'd Dir. Axis Transient	0.17	0.16	0.15	0.12	0.18	0.17	0.16	0.16
X''d Dir. Axis Subtransient	0.13	0.12	0.11	0.09	0.14	0.14	0.13	0.12
Xq Quad. Axis Reactance	1.77	1.65	1.53	1.24	1.90	1.80	1.72	1.65
X''q Quad. Axis Subtransient	0.27	0.25	0.23	0.19	0.29	0.27	0.26	0.25
XL Stator Leakage Reactance	0.07	0.06	0.06	0.05	0.07	0.07	0.06	0.06
Xlr Rotor Leakage Reactance	0.14	0.13	0.12	0.10	0.15	0.14	0.14	0.13
X2 Negative Sequence Reactance	0.18	0.16	0.15	0.12	0.19	0.18	0.17	0.16
X0 Zero Sequence Reactance	0.04	0.04	0.03	0.03	0.04	0.04	0.04	0.04

STAMFORD

S7L1M-J4 Wdg.312


Time Constants (Seconds)		
T'd Transient Time Const.	0.164	
T''d Sub-Transient Time Const.	0.008	
T'do O.C. Field Time Const.	4.980	
Ta Armature Time Const.	0.037	
T''q Sub-Transient Time Const.	0.0120	
Resistances in Ohms (Ω) at 22 ⁰ C		
Stator Winding Resistance (Ra), per phase for series connected	0.0006	
Rotor Winding Resistance (Rf)	1.84	
Exciter Stator Winding Resistance	20.1	
Exciter Rotor Winding Resistance per phase	0.057	
PMG Phase Resistance (Rpmg) per phase	1.91	
Positive Sequence Resistance (R1)	0.0007	
Negative Sequence Resistance (R2)	0.0008	
Zero Sequence Resistance (R0)	0.0007	
Saturation Factors	400V	480V
SG1.0	0.381	0.138
SG1.2	1.771	1.043
Mechanical Data		
Shaft and Keys	All alternator rotors are dynamically balanced to better than BS6861: Part 1 Grade 2.5 for minimum vibration in operation. Two bearing generators are balanced with a half key.	
	1 Bearing	2 Bearing
SAE Adaptor	SAE0, 00	SAE0, 00
Moment of Inertia	58.15 kgm²	56.76 kgm²
Weight Wound Stator	2131kg	2131kg
Weight Wound Rotor	1826kg	1767kg
Weight Complete Alternator	4515kg	4480kg
Shipping weight in a Crate	4574kg	4539kg
Packing Crate Size	220 X 115 X 155(cm)	220 X 115 X 155(cm)
Maximum Over Speed	2250 RPM for two minutes	
Bearing Drive End	-	BALL. 6232
Bearing Non-Drive End	BALL. 6319	BALL. 6319

STAMFORD®








S7L1M-J4 Wdg.312

THREE PHASE EFFICIENCY CURVES

50Hz

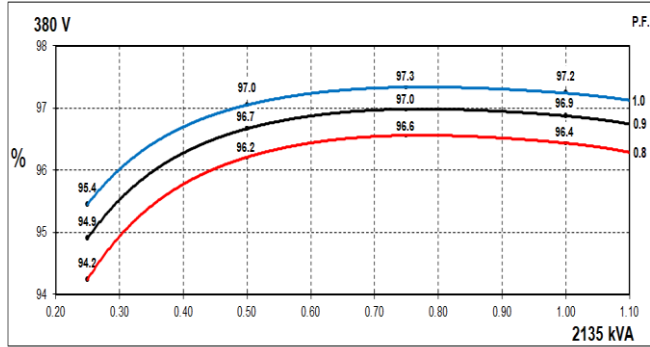

60Hz

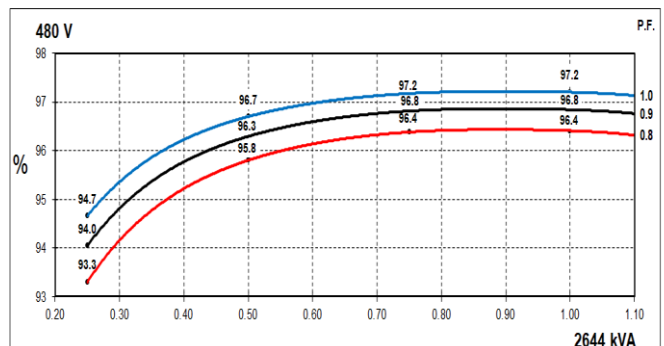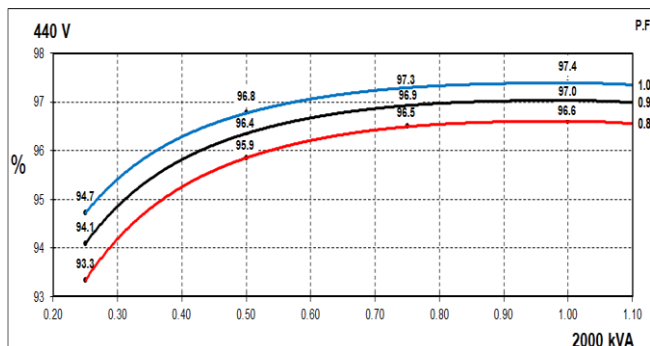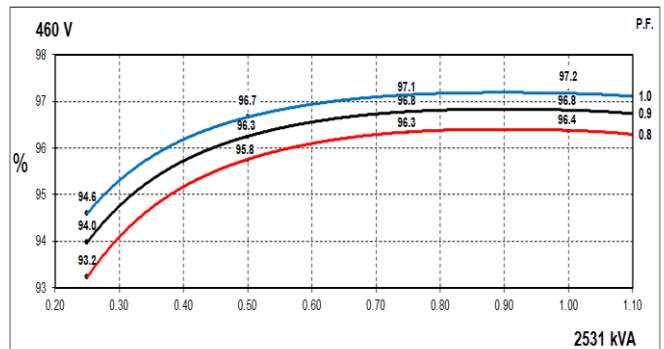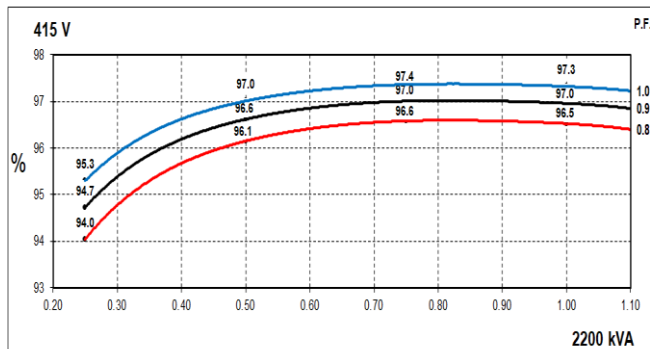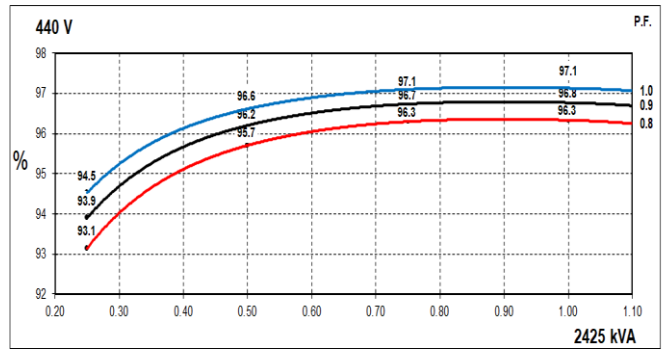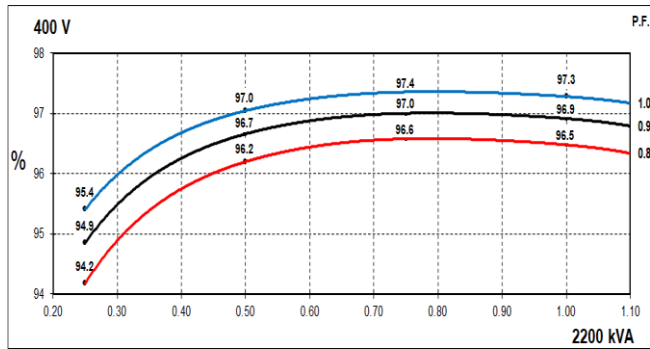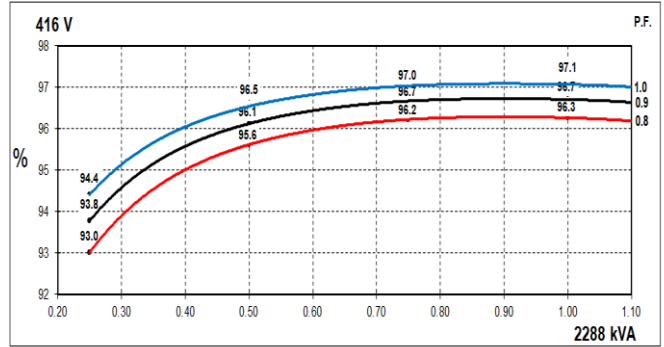


STAMFORD


S7L1M-J4 Wdg.312

Locked Rotor Motor Starting Curves - Separately Excited

50Hz

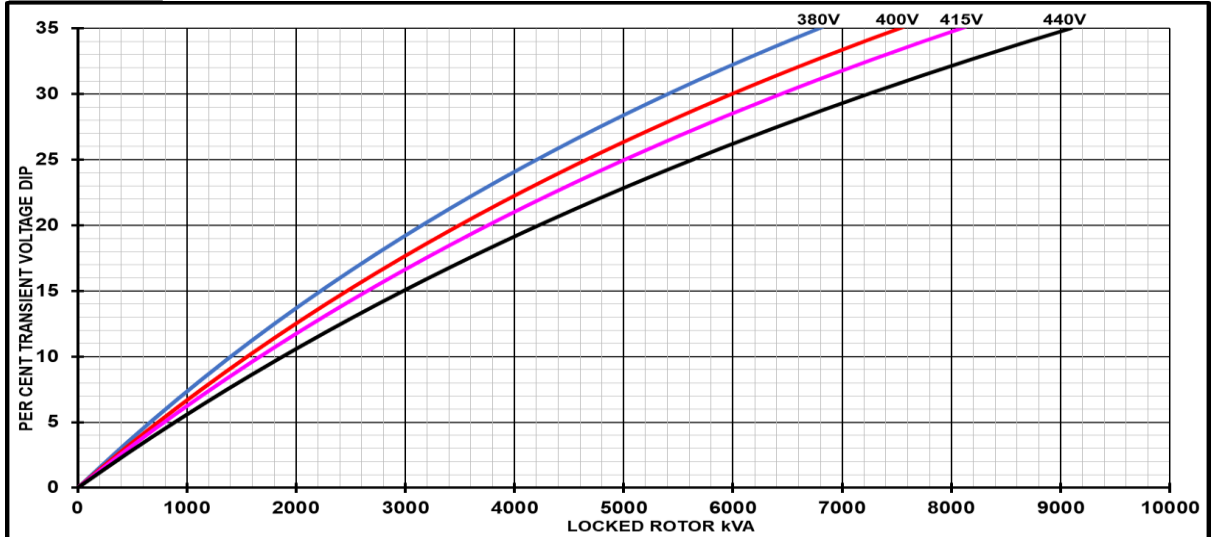

60Hz

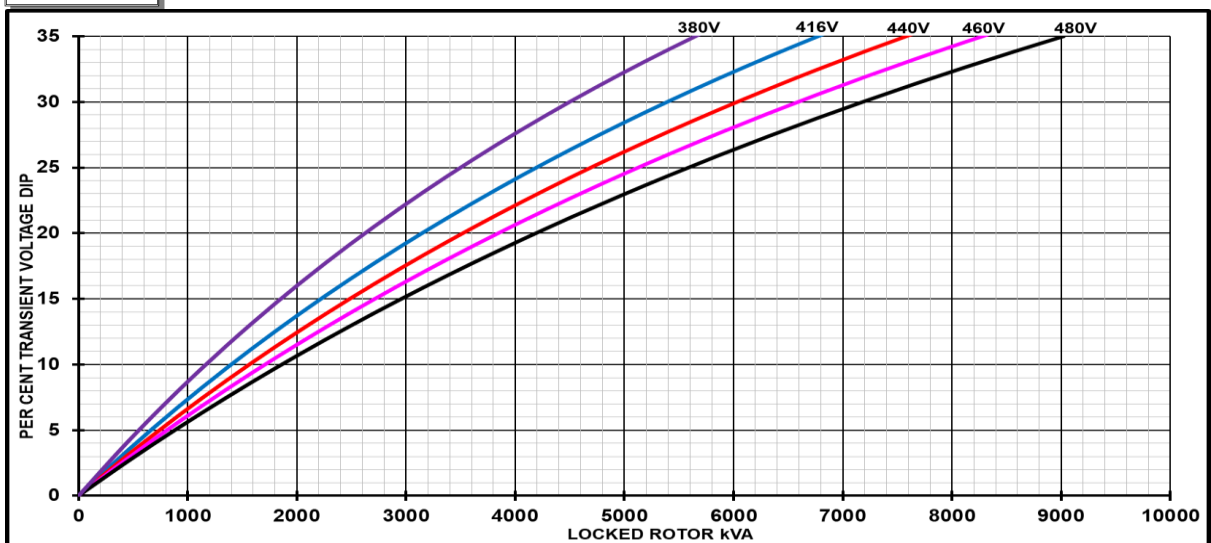

Transient Voltage Dip Scaling Factor		Transient Voltage Rise Scaling Factor	
Lagging PF	Scaling Factor	Lagging PF	Scaling Factor
<= 0.4	1.00	<= 0.4	1.25
0.5	0.95	0.5	1.20
0.6	0.90	0.6	1.15
0.7	0.86	0.7	1.10
0.8	0.83	> 0.7	1.00
0.9	0.75		
0.95	0.70		
1	0.65		


Note: To determine % Transient Voltage Dip or Voltage Rise at various PF, multiply the % Voltage Dip from the curve directly by the Scaling Factor.

STAMFORD

S7L1M-J4 Wdg.312


Three-phase Short Circuit Decrement Curve - Separately Excited

50Hz

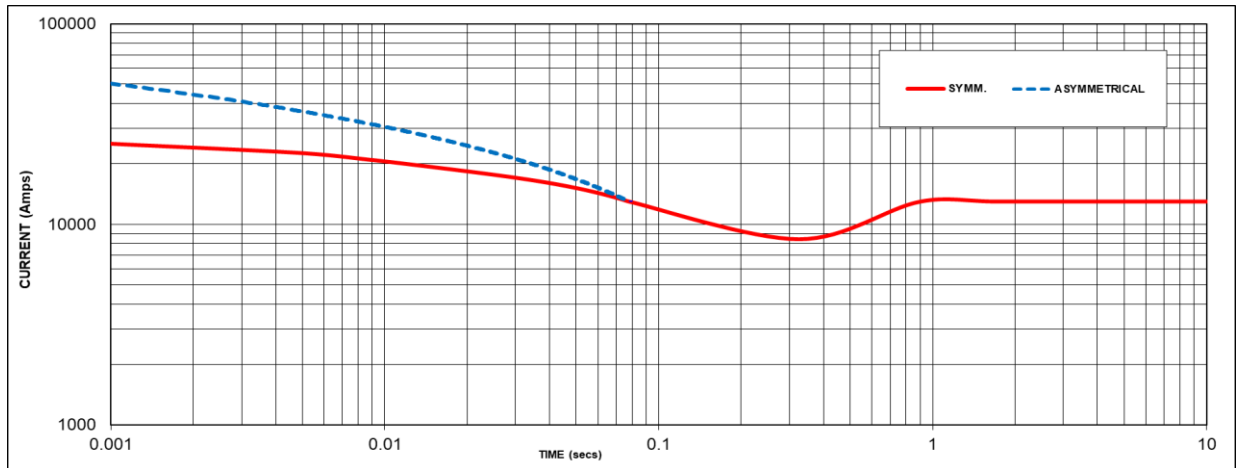

60Hz

Sustained Short Circuit = 11142 Amps

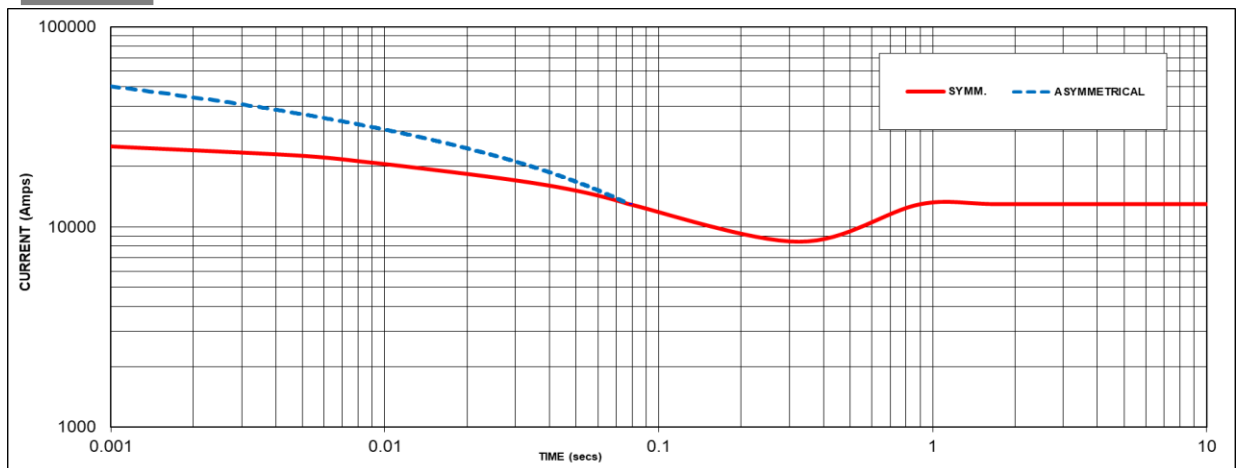

Sustained Short Circuit = 12987 Amps

Note 1

The following multiplication factors should be used to adjust the values from curve between time 0.001 seconds and the minimum current point in respect of nominal operating voltage :

50Hz		60Hz	
Voltage	Factor	Voltage	Factor
380V	X 1.00	416V	X 1.00
400V	X 1.05	440V	X 1.06
415V	X 1.09	460V	X 1.10
440V	X 1.16	480V	X 1.15

The sustained current value is constant irrespective of voltage level

Note 2

The following multiplication factor should be used to convert the values calculated in accordance with NOTE 1 to those applicable to the various types of short circuit :

	3-phase	2-phase L-L	1-phase L-N
Instantaneous	x 1.00	x 0.87	x 1.30
Minimum	x 1.00	x 1.80	x 3.20
Sustained	x 1.00	x 1.50	x 2.50
Max. sustained duration	10 sec.	5 sec.	2 sec.

Note 3

All other times are unchanged

Curves are drawn for Star connections under no-load excitation at rated speeds. For other connection (where applicable) the following multipliers should be applied to current values as shown :

Parallel Star = Curve current value X 2


Series Delta = Curve current value X 1.732

STAMFORD®


S7L1M-J4 Wdg.312

Typical Alternator Operating Charts

400V/50Hz

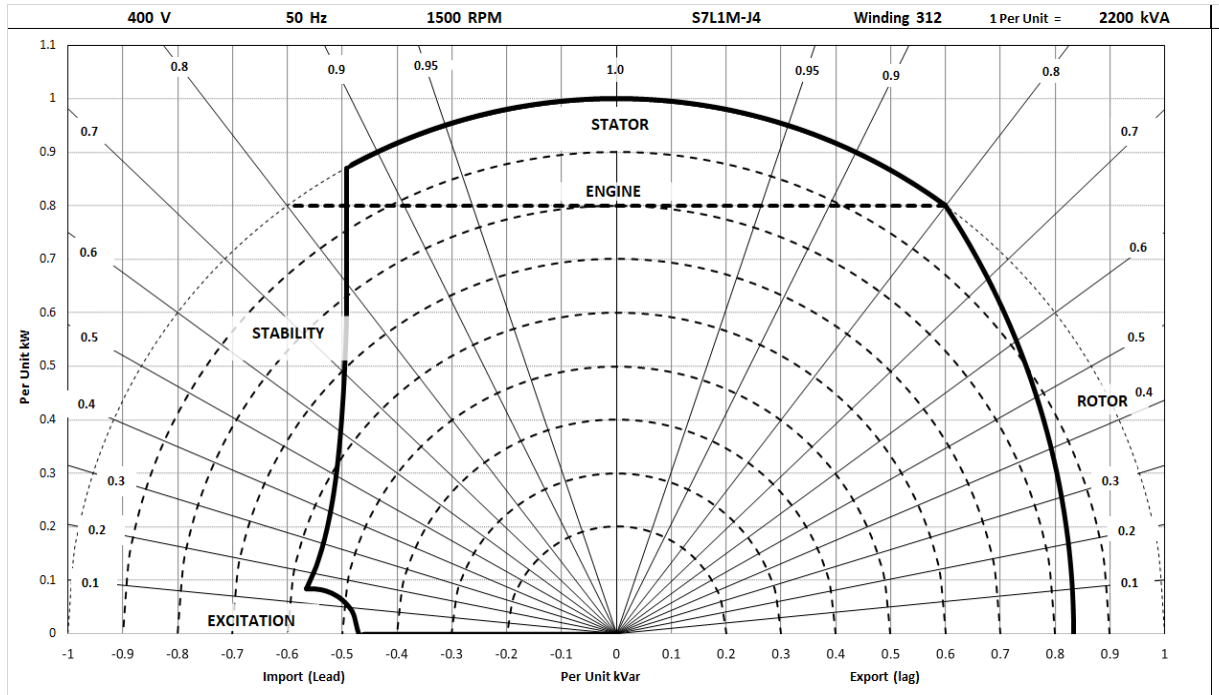

480V/60Hz

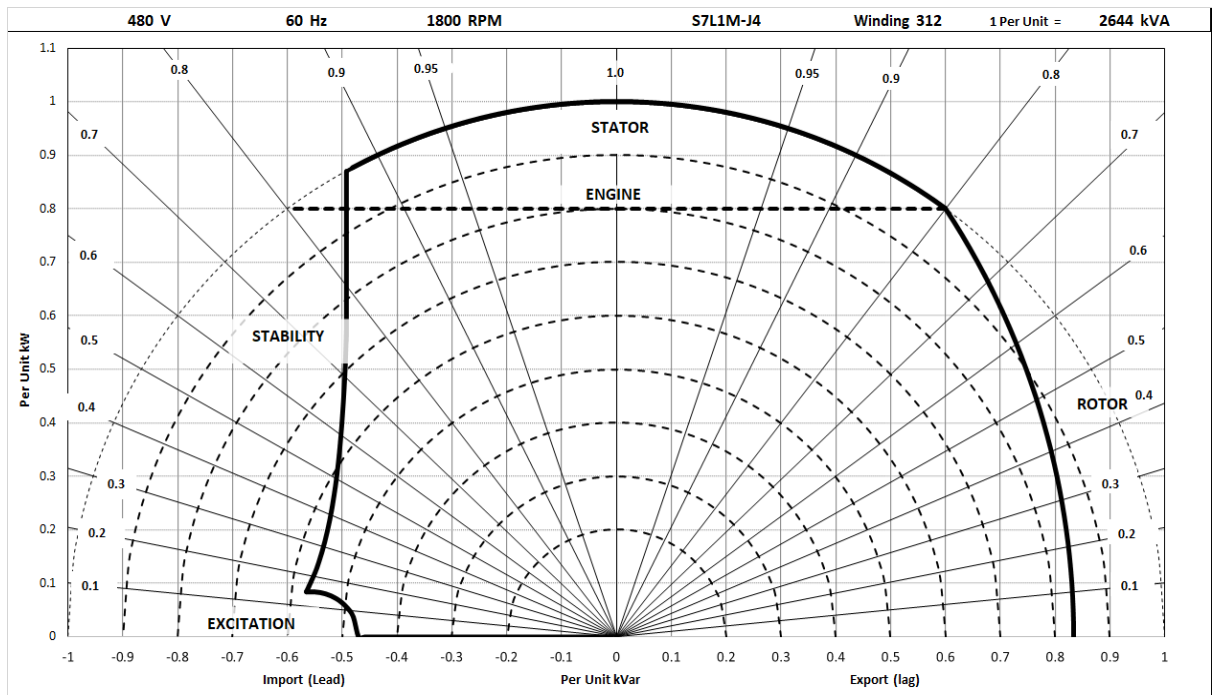

STAMFORD®

S7L1M-J4 Wdg.312

RATINGS AT 0.8 POWER FACTOR

Class - Temp Rise		Standby				Cont. H - 110/50°C				Cont. F - 90/50°C				Cont. B - 70/50°C			
50 Hz	Star (V)	380	400	415	440	380	400	415	440	380	400	415	440	380	400	415	440
	Parallel Star (V)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Delta (V)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	kVA	N/A	N/A	N/A	N/A	2135	2200	2200	2000	1928	1980	1980	1826	1638	1680	1680	1575
	kW	N/A	N/A	N/A	N/A	1708	1760	1760	1600	1542	1584	1584	1461	1310	1344	1344	1260
	Efficiency (%)	N/A	N/A	N/A	N/A	96.4	96.5	96.5	96.6	96.5	96.6	96.6	96.6	96.6	96.6	96.6	96.5
	kW Input	N/A	N/A	N/A	N/A	1771	1824	1823	1656	1598	1640	1640	1512	1357	1391	1391	1305

60 Hz	Star (V)	416	440	460	480	416	440	460	480	416	440	460	480	416	440	460	480
	Parallel Star (V)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Delta (V)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	kVA	N/A	N/A	N/A	N/A	2288	2425	2531	2644	2137	2269	2363	2475	1812	1913	2000	2088
	kW	N/A	N/A	N/A	N/A	1830	1940	2025	2115	1710	1815	1890	1980	1450	1530	1600	1670
	Efficiency (%)	N/A	N/A	N/A	N/A	96.3	96.3	96.4	96.4	96.3	96.4	96.4	96.4	96.3	96.3	96.4	96.4
	kW Input	N/A	N/A	N/A	N/A	1901	2014	2101	2194	1776	1884	1961	2053	1506	1589	1660	1732

De-rates

All values tabulated above are subject to the following reductions:

- 5% when air inlet filters are fitted
- 3% for every 500 meters by which the operating altitude exceeds 1000 meters above mean sea level
- 3% for every 5°C by which the operational ambient temperature exceeds 40°C @ Class H temperature rise (please refer to applications for ambient temperature de-rates at other temperature rise classes)
- For any other operating conditions impacting the cooling circuit please refer to applications

Note: Requirement for operating in an ambient exceeding 60°C and altitude exceeding 4000 meters (for <690V) or 1500 meters (for >690V) must be referred to applications.

Dimensional and Torsional Drawing

For dimensional and torsional information please refer to the alternator General Arrangement and rotor drawings available on our website (<http://stamford-avk.com/>)

Note: Continuous development of our products means that the information contained in our data sheets can change without notice, and specifications should always be confirmed with Cummins Generator Technologies prior to purchase.



Follow us @stamfordavk



Cummins Generator Technologies



View our videos at youtube.com/stamfordavk

news.stamford-avk.com

For Applications Support:
applications@cummins.com

For Customer Service:
emea.service@cummins.com

For General Enquiries:
Stamford-avk@cummins.com

Copyright 2016. Cummins Generator Technologies Ltd. All rights reserved.
Cummins and the Cummins logo are registered trade marks of Cummins Inc.
STAMFORD is a registered trade mark of Cummins Generator Technologies Ltd.

