

**Technical Data Sheet for AvK-Alternators**

FM 7.3-5

Date:	09/10/13	Customer:	GENERIC DATASHEET only
Project No.:		AvK Reference:	dig156l_6_50_3300

Object data:	
Site:	Prime Mover:
Application: Stationary Power Plant	Manufacturer:

Generator data:					
Generator:	DIG 156 I/6	Poles:	6	Standards: IEC 60034	
Rated power:	5600 kVA	4480 kWe	4601 kWm		
Power factor:	0.80				
Power at pf 1,0	4509 kVA	4509 kWe	4601 kWm		
Rated voltage:	3.3 kV				
Speed:	1000 1/min				
Frequency:	50 Hz	Voltage range / frequency range:			
Rated current:	979.7 A	Zone A according IEC 60034-1 (dU = +/-5%, df = +/-2%)			
Winding pitch:	ca. 5/6				
Insulation class:	Stator: Class F	Rotor: Class F	Temperature rise:	F	
Ambient temperature:	40 ° C	Environment:	Standard environment		
Site altitude:	1000 m				
Enclosure:	IP23	Filter:			
Cooling:	IC 01 - Open-circuit ventilation				
Coolant:	Ambient Air	Temperature	40 ° C	Temperature Air inlet	40 ° C
		Coolant:		generator:	
		Cooling air vol.:	5.5 m³/s	Cooling water quantity:	n/a
Moment of inertia (I):	710 kgm²	Weight:	17100 Kg	Losses (environment):	121 KW
				Losses (cooling):	n/a

Wires:	4 terminals, starpoint connected in terminal box
Operation mode:	Single mode
Regulators:	
Voltage regulator:	DECS 100

Electrical data: (acc. IEC)					
Efficiencies:	110%	100%	75%	50%	25%
Power factor 0.8	97,24	97,37	97,27	96,76	94,91
Power factor 0.9	97,57	97,69	97,55	96,98	95,05
Power factor 1.0	97,9	98	97,83	97,19	95,19

Reactances and time constants											
	unsaturated		saturated			unsaturated		saturated			
X _d	1.79	1.61	p.u.	X _q	0.89	0.87	p.u.	T _{d0'}	3.3 s	T _{d0''}	0.04629 s
X _{d'}	0.270	0.270	p.u.	X _{q'}	0.89	0.87	p.u.	T _{d'}	0.50 s	T _{q0'}	0.6 s
X _{d''}	0.193	0.175	p.u.	X _{q''}	0.193	0.193	p.u.	T _{d''}	0.03 s	T _{q0''}	0.27668 s
X ₂	0.202	0.184	p.u.	X ₀	0.058	0.053	p.u.	T _a	0.1 s	T _{q'}	0.6 s
X _{1s}	n.a.	0.105	p.u.							T _{q''}	0.06 s
Short circuit ratio saturated: 0.62					Z _n 1.945 Ohm						


Short circuit data:		
Initial short circuit current (3-phase):	I _{k''}	5599 A
Max. peak current (3-phase):	I _s	14253 A
Sustained short circuit current:	I _k	2939 A
Minimum 3 x rated current for max.10 s		
Initial short circuit torque:	M _{k2}	397.2 kNm
	M _{k3}	238.3 kNm
Max. faulty synchron moment:	M _f	854.0 kNm
Rated kVA torque:	M _{SN}	53.48 kNm
Rated torque	M _N	42.78 kNm
Shaft torque	M _{Sh}	43.94 kNm

Load application:	
max. load application: 3111 kVA (corresponds to 55,56 % from 5600 kVA) for Power factor 0.4 15% transient voltage drop	Power: 5600 kVA Power factor: 0.8 transient voltage drop: -21.3 %

Remarks:

Alternator :	DIG 156 I/6		
Rated output [kVA]	5600	Rated power factor:	0.8
Rated frequency [Hz]	50	Rated speed [rpm]	1000
			Rated voltage [kV]: 3.3


Wirkungsgrad-Kennlinie - Efficiency Curve

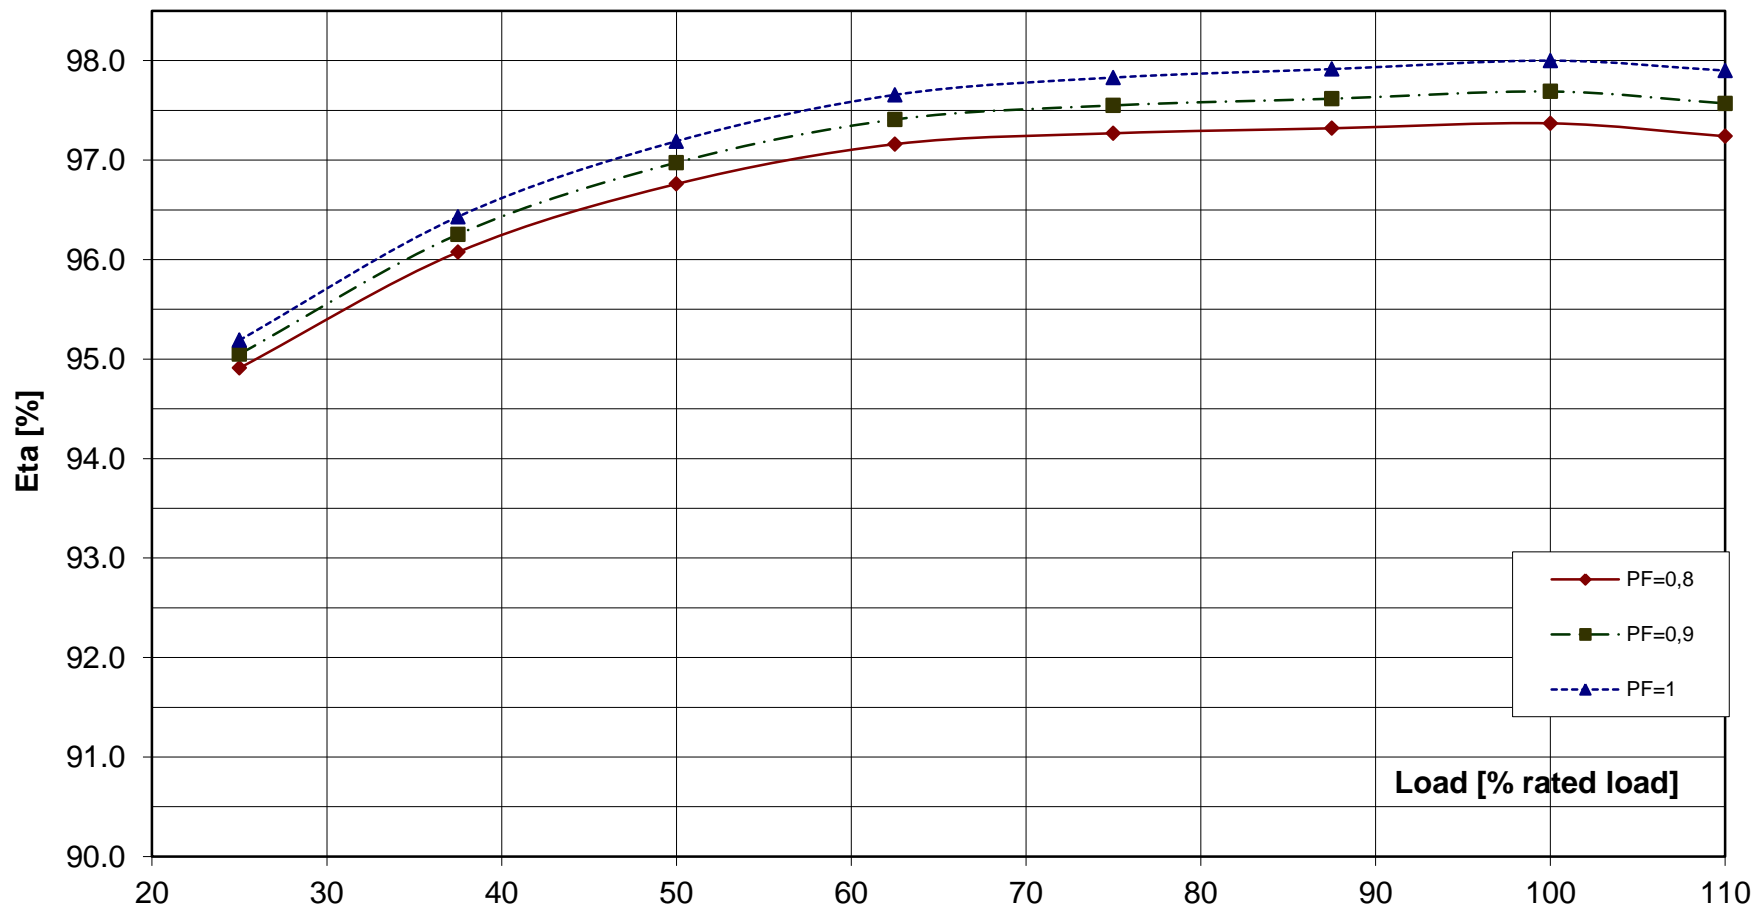

Alternator : DIG 156 I/6

Rated output [kVA]	5600	Rated power factor:	0.8	Rated voltage [kV]:	3.3
Rated frequency [Hz]	50	Rated speed [rpm]	1000		

Transient Voltage rise or drop for sudden load removal or application

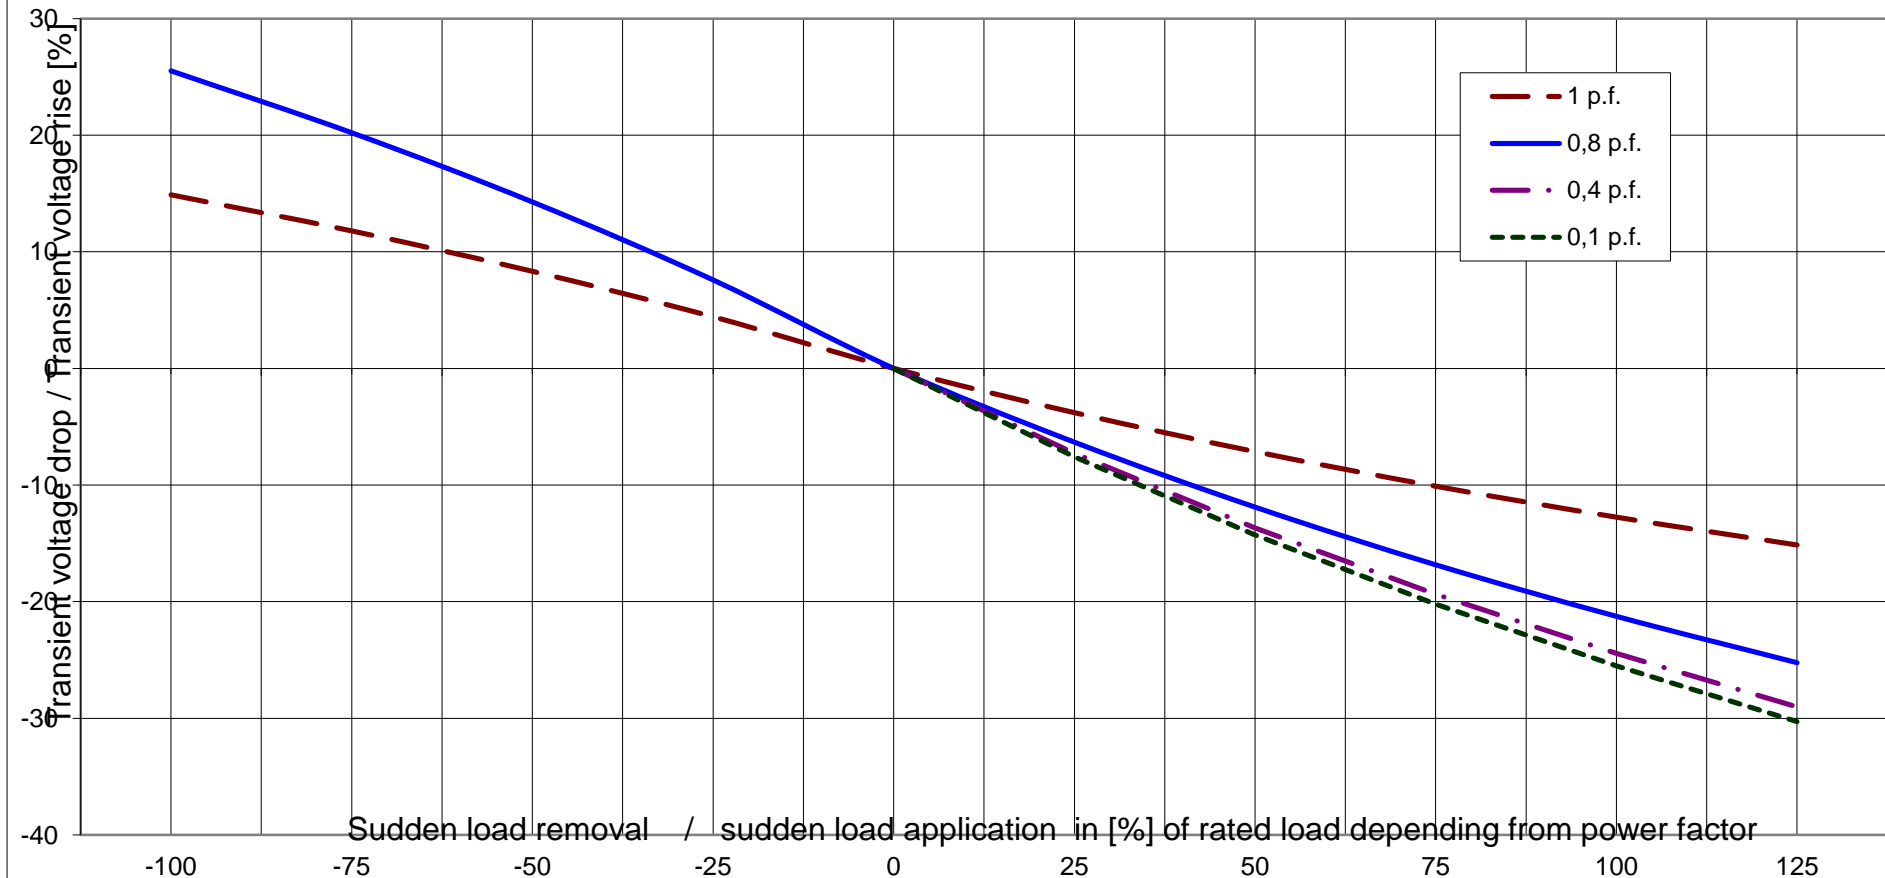




Technisches Datenblatt - Diagramme
Technical data sheet - Diagrams

ING-FCD-0112

Alternator : **DIG 156 I/6**

Rated output [kVA]	5600	Rated power factor:	0.8	Rated voltage [kV]:	3.3
Rated frequency [Hz]	50	Rated speed [rpm]	1000	MSN related to kVA:	53.48 KNm

Kurzschlußmomenten-Verlauf 2-poliger KS
Short circuit torque at 2-phase SC

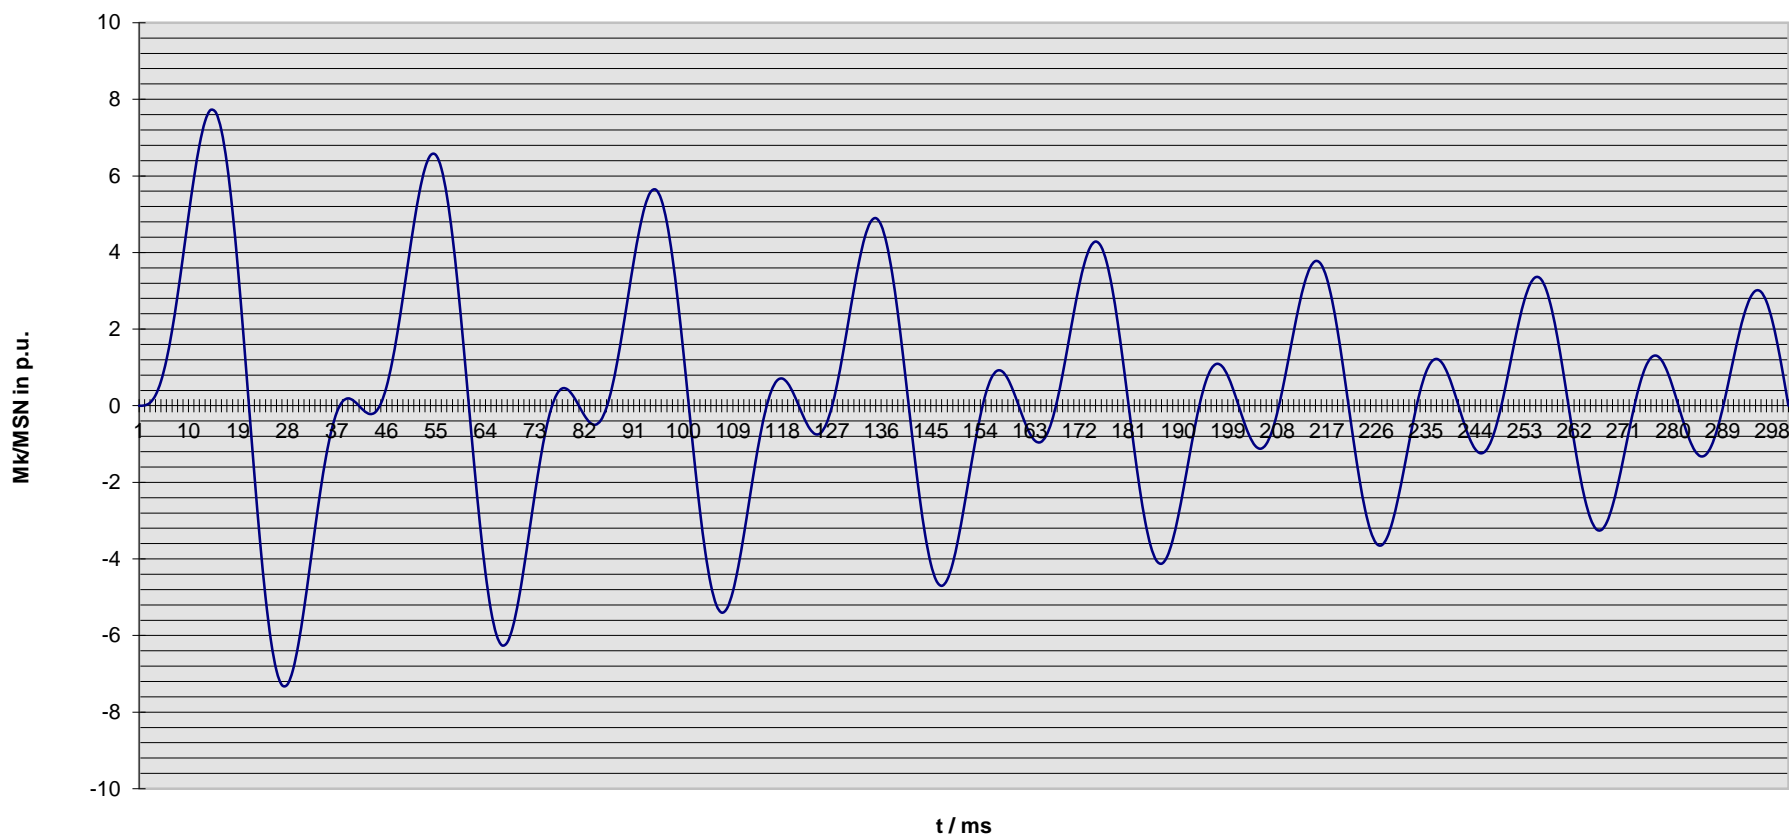

Nenndaten / nominal data

DIG 156 I/6

Leistung S_N : **5600 kVA**

$\cos \varphi$: **0.80**

Rating

p.f.

Spannung U_N : **3.30 kV**

Strom I_N : **980 A**

Voltage

Current

Frequenz f : **50 Hz**

Drehzahl n : **1,000 min⁻¹**

Frequency


Speed

Schutzart **IP23**

Protection

Kurzschlussstrom $I_{k3\text{phasig}} / I_N$ [p.u.]
Short-circuit current $I_{k3\text{phase}} / I_N$ [p.u.]

Stosskurzschluss-Strom, 3-phasig, asymmetrisch /
Sudden short circuit current, 3-phase, asymmetrical

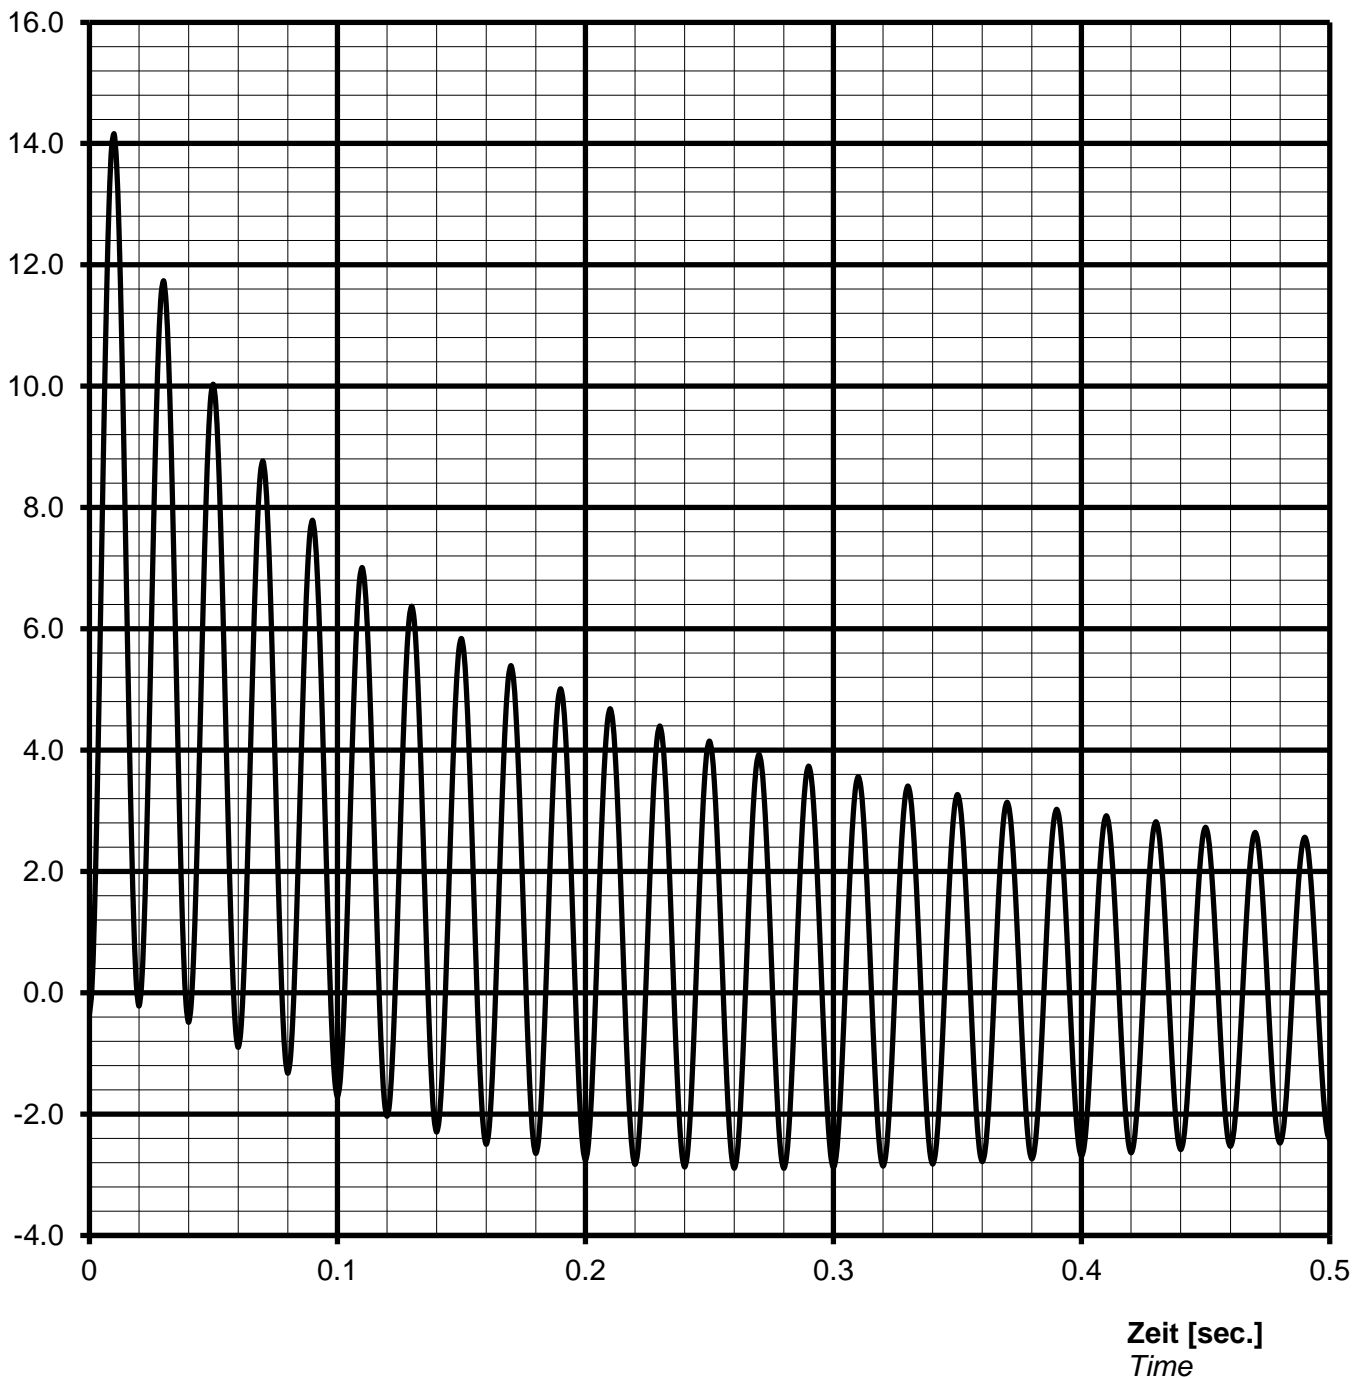

Notizen / remarks:

Maximum asymmetric peak value $I_{\text{peak}} =$ **13873 A** or **14.16 p.u.**

Nennwerten / nominal data

DIG 156 I/6

Leistung S_N : **5600** kVA

$\cos \varphi$: **0.80**

Rating

p.f.

Spannung U_N : **3.30** kV

Strom I_N : **980** A

Voltage

Current

Frequenz f: **50** Hz

Drehzahl n: **1000** min⁻¹

Frequency

Speed

Schutzart **IP23**

Protection

Überlast Kennlinie Overload capability



Notizen / remarks:

Strom / Zeit Kriterien:

$$(I / I_N)^2 \cdot t = 45s$$

Current/time characteristics:

$$1,5 \cdot I_N \text{ for } 30 \text{ s}$$

$$1,1 \cdot I_N \text{ for } 1 \text{ h in } 6 \text{ h}$$

Nenndaten / nominal data

DIG 156 I/6

Rating S_N : **5600 kVA**

p.f. **0.80**

Bemessungsleistung

Leistungsfaktor $\cos \varphi$:

Nominal voltage U_N : **3.30 kV**

Nominal current I_N : **980 A**

Bemessungsspannung

Bemessungsstrom

Frequency f_N : **50 Hz**

Speed n : **1000 min⁻¹**

Frequenz

Drehzahl

Protection: **IP23**

Schutzart

Inverse current or unbalanced negative sequence current



Remarks / Notizen:



Technische Daten selbstregelnden Drehstrom-Synchrongenerator
technical data for self regulating three phase alternator

ING-FCD-0112


TYPE

DIG 156 I/6

Projekt:

Order Nr.:

Capability (P-Q) Diagram

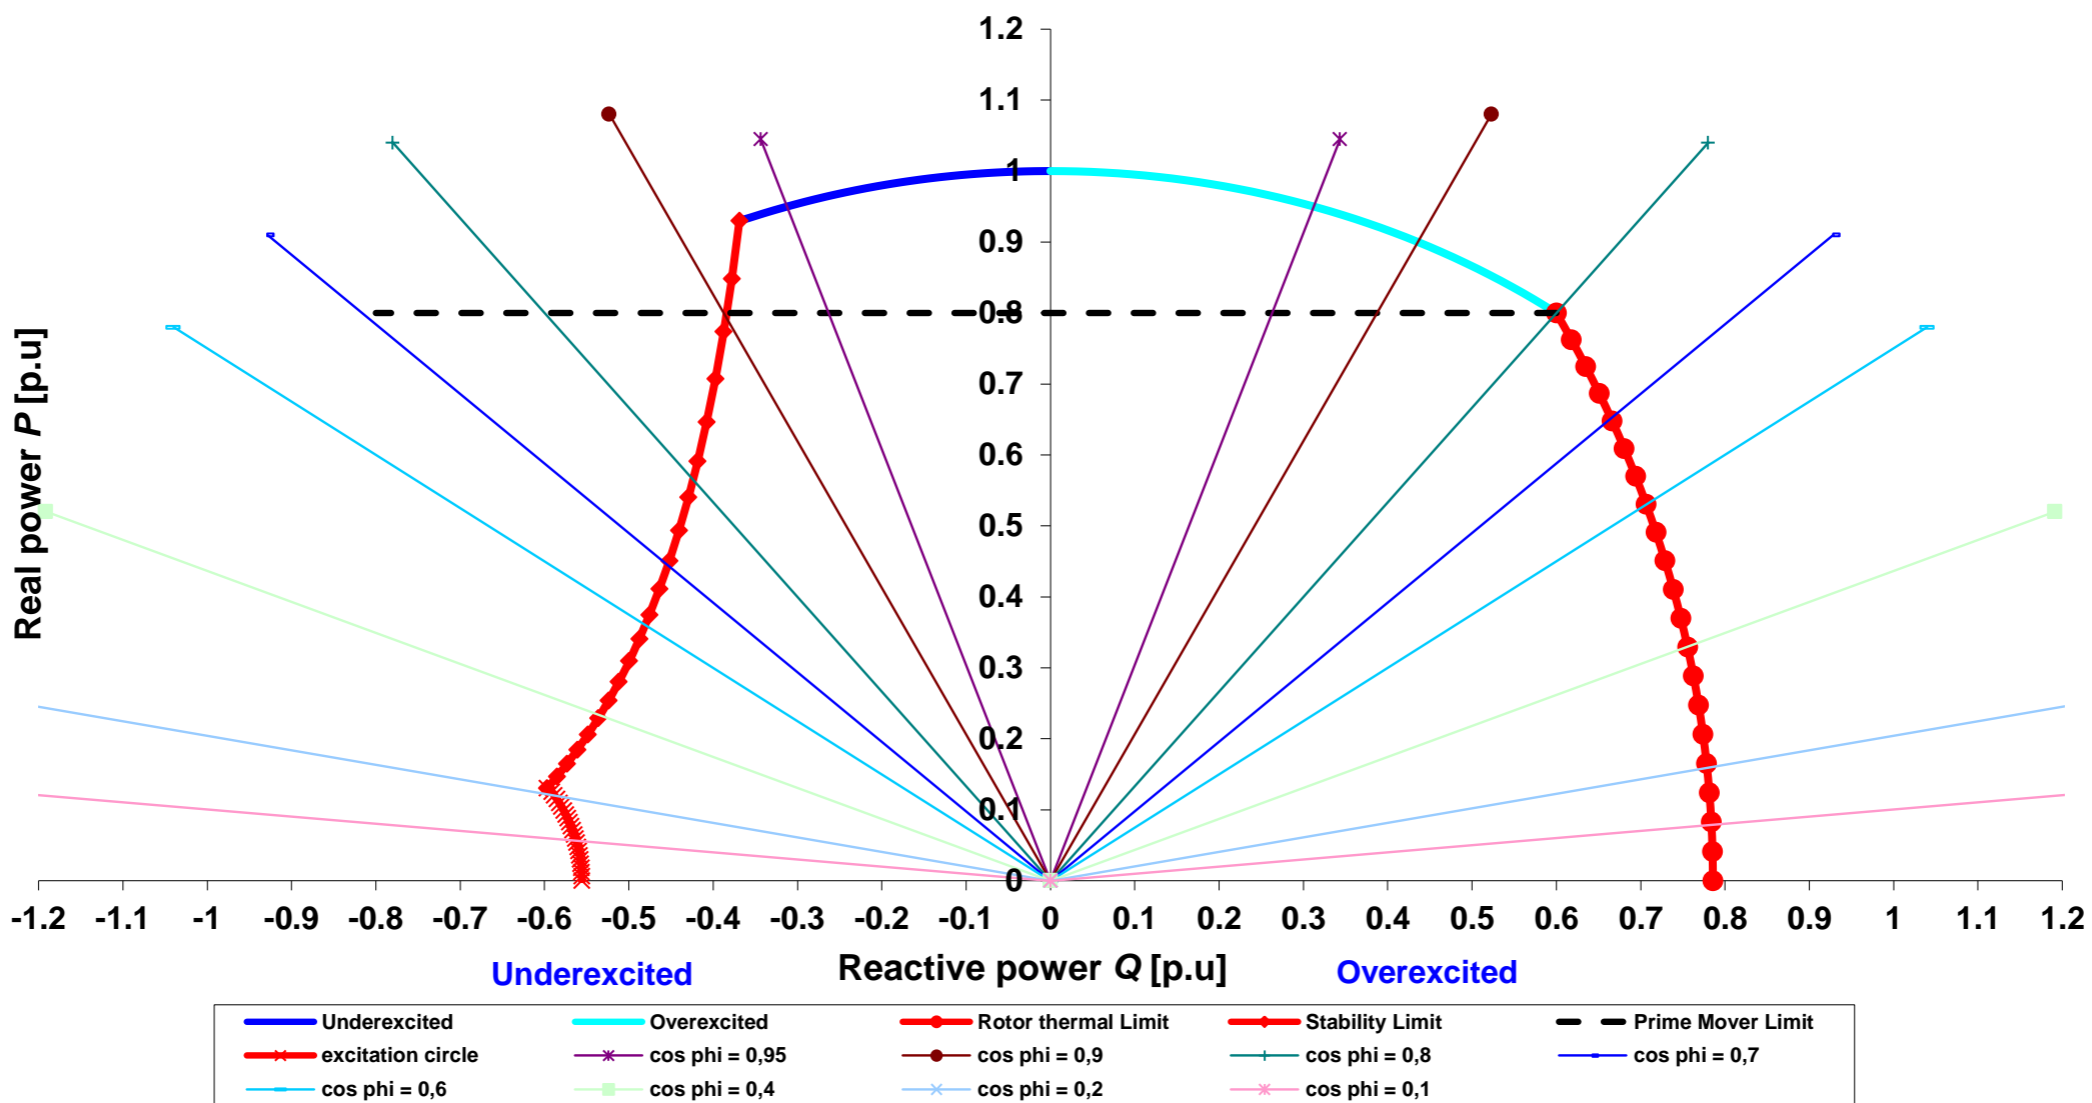

Cummins Generator Technologies

Datum / date:

18/10/2013

TYPE

DIG 156 I/6

Projekt:

Order Nr.:

