

# STAMFORD®


## S9L1D-E4 Wdg.607 - Technical Data Sheet

### Standards

STAMFORD industrial alternators meet the requirements of the relevant parts of the IEC 60034 and the relevant sections of other international standards such as BS5000-3, ISO 8528-3, VDE 0530, NEMA MG1-32, CSA C22.2-100 and AS 60034. Other standards and certifications can be considered on request.

### Quality Assurance

Alternators are manufactured using production procedures having a quality assurance level to BS EN ISO 9001.

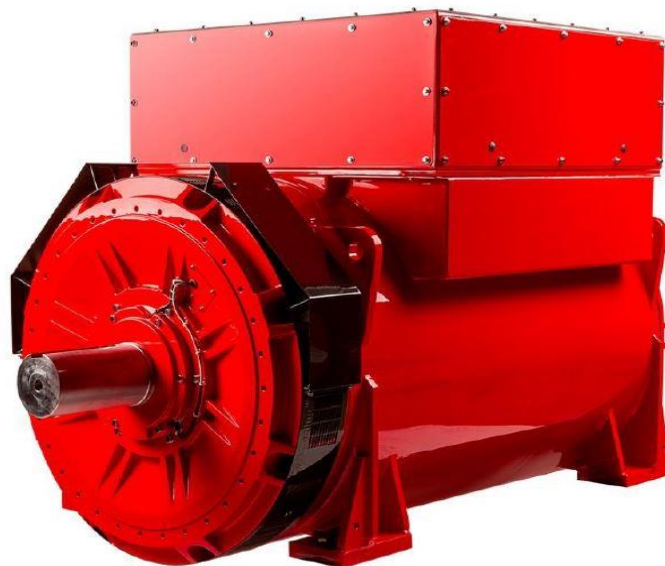

### Excitation and Voltage Regulators

Excitation System					
AVR Type	DM110	DECS100	DECS150		
Voltage Regulation	± 0.25%	± 0.25%	± 0.25%		with 4% Engine Governing
AVR Power	PMG	PMG	PMG		

No Load Excitation Voltage (V)	10.9
No Load Excitation Current (A)	1.0
Full Load Excitation Voltage (V)	45
Full Load Excitation Current (A)	3.7
Exciter Time Constant (seconds)	0.194

# STAMFORD®

## S9L1D-E4 Wdg.607

Electrical Data	
Insulation System	H
Stator Winding	Double Layer Concentric
Winding Pitch	2/3
Winding Leads	6
Winding Number	607
Number of Poles	4
IP Rating	IP23
RFI Suppression	BS EN 61000-6-2 & BS EN 61000-6-4, VDE 0875G, VDE 0875N. Refer to factory for others
Waveform Distortion	NON-DISTORTING BALANCED LINEAR LOAD < 5.0%
Short Circuit Ratio	1/Xd
Steady State X/R Ratio	33.06
60 Hz	
Telephone Interference	TIF<50
Cooling Air Flow	3.33 m³/sec
Voltage Star (V)	600
Voltage Parallel Star (V)	-
Voltage Delta (V)	-
kVA Base Rating (Class H) for Reactance Values (kVA)	4144
Saturated Values in Per Unit at Base Ratings and Voltages	
Xd Dir. Axis Synchronous	1.960
X'd Dir. Axis Transient	0.173
X''d Dir. Axis Subtransient	0.120
Xq Quad. Axis Reactance	1.021
X''q Quad. Axis Subtransient	0.106
XL Stator Leakage Reactance	0.055
X2 Negative Sequence Reactance	0.170
X0 Zero Sequence Reactance	0.064
Unsaturated Values in Per Unit at Base Ratings and Voltages	
Xd Dir. Axis Synchronous	2.352
X'd Dir. Axis Transient	0.199
X''d Dir. Axis Subtransient	0.140
Xq Quad. Axis Reactance	1.051
X''q Quad. Axis Subtransient	0.128
XL Stator Leakage Reactance	0.062
Xlr Rotor Leakage Reactance	0.079
X2 Negative Sequence Reactance	0.204
X0 Zero Sequence Reactance	0.074

# STAMFORD

## S9L1D-E4 Wdg.607


<b>Time Constants (Seconds)</b>		
T'd Transient Time Const.	0.2253	
T''d Sub-Transient Time Const.	0.0184	
T'do O.C. Field Time Const.	4.2535	
Ta Armature Time Const.	0.039	
T''q Sub-Transient Time Const.	0.0098	
<b>Resistances in Ohms (<math>\Omega</math>) at 22°C</b>		
Stator Winding Resistance (Ra), per phase for series connected	0.00048	
Rotor Winding Resistance (Rf)	1.56	
Exciter Stator Winding Resistance	11.2	
Exciter Rotor Winding Resistance per phase	0.0342	
PMG Phase Resistance (Rpmg) per phase	1.91	
Positive Sequence Resistance (R1)	0.00060	
Negative Sequence Resistance (R2)	0.00069	
Zero Sequence Resistance (R0)	0.00060	
<b>Saturation Factors</b>		
	600V	
SG1.0	0.136	
SG1.2	1.034	
<b>Mechanical Data</b>		
Shaft and Keys	All alternator rotors are dynamically balanced to better than ISO 21940-11 Grade 2.5 for minimum vibration in operation. Two bearing generators are balanced with a half key.	
	1 Bearing	2 Bearing
SAE Adaptor		0, 00, None
Moment of Inertia	-	102.6 kgm <sup>2</sup>
Weight Wound Stator	-	3530kg
Weight Wound Rotor	-	2387kg
Weight Complete Alternator	-	7050kg
Shipping weight in a Crate	-	7442kg
Packing Crate Size	-	280 x 200 x 220(cm)
Maximum Over Speed	2250 RPM for two minutes	
Bearing Drive End	-	6236
Bearing Non-Drive End	-	6324

# STAMFORD®

S9L1D-E4 Wdg.607

## THREE PHASE EFFICIENCY CURVES

60Hz

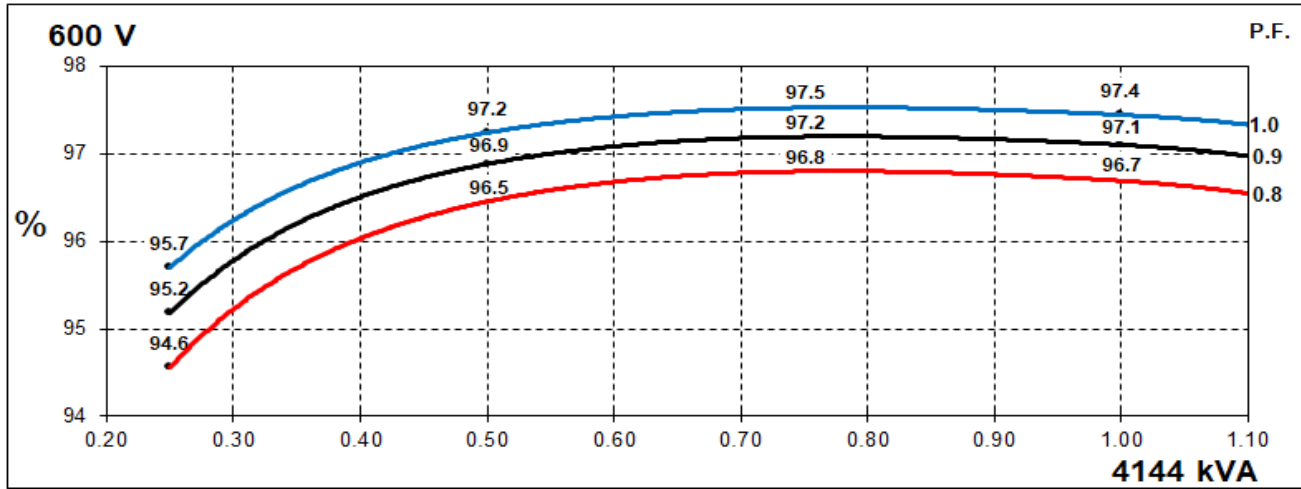


# STAMFORD

S9L1D-E4 Wdg.607

## Locked Rotor Motor Starting Curves - Separately Excited

**60Hz**

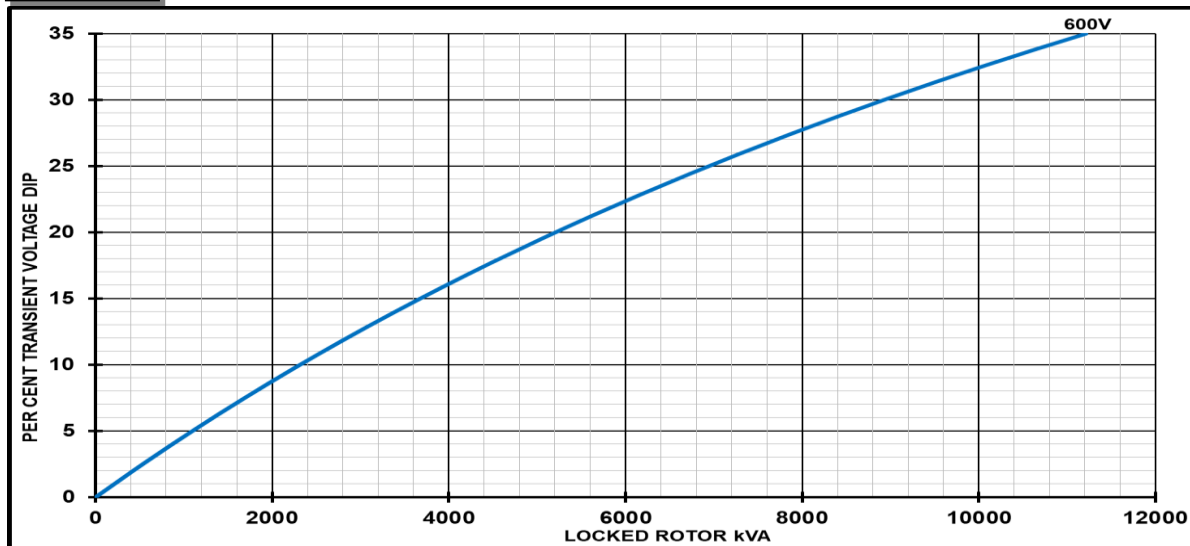

Transient Voltage Dip Scaling Factor		Transient Voltage Rise Scaling Factor	
Lagging PF	Scaling Factor	Lagging PF	Scaling Factor
<= 0.4	1.00	<= 0.4	1.25
0.5	0.95	0.5	1.20
0.6	0.90	0.6	1.15
0.7	0.86	0.7	1.10
0.8	0.83	> 0.7	1.00
0.9	0.75		
0.95	0.70		
1	0.65		


**Note:** To determine % Transient Voltage Dip or Voltage Rise at various PF, multiply the % Voltage Dip from the curve directly by the Scaling Factor.

# STAMFORD®

## S9L1D-E4 Wdg.607

### Three-phase Short Circuit Decrement Curve - Separately Excited

**60Hz**

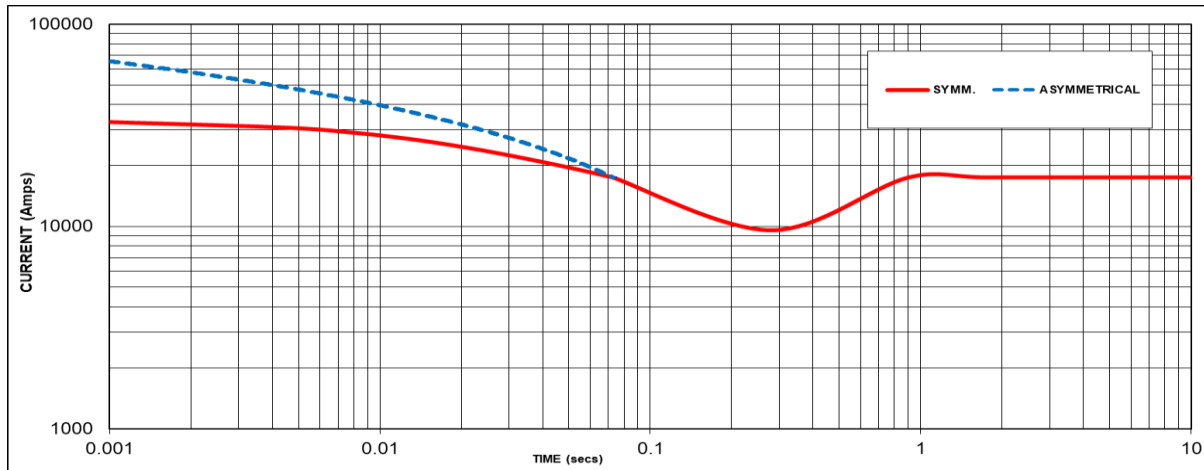

Sustained Short Circuit = 17462 Amps

**Note 1**

The following multiplication factors should be used to adjust the values from curve between time 0.001 seconds and the minimum current point in respect of nominal operating voltage :

50Hz		60Hz	
Voltage	Factor	Voltage	Factor
-	-	600V	X 1.00
-	-	-	-
-	-	-	-
-	-	-	-

The sustained current value is constant irrespective of voltage level

**Note 2**

The following multiplication factor should be used to convert the values calculated in accordance with NOTE 1 to those applicable to the various types of short circuit :

	3-phase	2-phase L-L	1-phase L-N
Instantaneous	x 1.00	x 0.87	x 1.30
Minimum	x 1.00	x 1.80	x 3.20
Sustained	x 1.00	x 1.50	x 2.50
Max. sustained duration	10 sec.	5 sec.	2 sec.

**Note 3**

All other times are unchanged

Curves are drawn for Star connections under no-load excitation at rated speeds. For other connection (where applicable) the following multipliers should be applied to current values as shown :

Parallel Star = Curve current value X 2


Series Delta = Curve current value X 1.732

# STAMFORD

S9L1D-E4 Wdg.607

## Typical Alternator Operating Charts

**600V/60Hz**

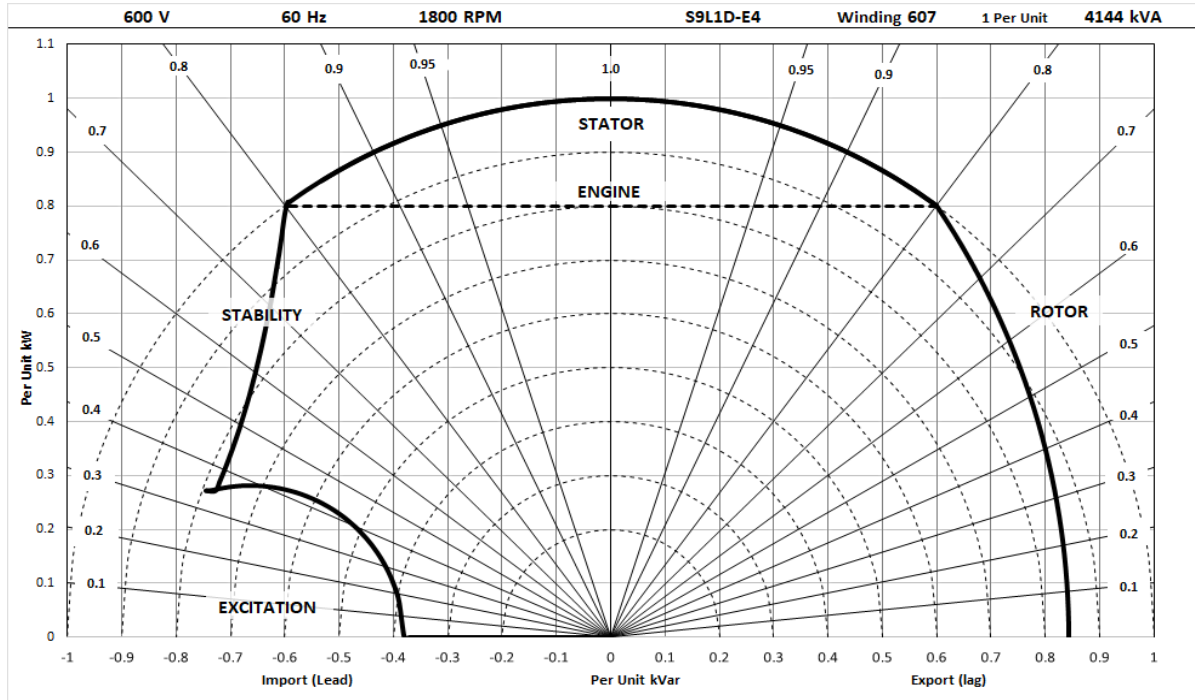

# STAMFORD®

## S9L1D-E4 Wdg.607

### RATINGS AT 0.8 POWER FACTOR

Class - Temp Rise		Standby - 150/40°C	Cont. H - 125/40°C	Cont. F - 105/40°C	Cont. B - 80/40°C
<b>50</b> Hz	Star (V)	N/A	N/A	N/A	N/A
	Parallel Star (V)	N/A	N/A	N/A	N/A
	Delta (V)	N/A	N/A	N/A	N/A
	kVA	N/A	N/A	N/A	N/A
	kW	N/A	N/A	N/A	N/A
	Efficiency (%)	N/A	N/A	N/A	N/A
	kW Input	N/A	N/A	N/A	N/A

<b>60</b> Hz	Star (V)	600	600	600	600
	Parallel Star (V)	N/A	N/A	N/A	N/A
	Delta (V)	N/A	N/A	N/A	N/A
	kVA	4431	4144	3875	3375
	kW	3545	3315	3100	2700
	Efficiency (%)	96.6	96.7	96.7	96.8
	kW Input	3669	3429	3204	2789

#### De-rates

All values tabulated above are subject to the following reductions:

- 5% when air inlet filters are fitted
- 3% for every 500 meters by which the operating altitude exceeds 1000 meters above mean sea level
- 3% for every 5°C by which the operational ambient temperature exceeds 40°C @ Class H temperature rise (please refer to applications for ambient temperature de-rates at other temperature rise classes)
- For marine alternators, 3% for every 5°C by which the operational ambient temperature exceeds 50°C
- For any other operating conditions impacting the cooling circuit please refer to applications

Note: Requirement for operating in an ambient exceeding 60°C and altitude exceeding 4000 meters (for <690V) or 1500 meters (for >690V) must be referred to applications.

#### Dimensional and Torsional Drawing

For dimensional and torsional information please refer to the alternator General Arrangement and rotor drawings available on our website (<http://stamford-avk.com/>)

**Note:** Continuous development of our products means that the information contained in our data sheets can change without notice, and specifications should always be confirmed with Cummins Generator Technologies prior to purchase.





Follow us @stamfordavk



Cummins Generator Technologies



View our videos at [youtube.com/stamfordavk](https://youtube.com/stamfordavk)

[stamford-avk.com](https://stamford-avk.com)

**For Applications Support:**  
**[applications@cummins.com](mailto:applications@cummins.com)**

**For Customer Service:**  
**[emea.service@cummins.com](mailto:emea.service@cummins.com)**

**For General Enquiries:**  
**[Stamford-avk@cummins.com](mailto:Stamford-avk@cummins.com)**

Copyright 2025. Cummins Generator Technologies Ltd. All rights reserved.  
Cummins and the Cummins logo are registered trade marks of Cummins Inc.  
STAMFORD is a registered trade mark of Cummins Generator Technologies Ltd.

