

**Technical Data Sheet for AvK-Alternators**

FM 7.3-5

Date:	09/10/13	Customer:	GENERIC DATASHEET only
Project No.:		AvK Reference:	dig130h_4_50_6600

**Object data:**

Site:		Prime Mover:	
Application:	Stationary Power Plant	Manufacturer:	

**Generator data:**

Generator:	DIG 130 h/4	Poles:	4	Standards:	IEC 60034
Rated power:	2150 kVA	1720 kWe	1788 kWm		
Power factor:	0.80				
Power at pf 1,0	1736 kVA	1736 kWe	1788 kWm		
Rated voltage:	6.6 kV				
Speed:	1500 1/min				
Frequency:	50 Hz			Voltage range / frequency range:	
Rated current:	188.1 A			Zone A according IEC 60034-1 (dU = +/-5%, df = +/-2%)	

Winding pitch:	ca. 5/6
----------------	---------

Insulation class:	Stator: Class F	Rotor: Class F	Temperature rise:	F
-------------------	-----------------	----------------	-------------------	---

Ambient temperature:	40 ° C	Environment:	Standard environment
----------------------	--------	--------------	----------------------

Site altitude:	1000 m		
----------------	--------	--	--

Enclosure:	IP23	Filter:	
------------	------	---------	--

Cooling:	IC 01 - Open-circuit ventilation
----------	----------------------------------

Coolant:	Ambient Air	Temperature	40 ° C	Temperature Air inlet	40 ° C
----------	-------------	-------------	--------	-----------------------	--------

		Coolant:		generator:	
--	--	----------	--	------------	--

		Cooling air vol.:	3.0 m³/s	Cooling water quantity:	n/a
--	--	-------------------	----------	-------------------------	-----

Moment of inertia (I):	85 kgm²	Weight:	6300 Kg	Losses (environment):	68 KW
------------------------	---------	---------	---------	-----------------------	-------

		Losses (cooling):	n/a		
--	--	-------------------	-----	--	--

Wires:	4 terminals, starpoint connected in terminal box
--------	--

Operation mode:	Single mode
-----------------	-------------

Regulators:	
-------------	--

Voltage regulator:	DECS 100
--------------------	----------

**Electrical data: (acc. IEC)**

Efficiencies:	110%	100%	75%	50%	25%
Power factor 0.8	96,01	96,2	96,1	95,6	93,5
Power factor 0.9	96,49	96,65	96,5	95,85	93,65
Power factor 1.0	96,96	97,1	96,9	96,1	93,8

**Reactances and time constants**

	unsaturated	saturated		unsaturated	saturated				
$X_d$	2.40	2.16 p.u.	$X_q$	1.20	1.18 p.u.	$T_{d0'}$	2.9 s	$T_{d0''}$	0.02461 s
$X_d'$	0.315	0.315 p.u.	$X_q'$	1.20	1.18 p.u.	$T_{d'}$	0.42 s	$T_{q0'}$	0.3 s
$X_d''$	0.211	0.192 p.u.	$X_q''$	0.211	0.211 p.u.	$T_{d''}$	0.015 s	$T_{q0''}$	0.17062 s
$X_2$	0.222	0.202 p.u.	$X_0$	0.064	0.058 p.u.	$T_a$	0.08 s	$T_{q'}$	0.3 s
$X_{1s}$	n.a.	0.115 p.u.						$T_{q''}$	0.03 s

Short circuit ratio saturated:	0.46	$Z_n$	20.260 Ohm
--------------------------------	------	-------	------------

**Short circuit data:**

Initial short circuit current (3-phase):	$I_k''$	980 A	
Max. peak current (3-phase):	$I_s$	2495 A	
Sustained short circuit current:	$I_k$	564 A	Minimum 3 x rated current for max.10 s

Initial short circuit torque:	$M_{k2}$	92.7 kNm
	$M_{k3}$	55.6 kNm

Max. faulty synchron moment:	$M_f$	199.3 kNm
------------------------------	-------	-----------

Rated kVA torque:	$M_{SN}$	13.69 kNm
-------------------	----------	-----------

Rated torque	$M_N$	10.95 kNm
--------------	-------	-----------

Shaft torque	$M_{Sh}$	11.38 kNm
--------------	----------	-----------


**Load application:**

max. load application: 1024 kVA (corresponds to 47,62 % from 2150 kVA) for Power factor 0.4 15% transient voltage drop	Power: 2150 kVA Power factor: 0.8 transient voltage drop: -24.0 %
---	---

**Remarks:**

<b>Alternator :</b>	<b>DIG 130 h/4</b>		
Rated output [kVA]	2150	Rated power factor:	0.8
Rated frequency [Hz]	50	Rated speed [rpm]	1500
			Rated voltage [kV]: 6.6


### Wirkungsgrad-Kennlinie - Efficiency Curve

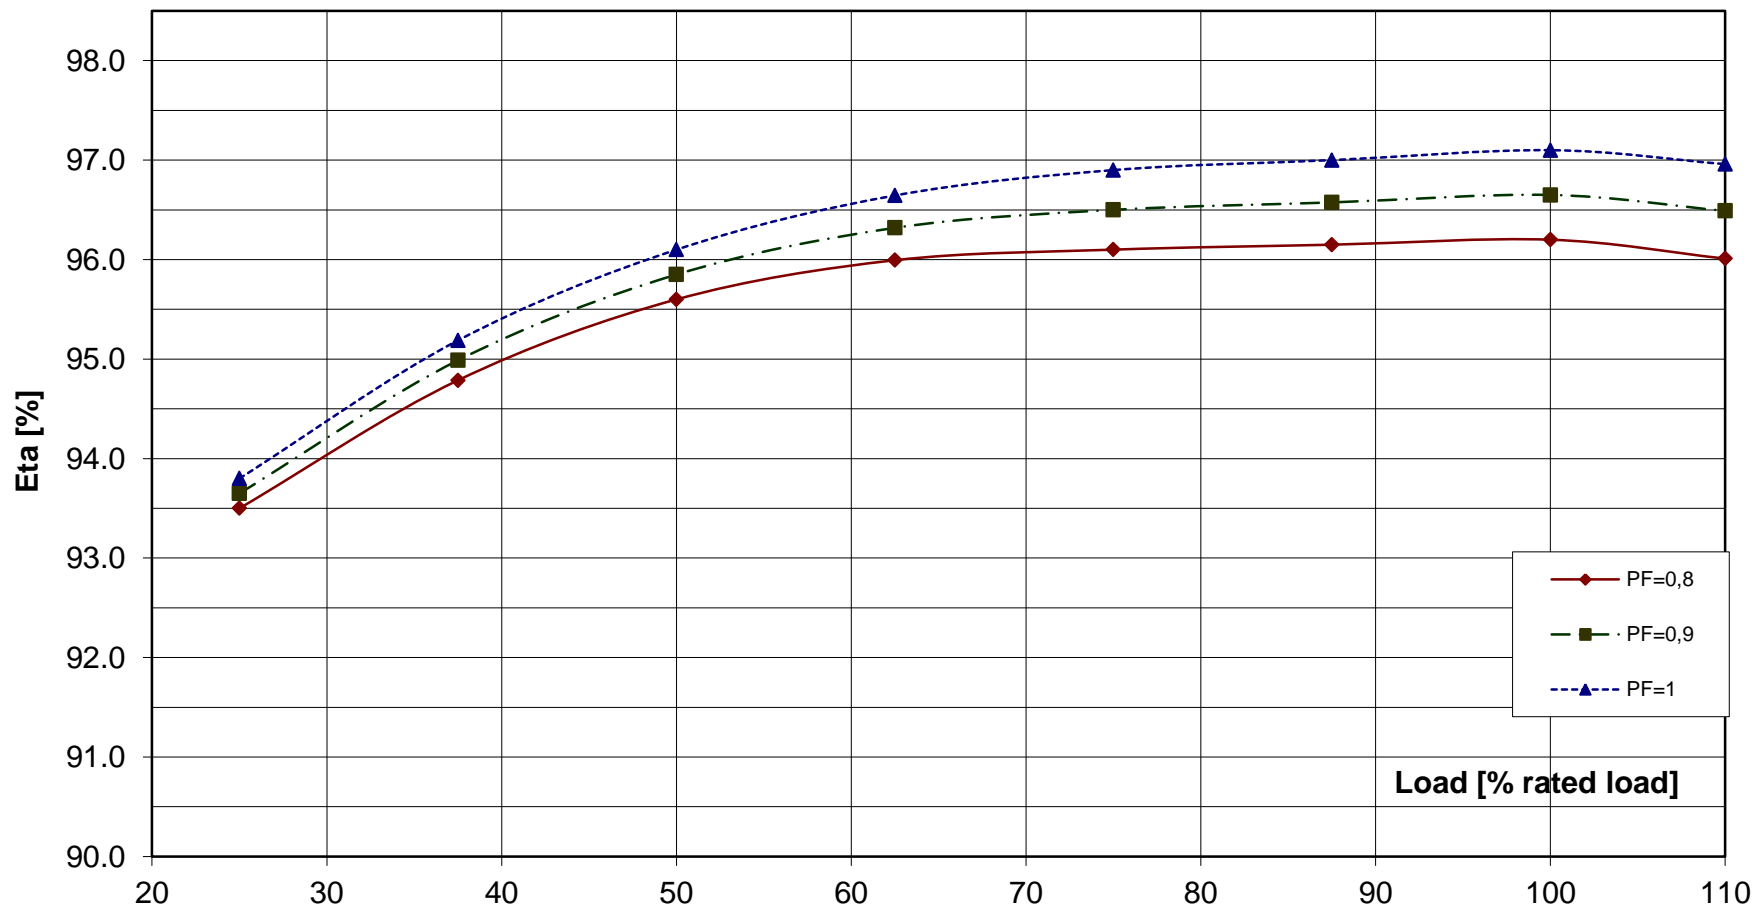

**Alternator : DIG 130 h/4**

Rated output [kVA]	2150	Rated power factor:	0.8	Rated voltage [kV]:	6.6
Rated frequency [Hz]	50	Rated speed [rpm]	1500		

**Transient Voltage rise or drop for sudden load removal or application**

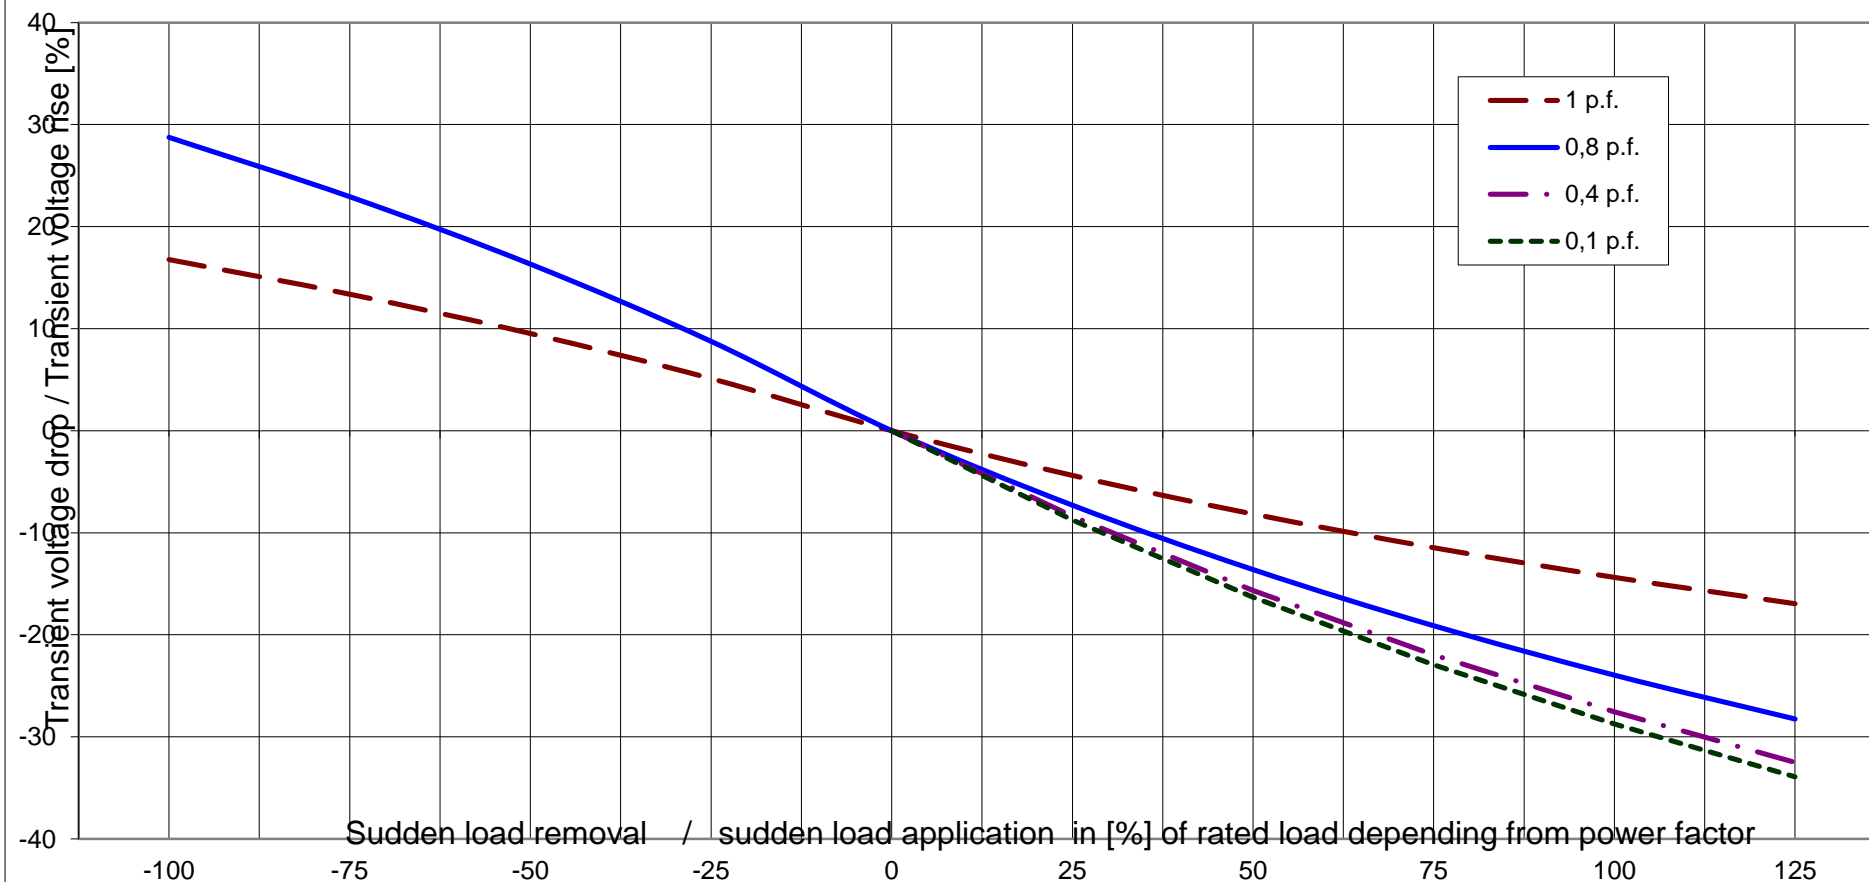




Technisches Datenblatt - Diagramme  
Technical data sheet - Diagrams

ING-FCD-0112

Alternator : **DIG 130 h/4**

Rated output [kVA]	2150	Rated power factor:	0.8	Rated voltage [kV]:	6.6
Rated frequency [Hz]	50	Rated speed [rpm]	1500	MSN related to kVA:	13.69 KNm

Kurzschlußmomenten-Verlauf 2-poliger KS  
Short circuit torque at 2-phase SC

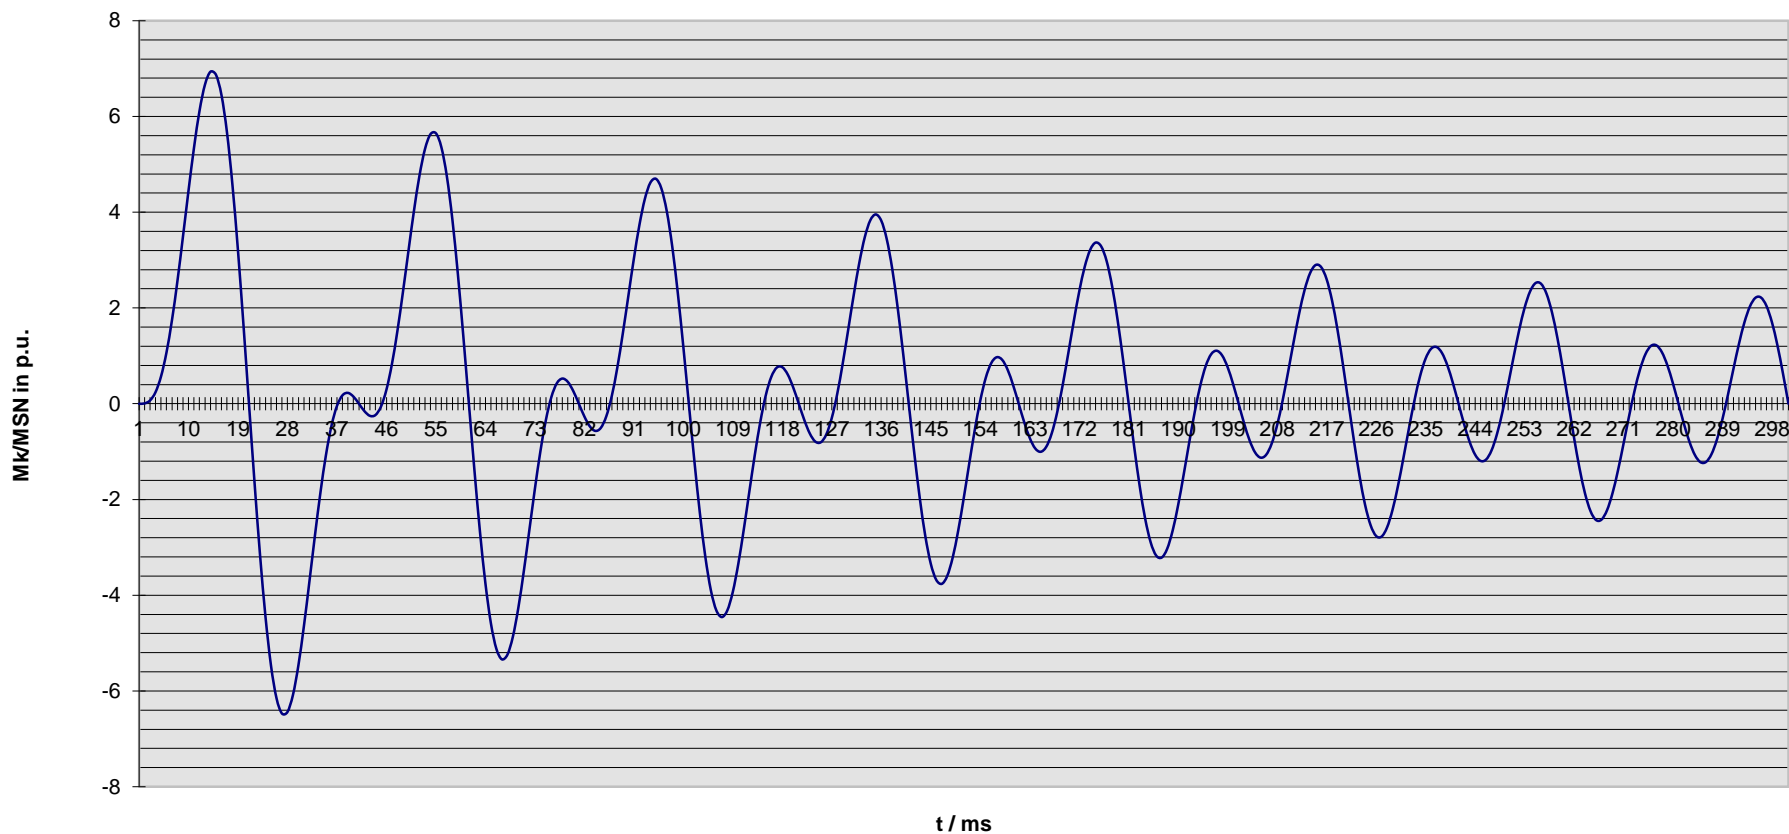

**Nenndaten / nominal data**

**DIG 130 h/4**

Leistung  $S_N$ : **2150 kVA**

$\cos \varphi$ : **0.80**

*Rating*

*p.f.*

Spannung  $U_N$ : **6.60 kV**

Strom  $I_N$ : **188 A**

*Voltage*

*Current*

Frequenz  $f$ : **50 Hz**

Drehzahl  $n$ : **1,500 min<sup>-1</sup>**

*Frequency*


*Speed*

Schutzart **IP23**

*Protection*

**Kurzschlussstrom  $I_{k3\text{phasig}} / I_N$  [p.u.]**  
**Short-circuit current  $I_{k3\text{phase}} / I_N$  [p.u.]**

**Stosskurzschluss-Strom, 3-phasig, asymmetrisch /**  
*Sudden short circuit current, 3-phase, asymmetrical*

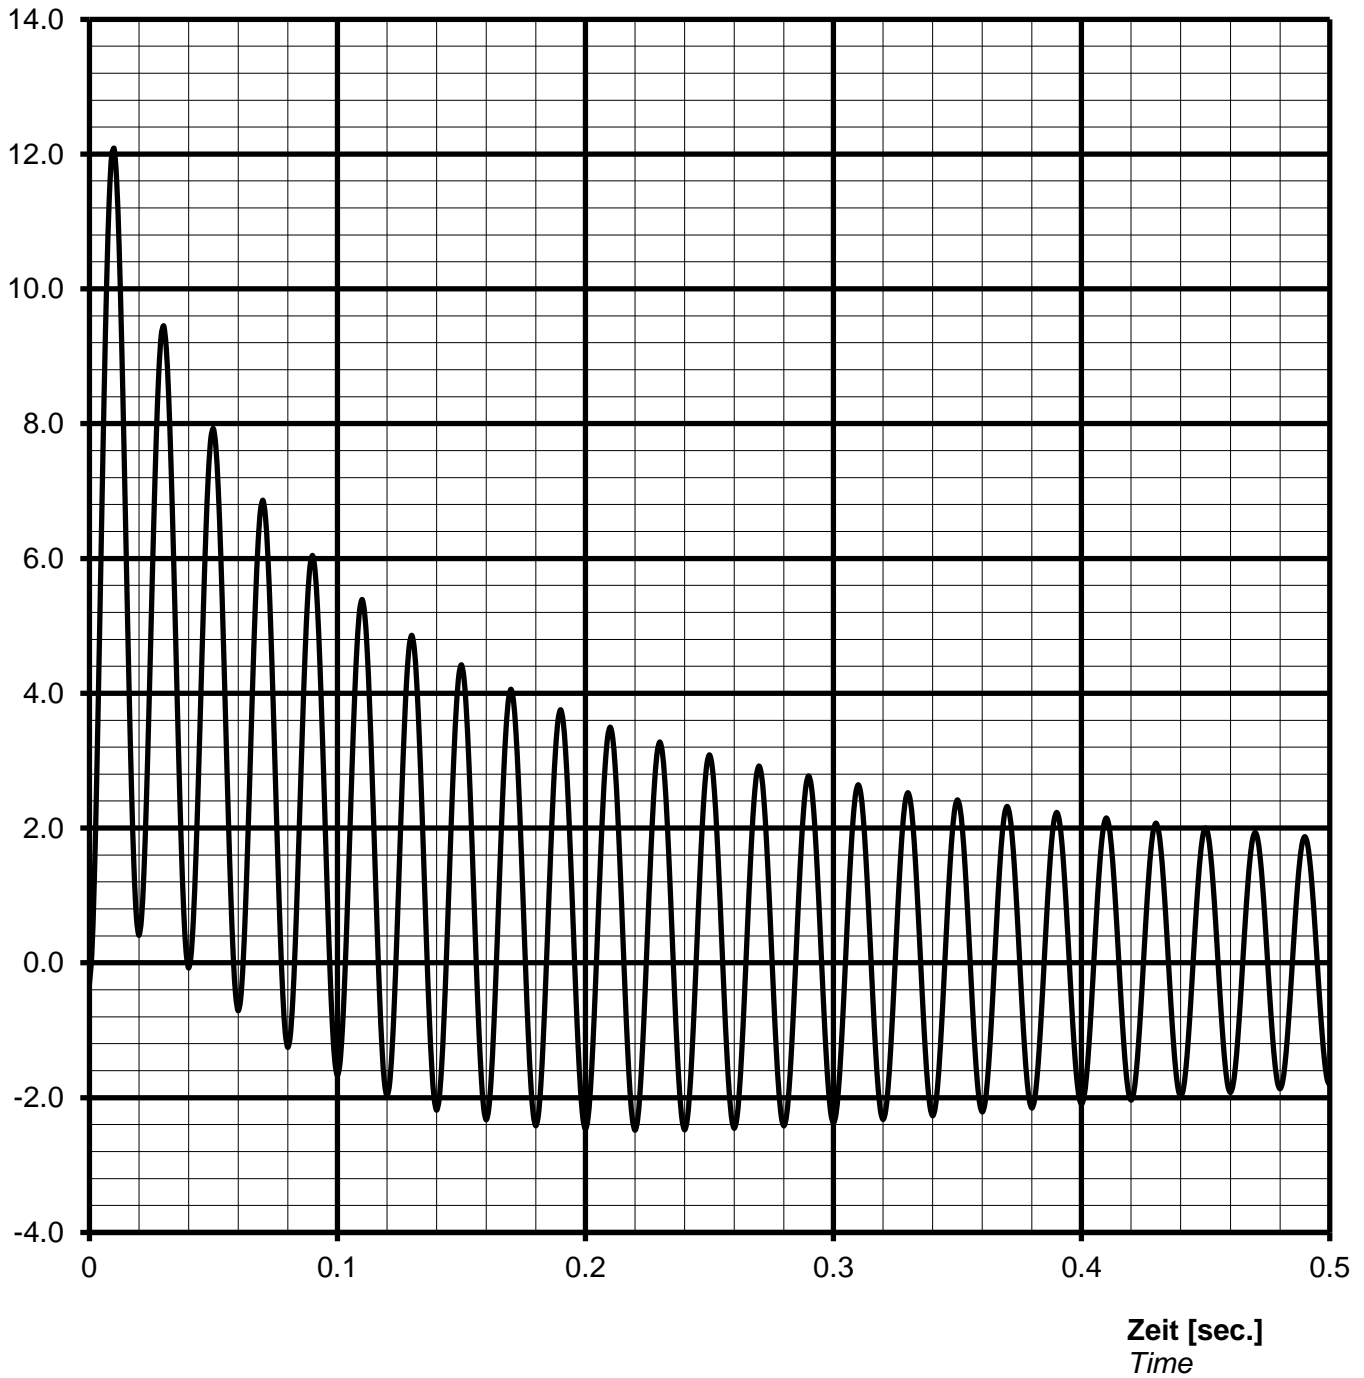

**Notizen / remarks:**

**Maximum asymmetric peak value  $I_{\text{peak}} = 2273 \text{ A}$  or  $12.08 \text{ p.u.}$**

#### Nenn Daten / nominal data

DIG 130 h/4

Leistung  $S_N$ : **2150 kVA**

$\cos \varphi$ : **0.80**

Rating

p.f.

Spannung  $U_N$ : **6.60 kV**

Strom  $I_N$ : **188 A**

Voltage

Current

Frequenz f: **50 Hz**

Drehzahl n: **1500 min<sup>-1</sup>**


Frequency

Speed

Schutzart **IP23**

Protection

#### Überlast Kennlinie Overload capability

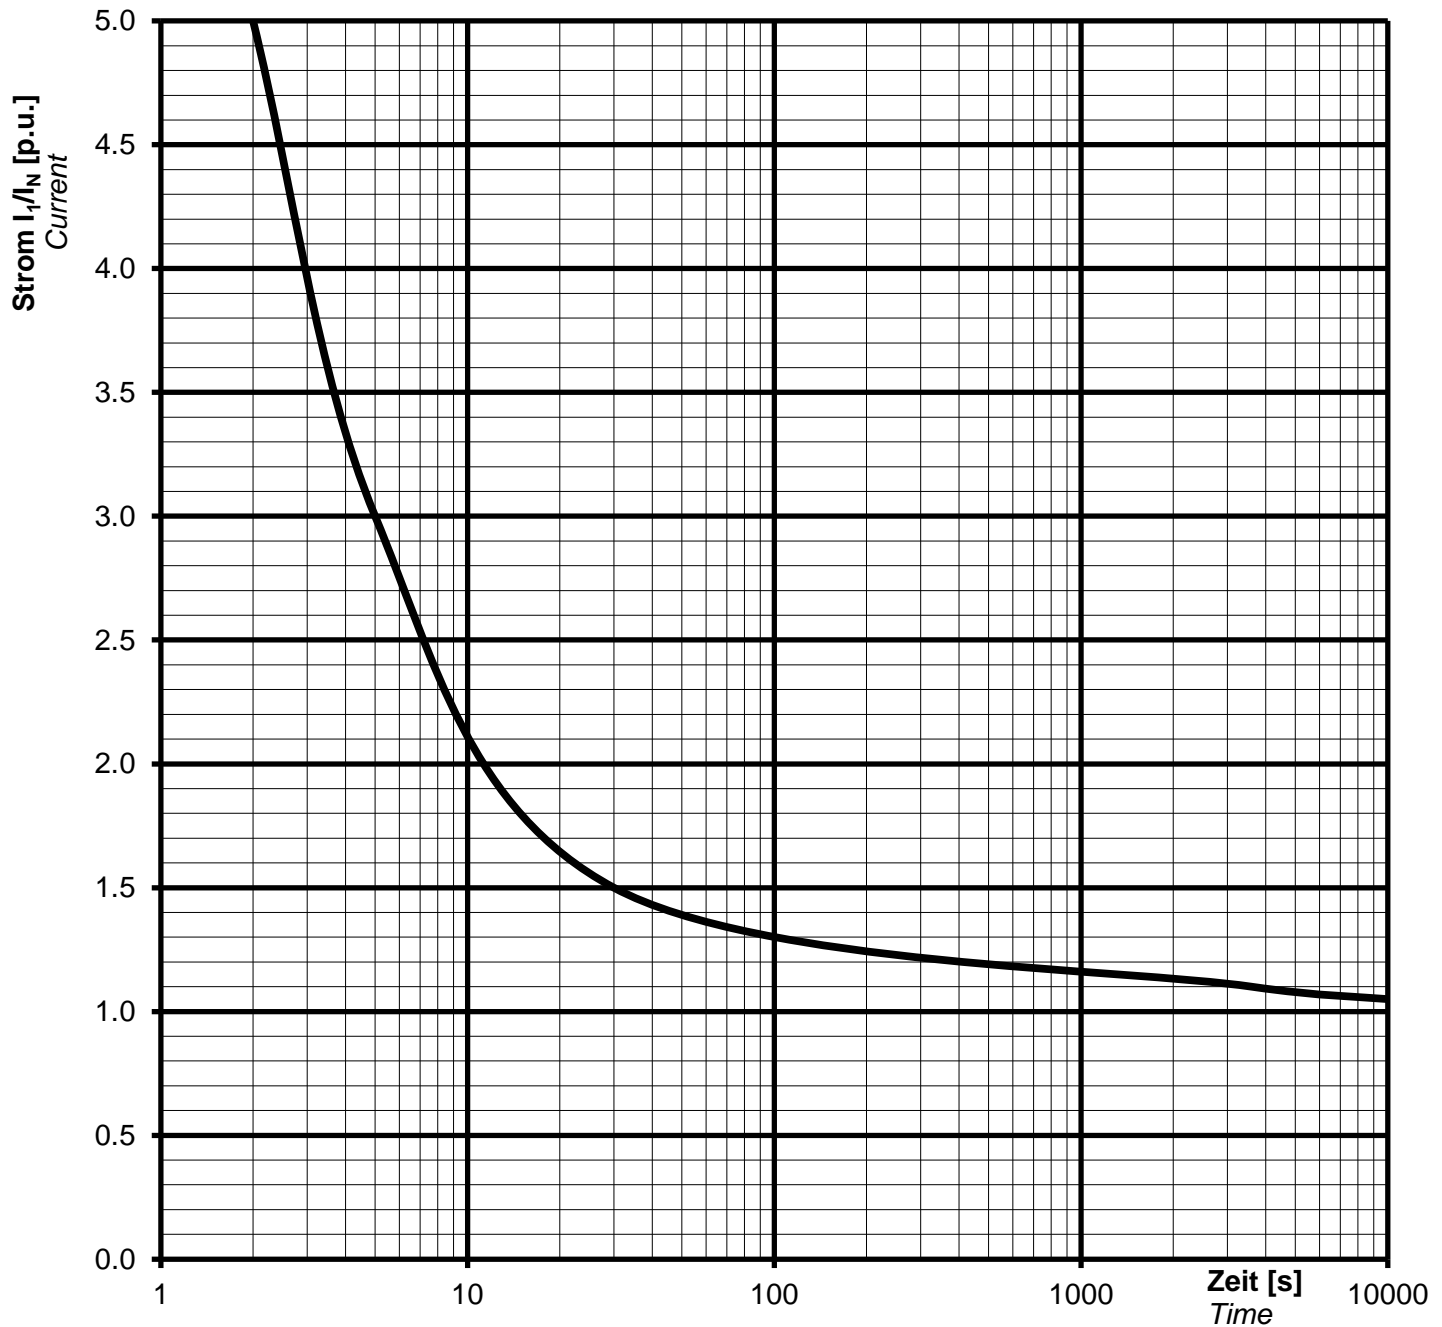

#### Notizen / remarks:

Strom / Zeit Kriterien:

$$(I / I_N)^2 \cdot t = 45s$$

Current/time characteristics:

1,5 \*  $I_N$  for 30 s

1,1 \*  $I_N$  for 1 h in 6h

#### Nenndaten / nominal data

DIG 130 h/4

Rating  $S_N$ : **2150 kVA**

*p.f.* **0.80**

*Bemessungsleistung*

Leistungsfaktor  $\cos \varphi$ :

Nominal voltage  $U_N$ : **6.60 kV**

Nominal current  $I_N$ : **188 A**

*Bemessungsspannung*

*Bemessungsstrom*

Frequency  $f_N$ : **50 Hz**

Speed  $n$ : **1500 min<sup>-1</sup>**


*Frequenz*

*Drehzahl*

Protection: **IP23**

*Schutzart*

#### Inverse current or unbalanced negative sequence current

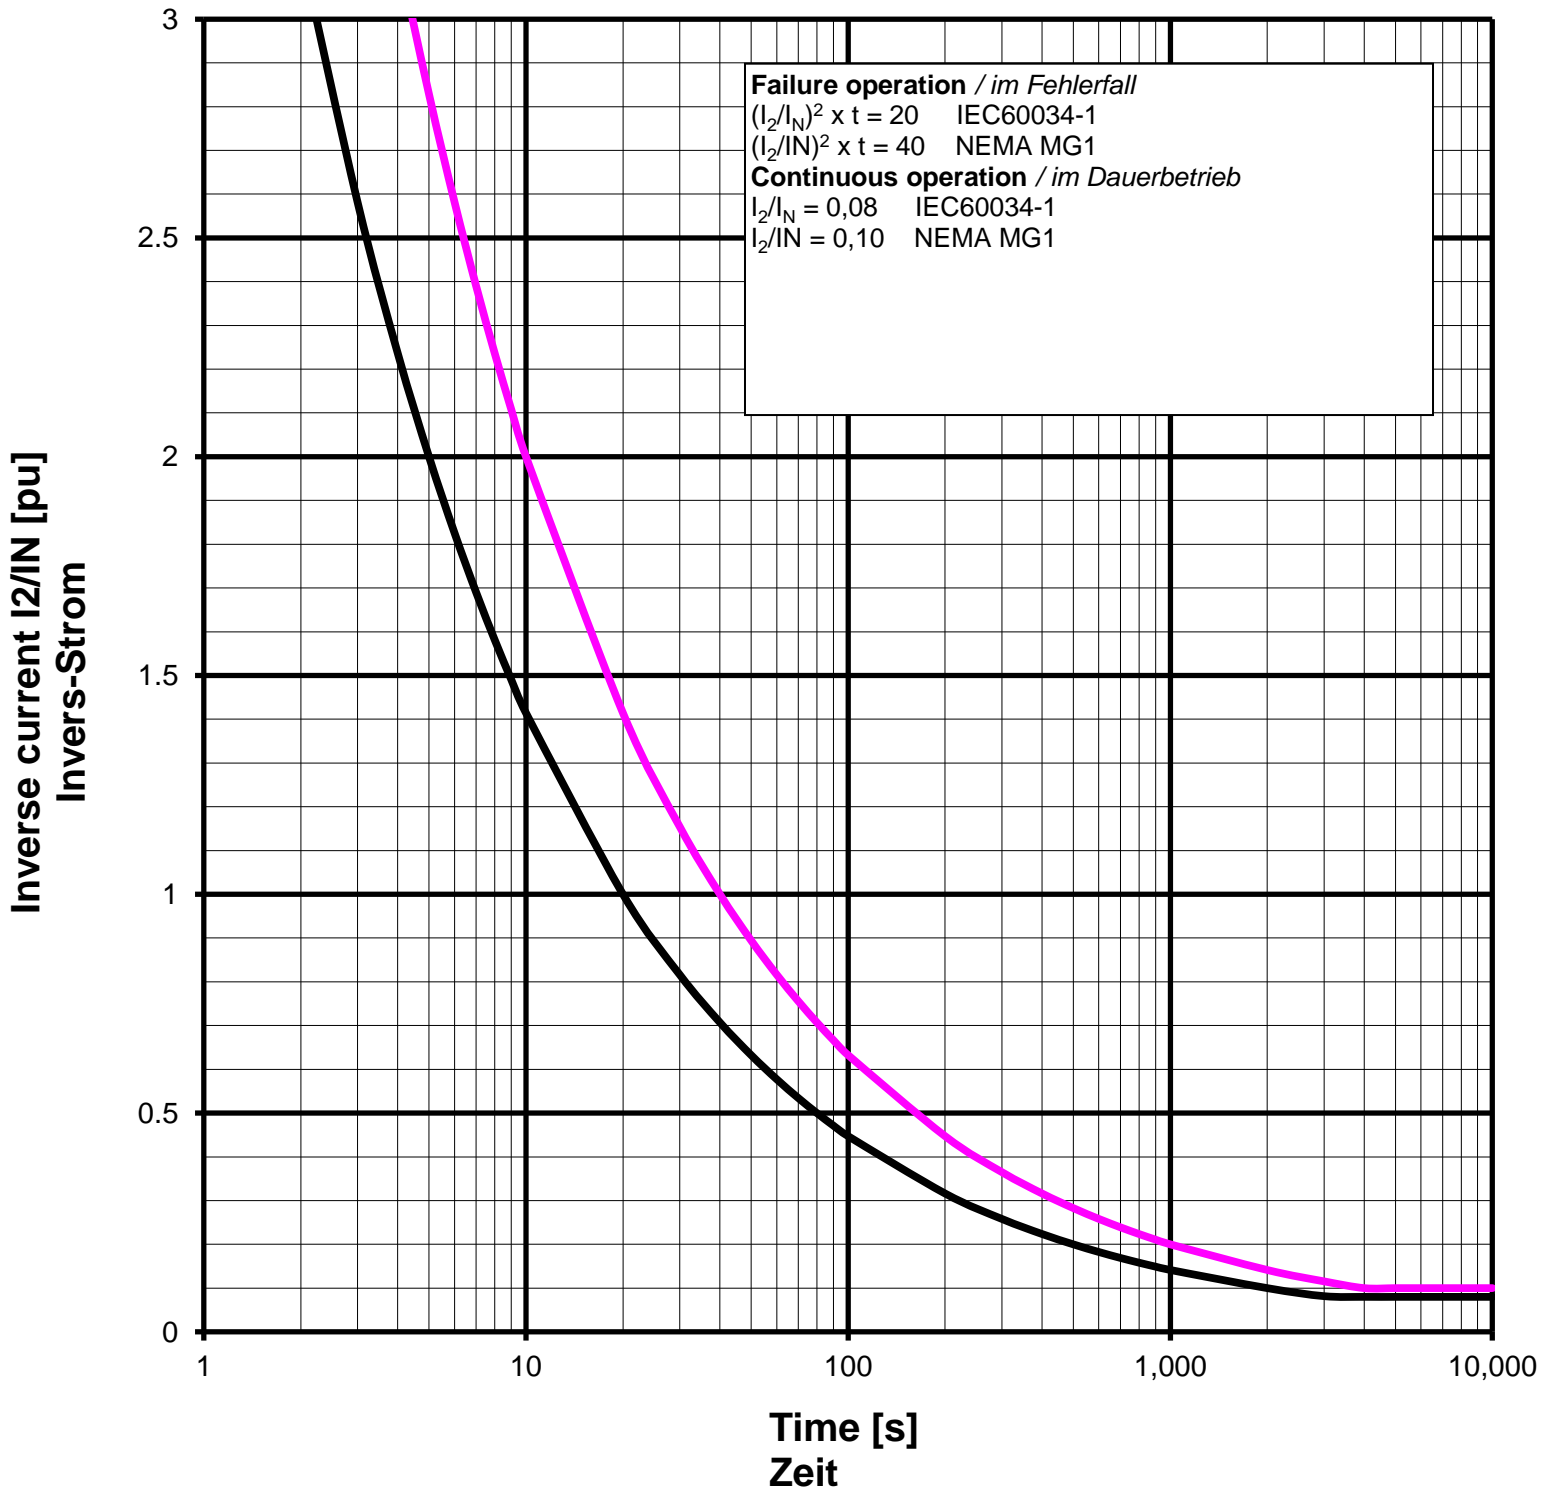

Remarks / Notizen:



Technische Daten selbstregelnden Drehstrom-Synchrongenerator  
technical data for self regulating three phase alternator

ING-FCD-0112


TYPE

DIG 130 h/4

Projekt:

Order Nr.:

### Capability (P-Q) Diagram

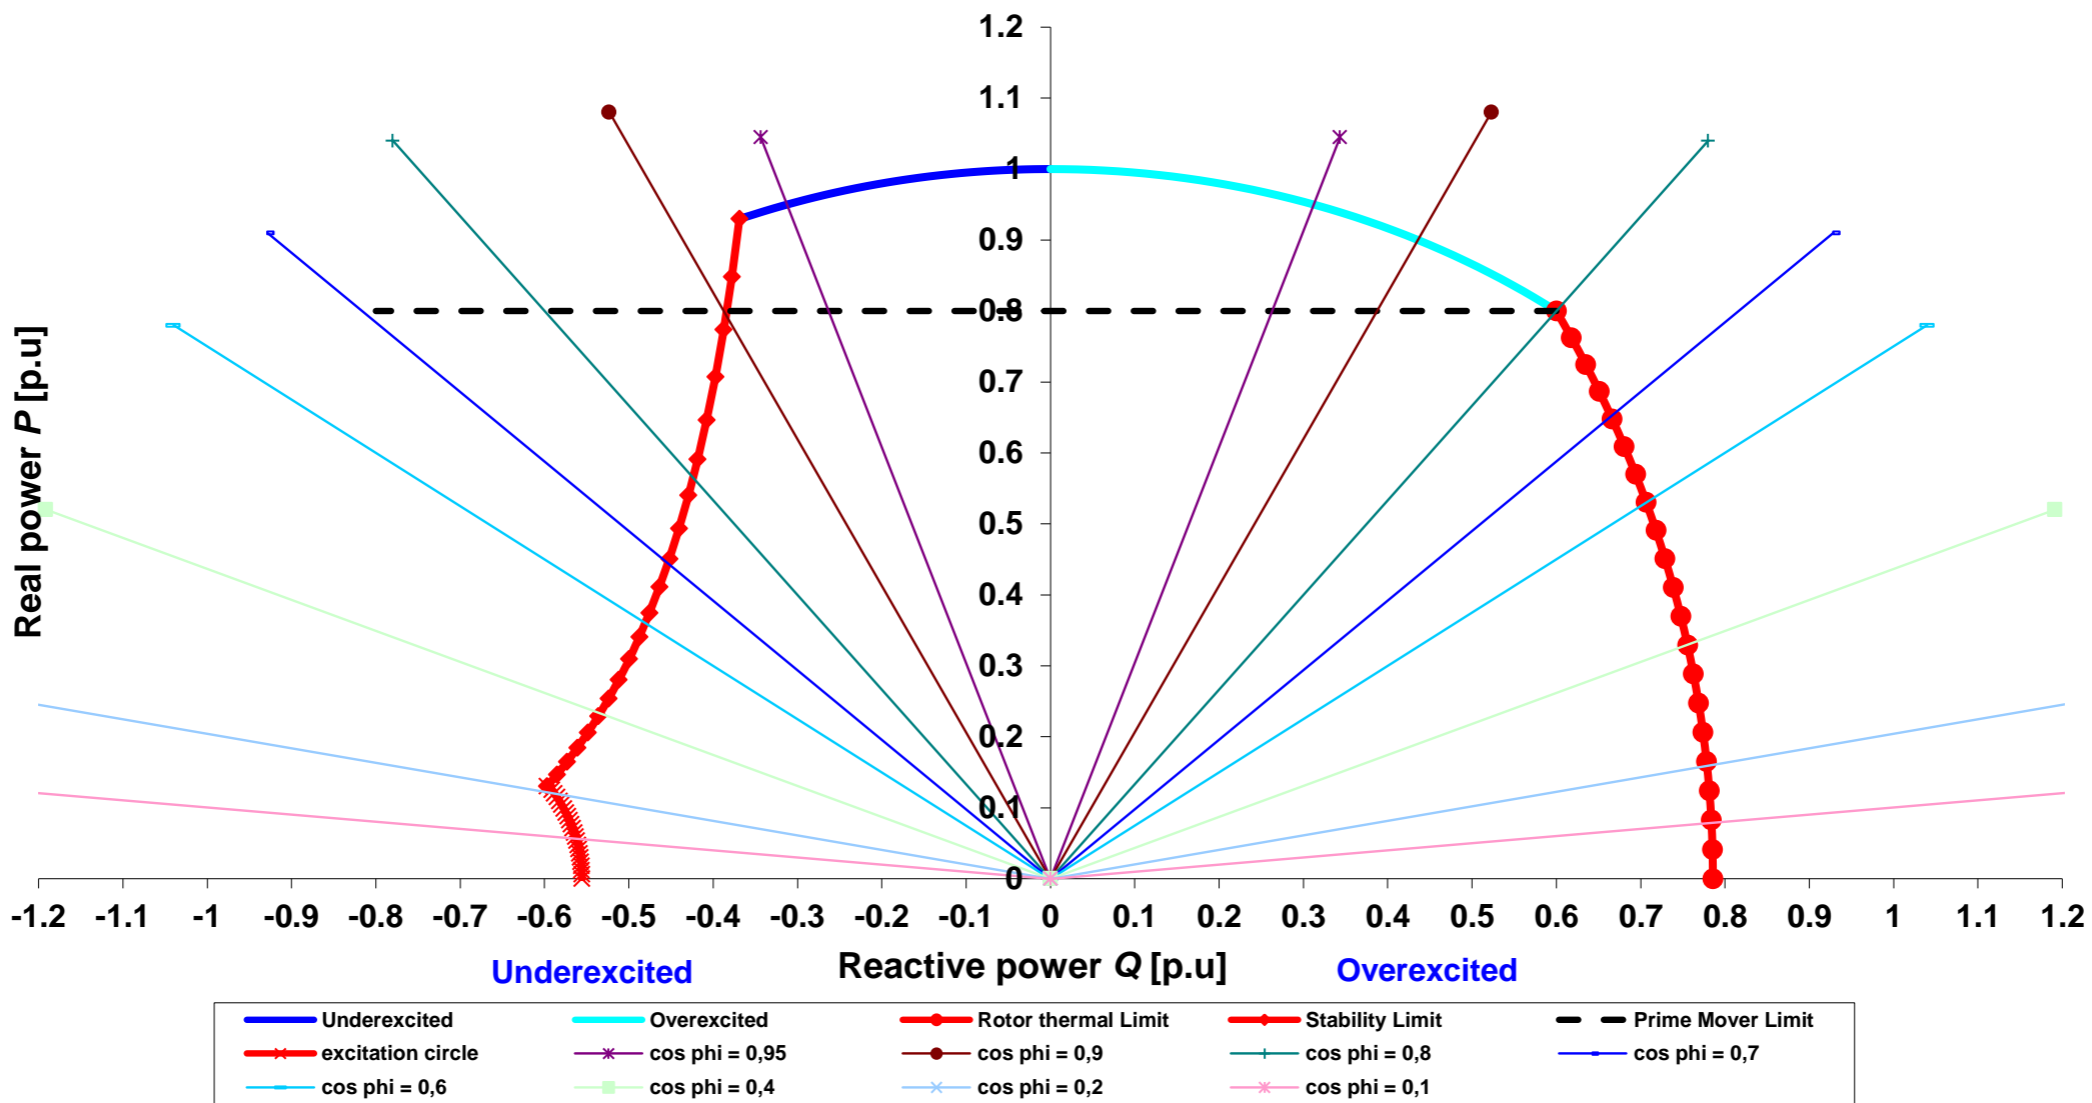


Cummins Generator Technologies

Datum / date:

10/10/2013



TYPE	DIG 130 h/4	Projekt:		Order Nr.:	
------	-------------	----------	--	------------	--

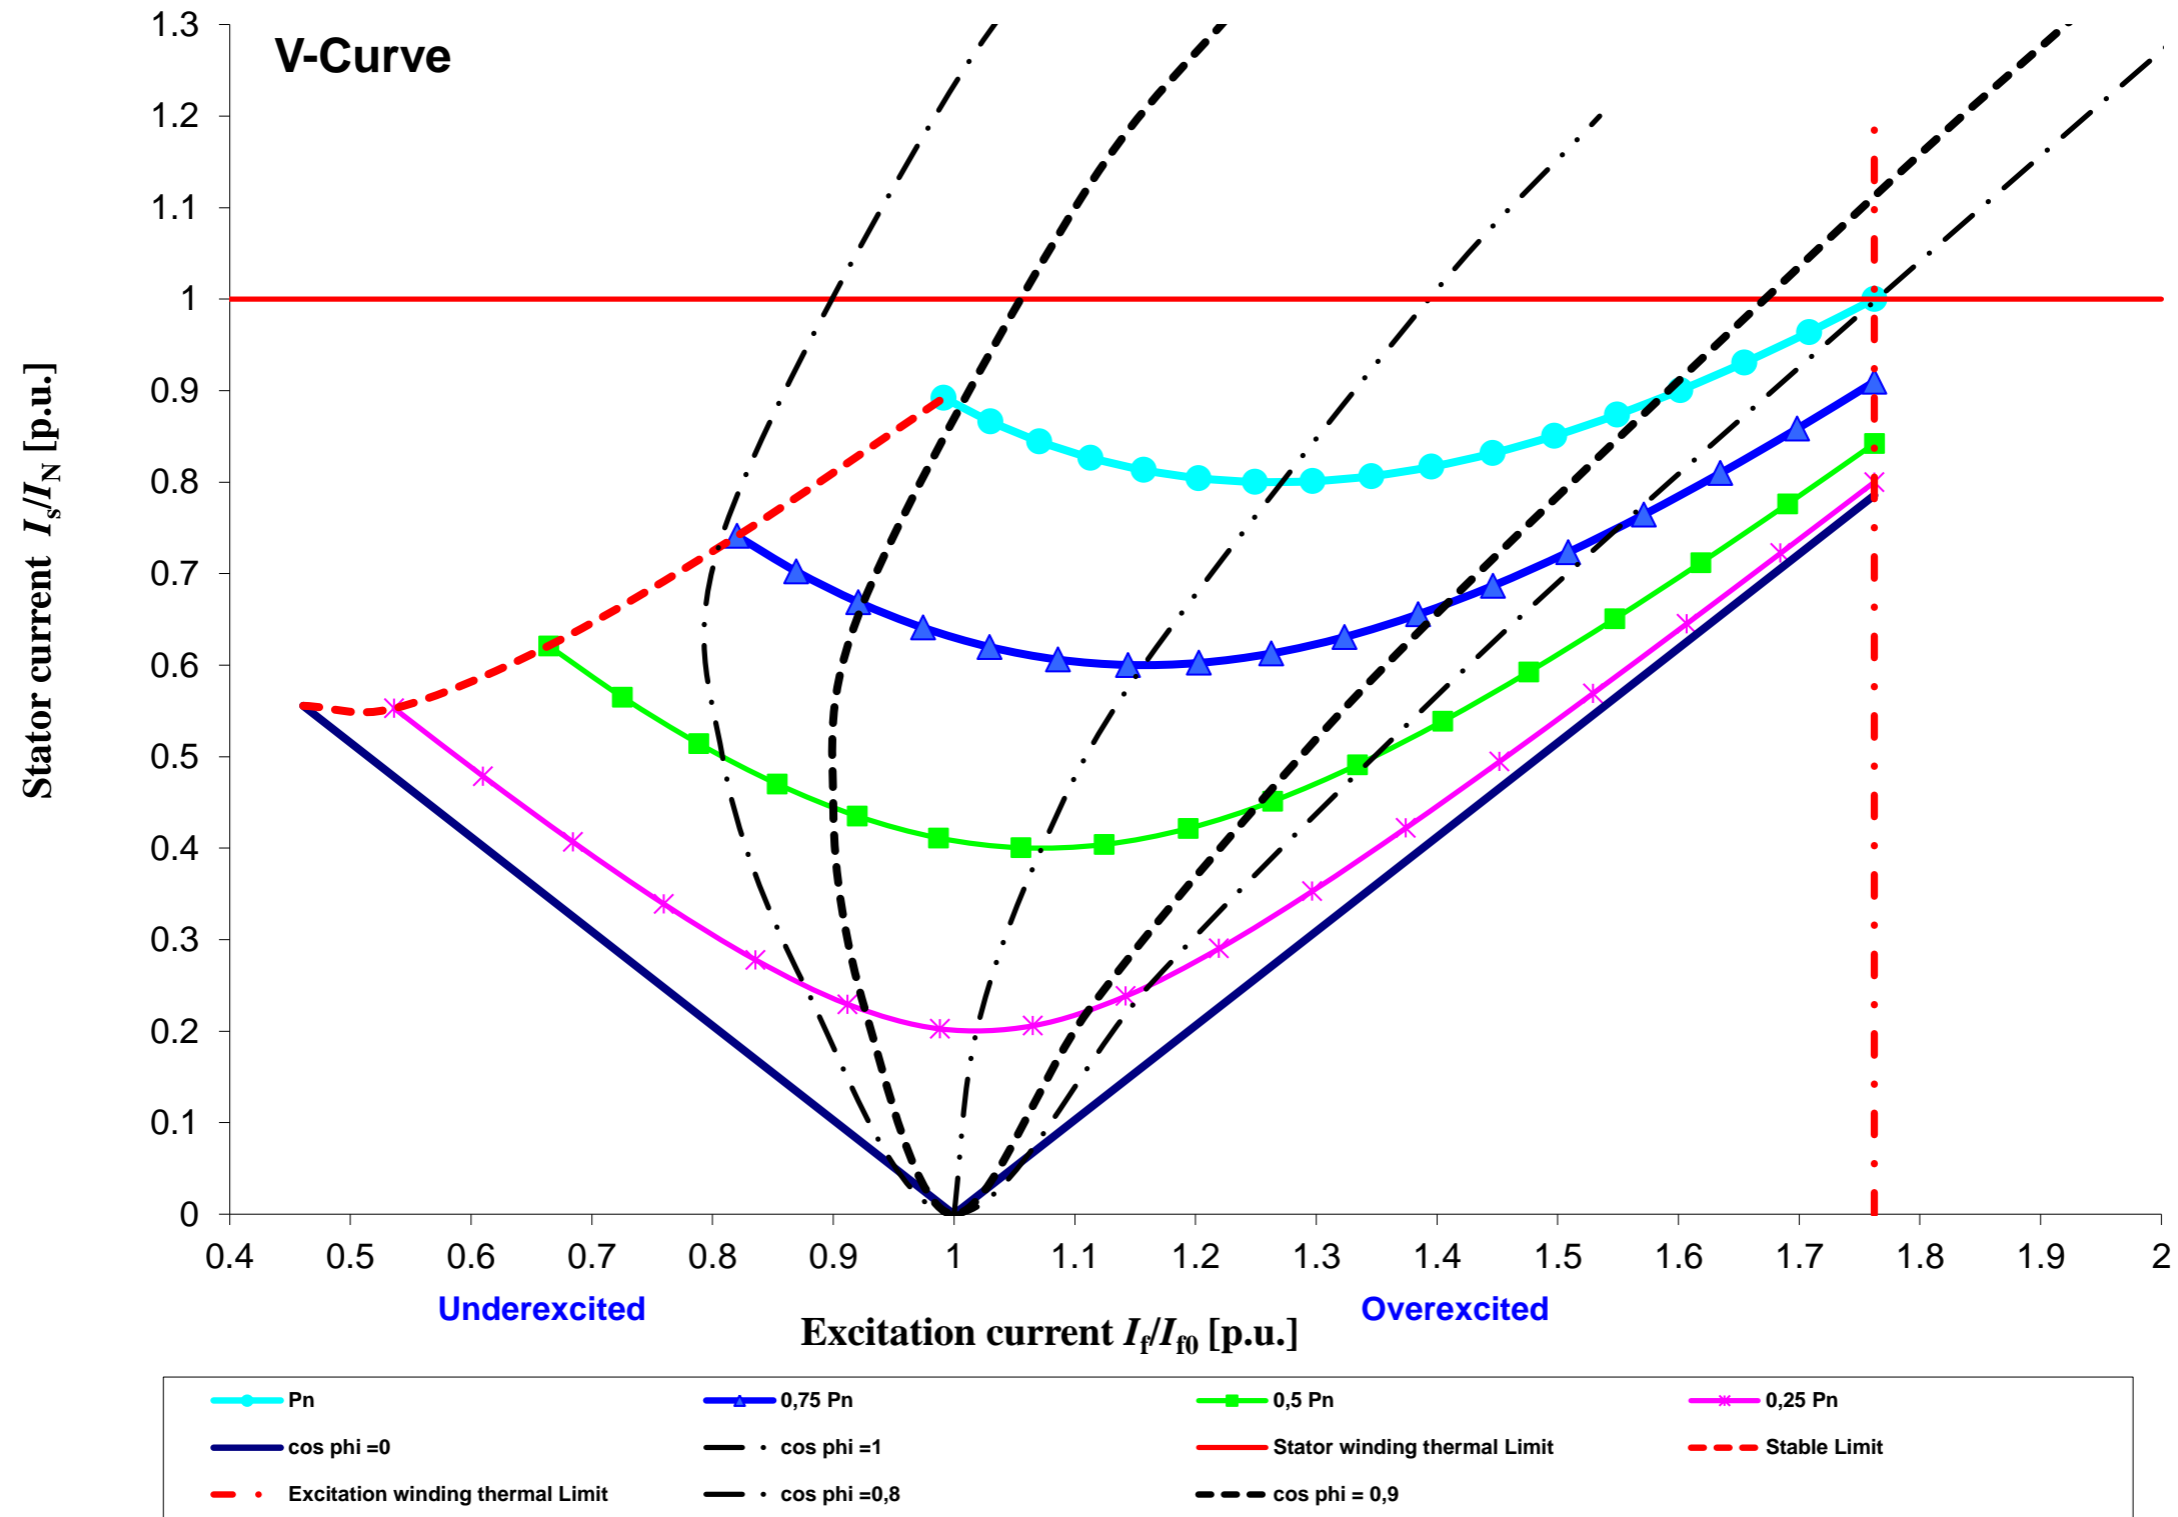

Cummins Generator Technologies	Datum / date:	
	10/10/2013	