



## Technical Data Sheet for AvK-Alternators

FM 7.3-5

Date:	02/10/13	Customer:	GENERIC DATASHEET only
Project No.:	GENERIC DATASHEET only	AvK Reference:	DSG099L1_8_50_400

<b>Object data:</b>	
Site:	Prime Mover:
Application: Stationary Power Plant	Manufacturer:

<b>Generator data:</b>					
Generator:	DSG 99 L1/8	Poles:	8	Standards: IEC 60034	
Rated power:	2260 kVA	1808 kWe	1891 kWm		
Power factor:	0.80				
Power at pf 1,0	1834 kVA	1834 kWe	1891 kWm		
Rated voltage:	0.4 kV				
Speed:	750 1/min				
Frequency:	50 Hz		Voltage range / frequency range:		
Rated current:	3262.0 A		Zone A according IEC 60034-1 (dU = +/-5%, df = +/-2%)		
Winding pitch:	ca. 5/6				
Insulation class:	Stator: Class H	Rotor: Class H	Temperature rise:		H
Ambient temperature:	40 °C		Environment:	Standard environment	
Site altitude:	1000 m				
Enclosure:	IP23		Filter:		
Cooling:	IC 01 - Open-circuit ventilation				
Coolant:	Ambient Air	Temperature	40 °C	Temperature Air inlet	40 °C
		Coolant:		generator:	
		Cooling air vol.:	2.5 m³/s	Cooling water quantity:	n/a
Moment of inertia (I):	235 kgm²	Weight:	7400 Kg	Losses (environment):	83 KW
				Losses (cooling):	n/a

Wires:	4 terminals, starpoint connected in terminal box
Operation mode:	Single mode
Regulators:	
Voltage regulator:	DECS 100

<b>Electrical data: (acc. IEC)</b>					
Efficiencies:	110%	100%	75%	50%	25%
Power factor 0.8	95,38	95,6	95,9	95,85	94,55
Power factor 0.9	96,12	96,3	96,45	96,3	94,85
Power factor 1.0	96,85	97	97	96,75	95,15

<b>Reactances and time constants</b>										
	unsaturated		saturated			unsaturated		saturated		
$X_d$	1.95	1.76	p.u.	$X_q$	0.98	0.96	p.u.	$T_{d0'}$	2.2	s
$X_d'$	0.295	0.295	p.u.	$X_q'$	0.98	0.96	p.u.	$T_d'$	0.33	s
$X_d''$	0.169	0.154	p.u.	$X_q''$	0.169	0.169	p.u.	$T_{d0}''$	0.016	s
$X_2$	0.178	0.162	p.u.	$X_0$	0.051	0.046	p.u.	$T_a$	0.045	s
$X_{1s}$	n.a.	0.092	p.u.					$T_{q1}'$	0.32	s
								$T_{q1}''$	0.032	s
Short circuit ratio saturated: 0.57					$Z_n$ 0.071 Ohm					


<b>Short circuit data:</b>		
Initial short circuit current (3-phase):	$I_k'$	21182 A
Max. peak current (3-phase):	$I_s$	53921 A
Sustained short circuit current:	$I_k$	9786 A
Minimum 3 x rated current for max.10 s		
Initial short circuit torque:	$M_{k2}$	242.9 kNm
	$M_{k3}$	145.7 kNm
Max. faulty synchron moment:	$M_f$	522.2 kNm
Rated kVA torque:	$M_{SN}$	28.78 kNm
Rated torque	$M_N$	23.02 kNm
Shaft torque	$M_{Sh}$	24.08 kNm

<b>Load application:</b>	
max. load application: 1149 kVA (corresponds to 50,85 % from 2260 kVA) for Power factor 0.4 15% transient voltage drop	Power: 2260 kVA Power factor: 0.8 transient voltage drop: -22.8 %

**Remarks:**

<b>Alternator :</b>	<b>DSG 99 L1/8</b>			
Rated output [kVA]	2260	Rated power factor:	0.8	Rated voltage [kV]: 0.4
Rated frequency [Hz]	50	Rated speed [rpm]	750	

### Wirkungsgrad-Kennlinie - Efficiency Curve

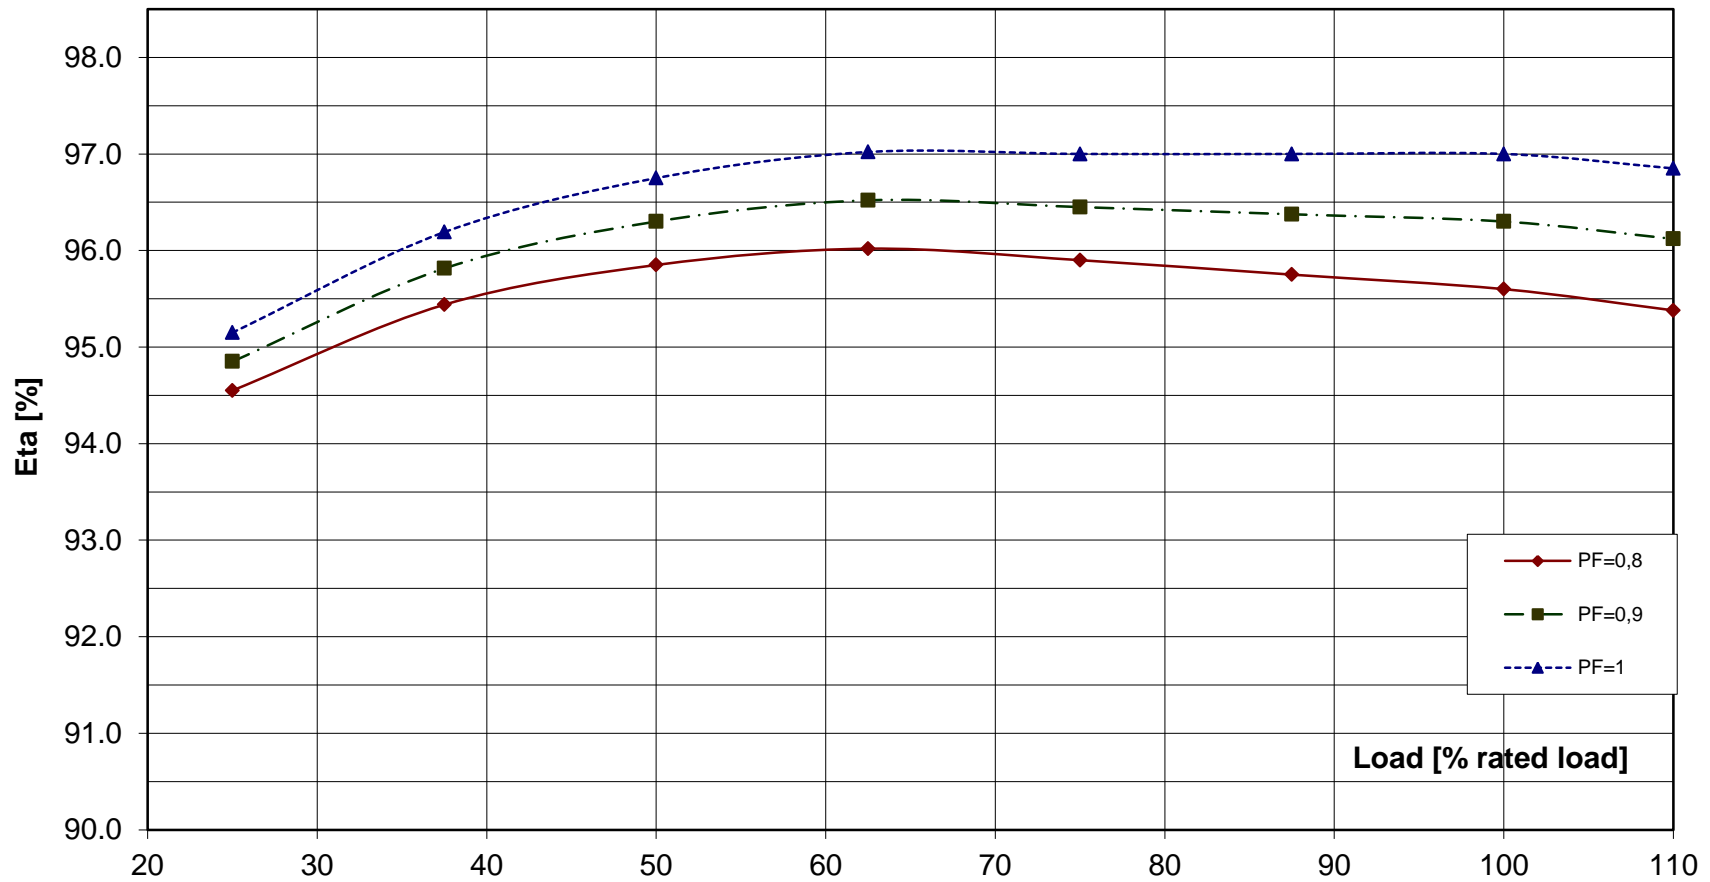

**Alternator : DSG 99 L1/8**

Rated output [kVA]

2260

Rated power factor:

0.8

Rated voltage [kV]: 0.4


Rated frequency [Hz]

50

Rated speed [rpm]

750

### Transient Voltage rise or drop for sudden load removal or application

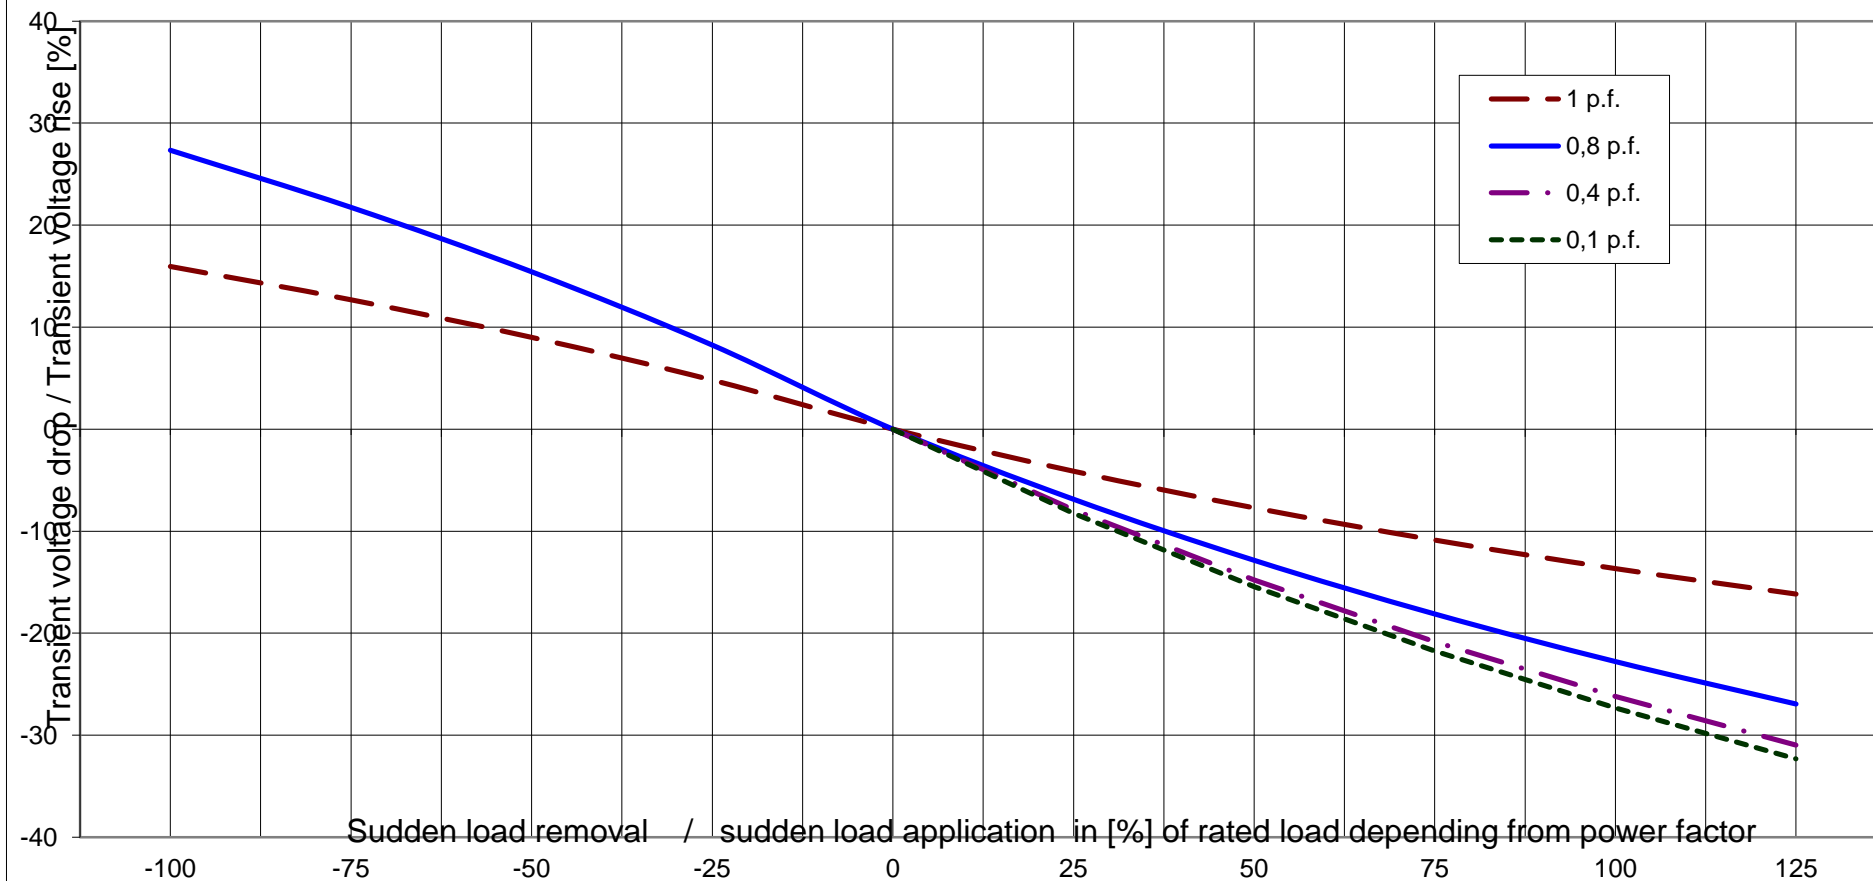




Technisches Datenblatt - Diagramme  
Technical data sheet - Diagrams

**ING-FCD-0112**

**Alternator : DSG 99 L1/8**

Rated output [kVA]	2260	Rated power factor:	0.8	Rated voltage [kV]:	0.4
Rated frequency [Hz]	50	Rated speed [rpm]	750	MSN related to kVA:	28.78 KNm

**Kurzschlußmomenten-Verlauf 2-poliger KS**  
**Short circuit torque at 2-phase SC**

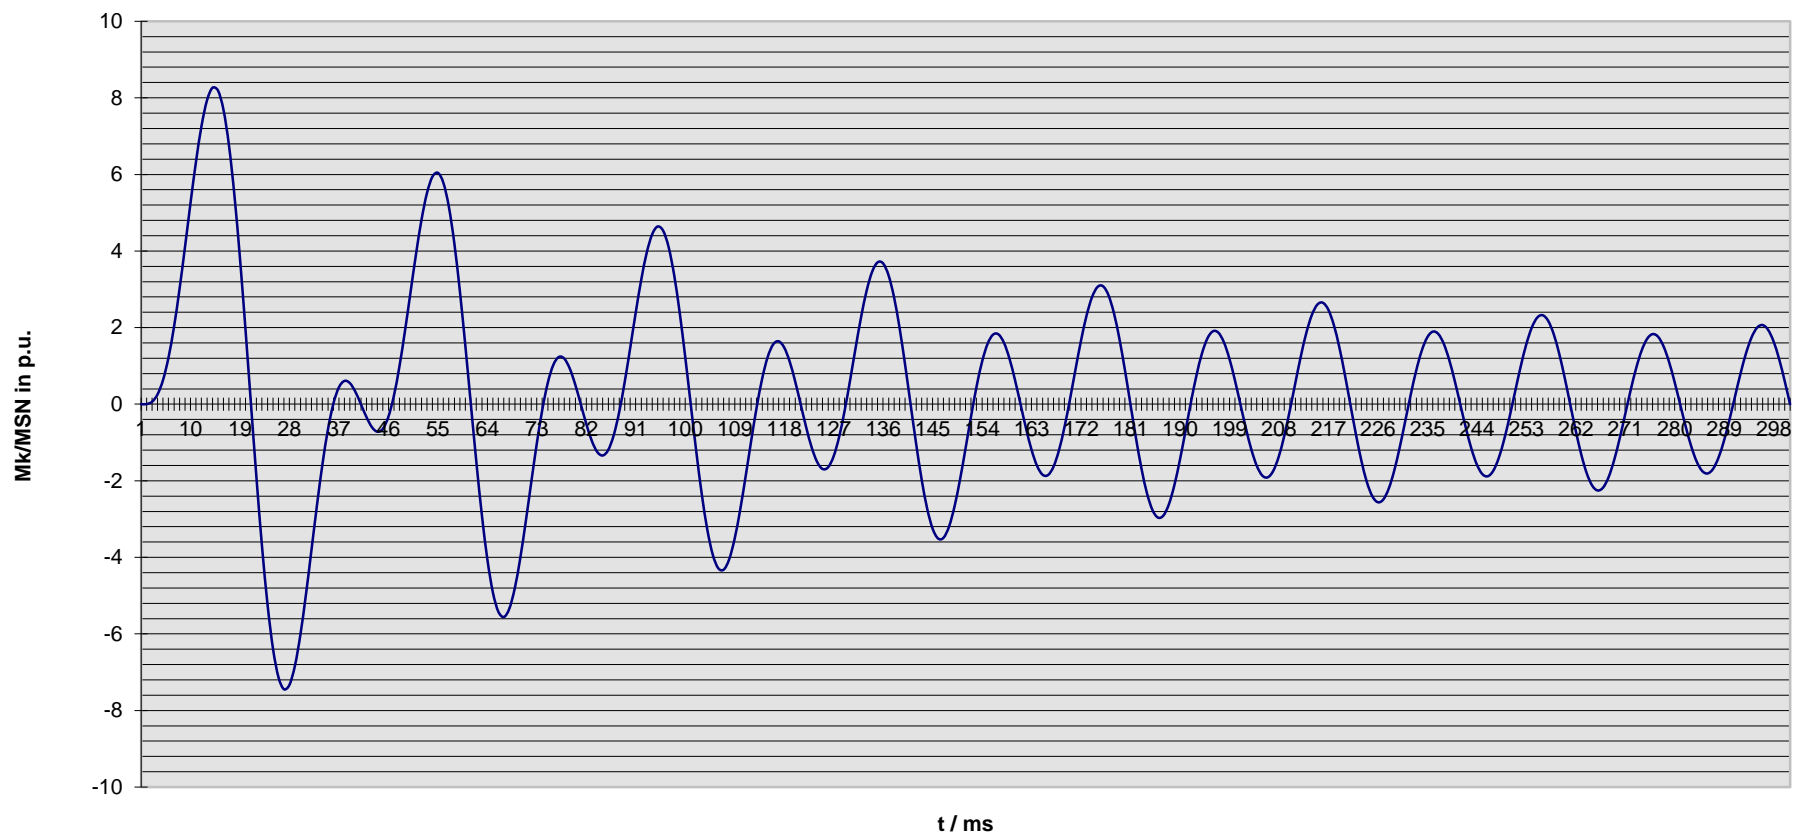

#### Nennenden / nominal data

DSG 99 L1/8

Leistung  $S_N$ : **2260** kVA

$\cos \varphi$ : **0.80**

*Rating*

*p.f.*

Spannung  $U_N$ : **0.40** kV

Strom  $I_N$ : **3262** A

*Voltage*

*Current*

Frequenz  $f$ : **50** Hz

Drehzahl  $n$ : **750** min<sup>-1</sup>

*Frequency*


*Speed*

Schutzart **IP23**

*Protection*

**Kurzschlussstrom  $I_{k3\text{phasig}} / I_N$  [p.u.]**  
 Short-circuit current  $I_{k3\text{phase}} / I_N$  [p.u.]

**Stosskurzschluss-Strom, 3-phasig, asymmetrisch /**  
*Sudden short circuit current, 3-phase, asymmetrical*

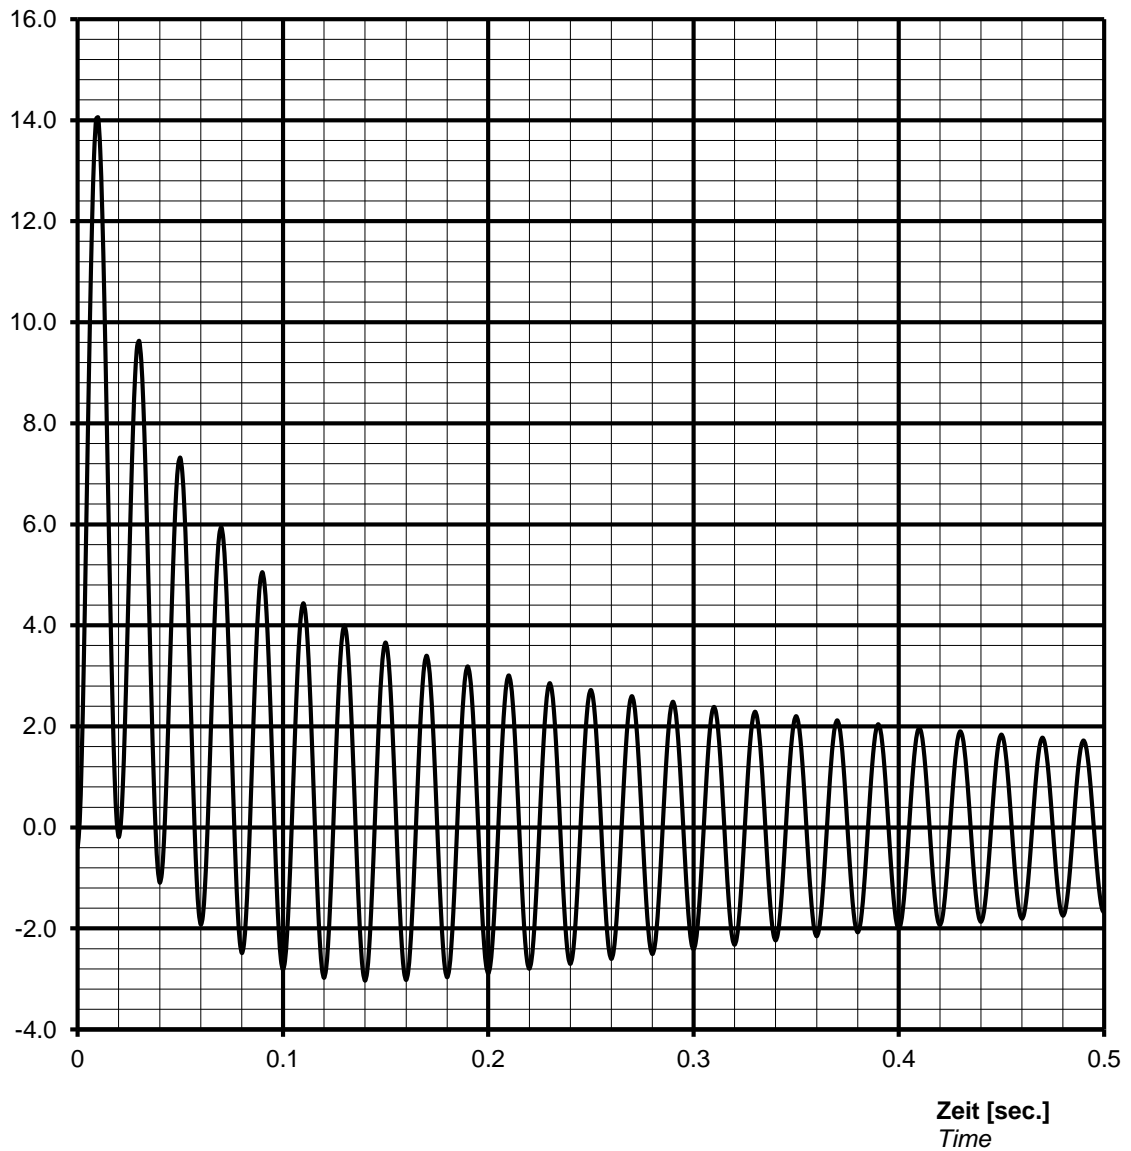

#### Notizen / remarks:

**Maximum asymmetric peak value**

$I_{\text{speak}} =$  **45839 A** or **14.05 p.u.**


**Nenndaten / nominal data**

**DSG 99 L1/8**

Leistung  $S_N$ : **2260** kVA  
*Rating*  
 Spannung  $U_N$ : **0.40** kV  
*Voltage*  
 Frequenz  $f$ : **50** Hz  
*Frequency*  
 Schutzart **IP23**  
*Protection*

$\cos \varphi$ : **0.80**  
*p.f.*  
 Strom  $I_N$ : **3262** A  
*Current*  
 Drehzahl  $n$ : **750** min<sup>-1</sup>  
*Speed*

**Überlast Kennlinie**  
*Overload capability*

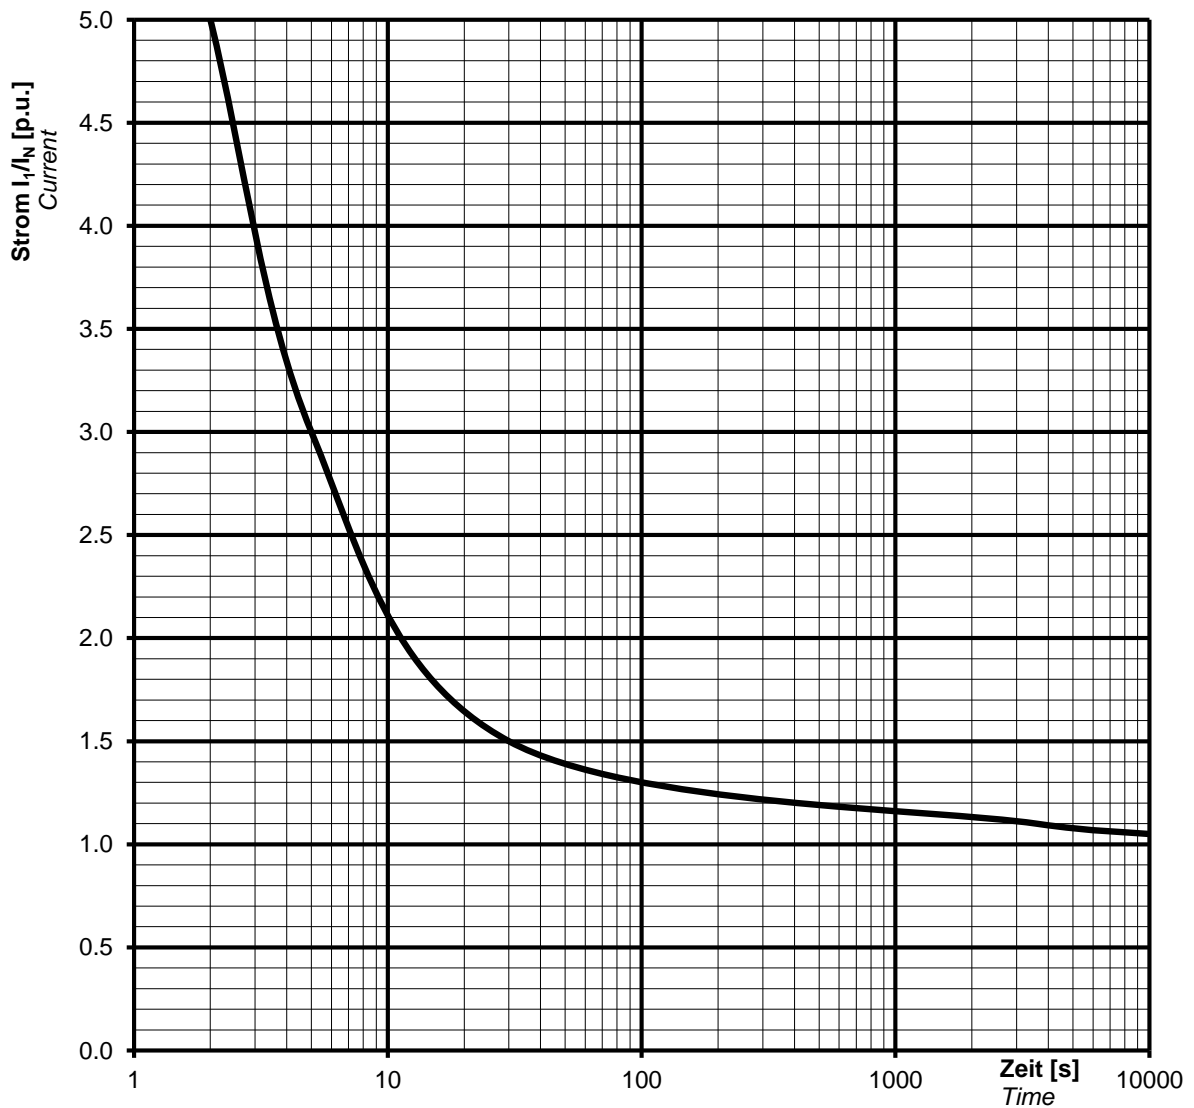

**Notizen / remarks:**

**Strom / Zeit Kriterien:**  $(I / I_N)^2 \cdot t = 45s$   
**Current/time characteristics:** 1,5 \*  $I_N$  for 30 s  
 1,1 \*  $I_N$  for 1 h in 6h

#### Nennndaten / nominal data

**DSG 99 L1/8**

Rating  $S_N$ : **2260** kVA

*p.f.* **0.80**

*Bemessungsleistung*

Leistungsfaktor  $\cos \varphi$ :

Nominal voltage  $U_N$ : **0.40** kV

Nominal current  $I_N$ : **3262** A

*Bemessungsspannung*

*Bemessungsstrom*

Frequency  $f_N$ : **50** Hz

Speed  $n$ : **750** min<sup>-1</sup>


*Frequenz*

*Drehzahl*

Protection: **IP23**

*Schutzart*

#### Inverse current or unbalanced negative sequence current

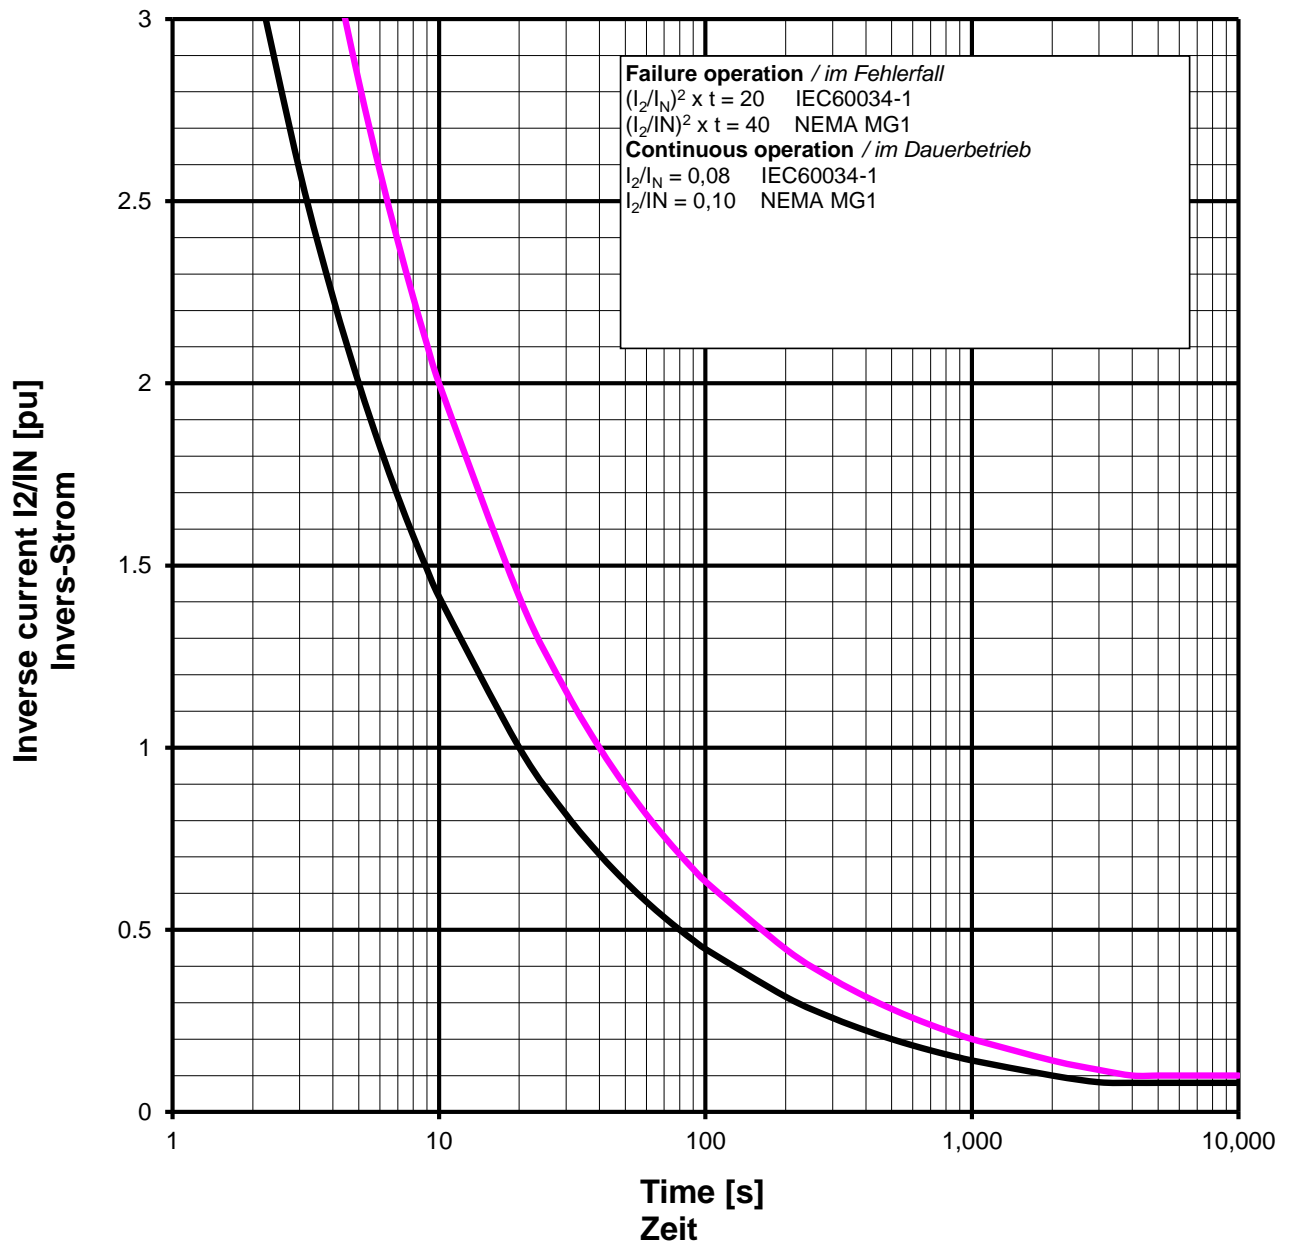

Remarks / Notizen:

*All data according IEC 60034-1, NEMA MG1*



Technische Daten selbstregelnden Drehstrom-Synchrongenerator  
 technical data for self regulating three phase alternator

ING-FCD-0112


TYPE

DSG 99 L1/8

Projekt:

Order Nr.:

Capability (P-Q) Diagram

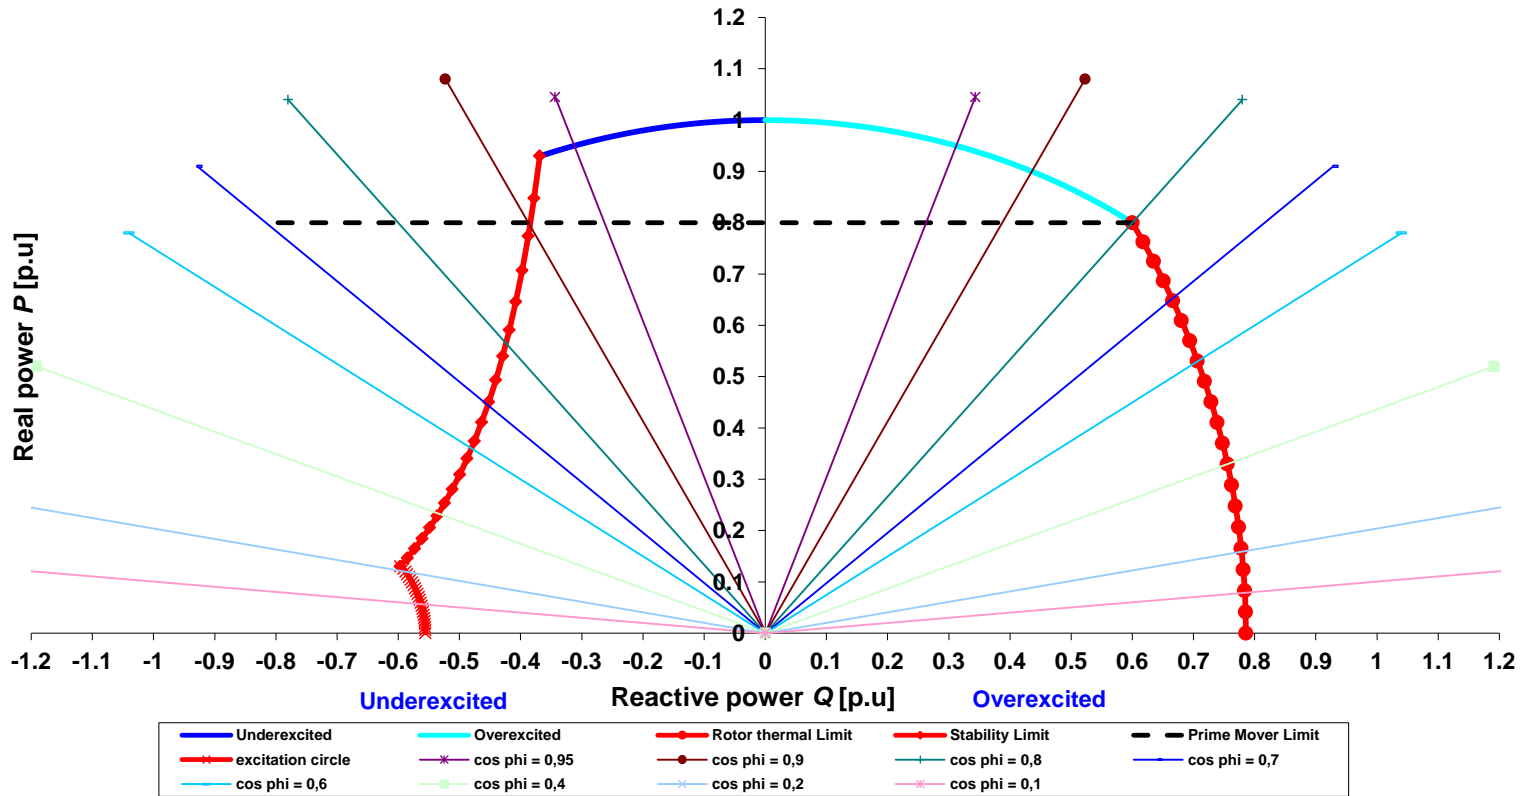

Cummins Generator Technologies

Datum / date:

03/10/2013





TYPE: DSG 99 L1/8 Projekt: Order Nr.:

