
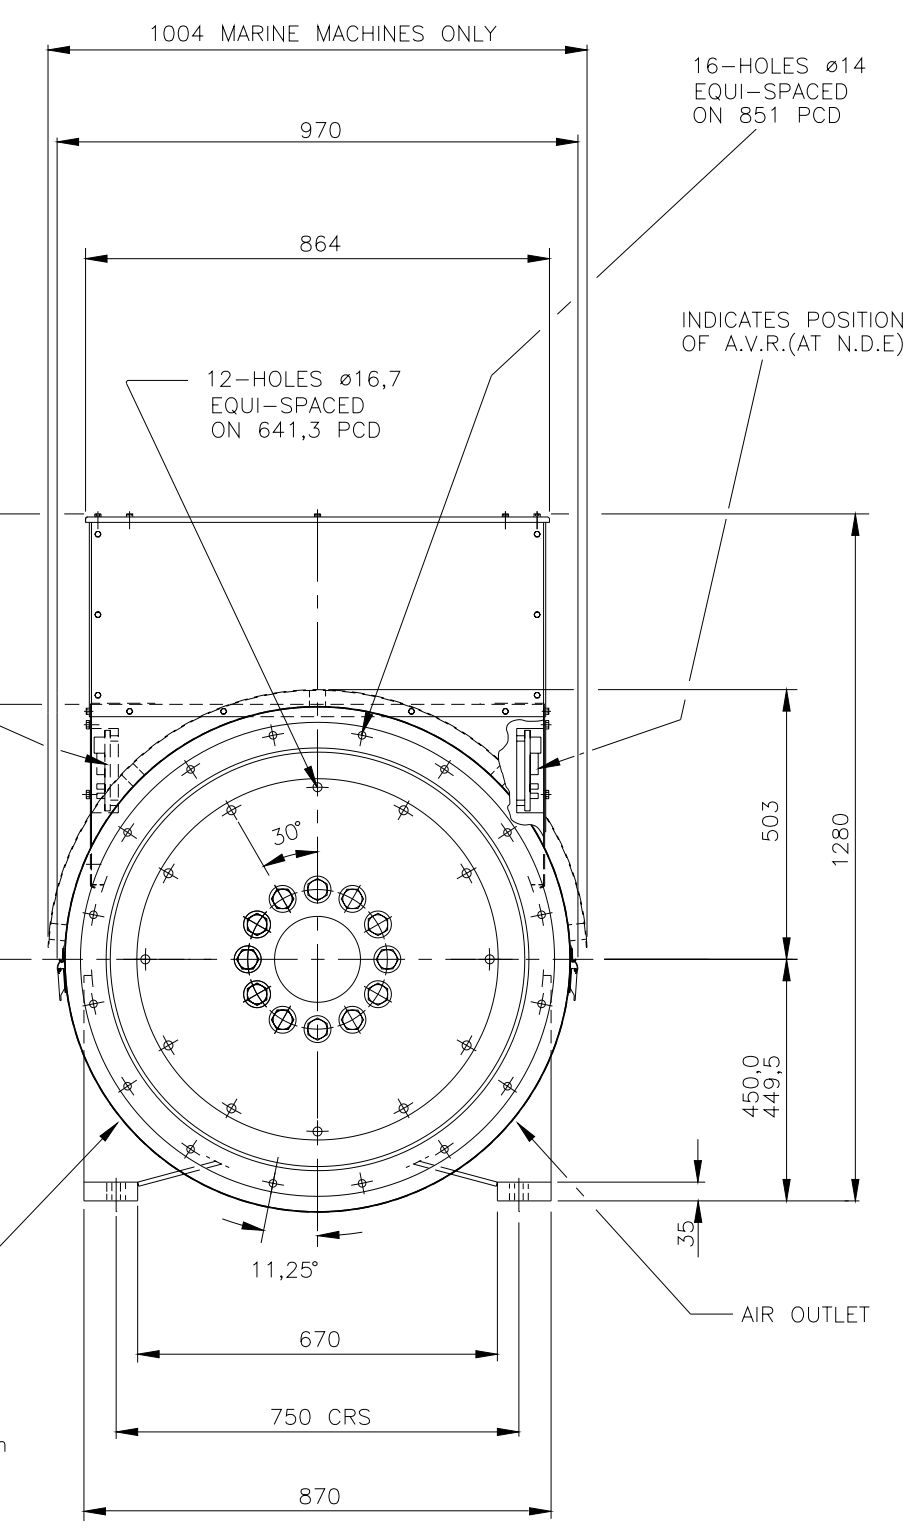
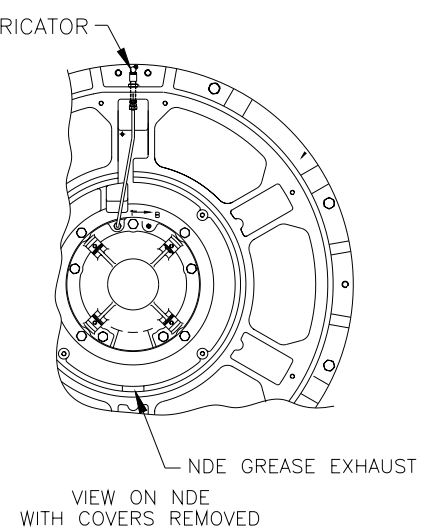


IF IN DOUBT-ASK
DO NOT SCALE

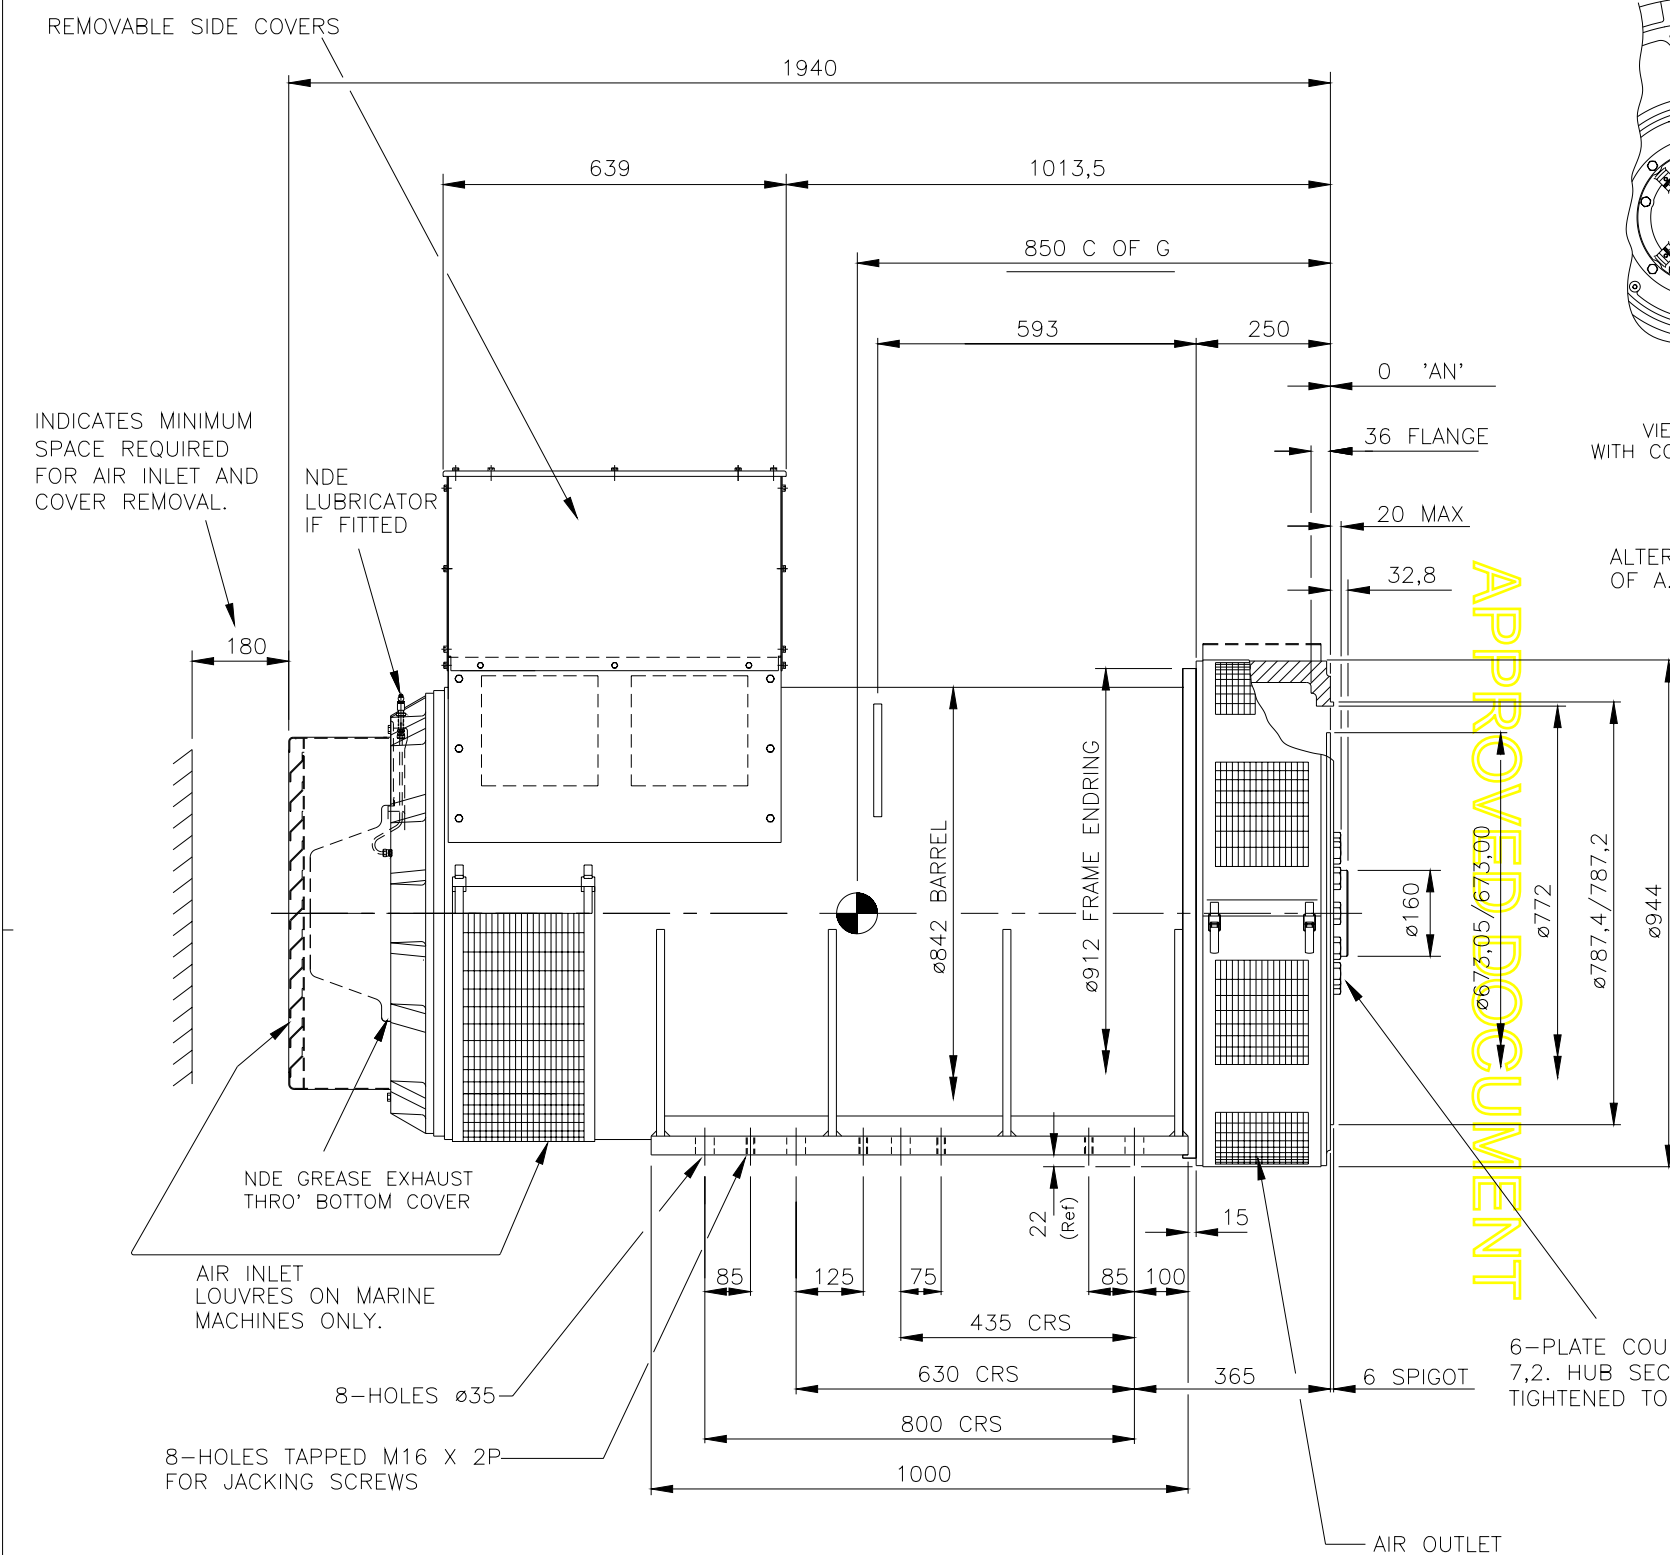

APPROVED DOCUMENT

NOTE:-
CUSTOMER MAY CUT CABLE ENTRY HOLES AS REQUIRED IN ANY OF THE FOUR TERMINAL BOX SIDES SUBJECT TO POSITION OF AVR, TERMINALS, ETC.

CUSTOMER MUST ENSURE THAT AIR INLET & OUTLET POSITIONS ARE NOT OBSTRUCTED

5-0895-01				D	JKB	04/11/10	LUBRICATION DETAILS ADDED TO NDE	CERTIFIED PRINT ONLY IF SIGNED	P7 G 1-BRG ALTERNATOR ADAPTOR - SAE No 00 COUPLING - SAE No 21 STD T/BOX - STD FEET	SCALE 1:10	FIRST W.O.	
4-9430-01				C	DFC	31.01.08	INCORRECT ADAPTOR DIMENSION ø711 DELETED				UNIT OF MEASUREMENT MILLIMETRES (mm)	
4-8664-02				B	USD	14.09.06	CHANGE OF COMPANY NAME	DRAWN DW 14.03.05 CHECKED DFC 31.01.08 APPROVED SFA 31.01.08	CUMMINS GENERATOR TECHNOLOGIES LTD.	70-1001		ISSUE D
4/7752/01				A	DW	14.03.05	ORIGINAL ISSUE			SHEET 1 OF 1 SHEETS		
MOD.	ISSUE	DRAWN	DATE	ALTERATION								