

S0L2-M1 Winding 17

S0L2-M1 - Technical Data Sheet

Standards

Stamford industrial alternators meet the requirements of IEC EN 60034 and the relevant section of other international standards such as BS5000, VDE 0530, NEMA MG1-32, IEC34, CSA C22.2-100 and AS1359. Other standards and certifications can be considered on request.

Quality Assurance

Alternators are manufactured using production procedures having a quality assurance level to BS EN ISO 9001.



Excitation and Voltage Regulators

Excitation System			
AVR Type	AVR Power		
AS540	Self-Excited		
Voltage Regulation	± 1%		
No Load Excitation Voltage (V)	8.9 V		
Full Load Excitation Voltage (V)	41.3 V		



Insulation System	Electrical Data		
Winding Pitch Two Thirds Winding Leads 12 Winding Number 17 Number of Poles 4 IP Rating IP23 RFI Suppression EN 61000-6-2 & EN 61000-6-4, refer to factory for others Waveform Distortion No LOAD < 2.5% NON-DISTORTING BALANCED LINEAR LOAD < 5.0%	Insulation System	Class H	
Winding Leads 12	Stator Winding	Double Layer Concentric	
Winding Number 17 Number of Poles	Winding Pitch	Two Thirds	
Number of Poles 4	Winding Leads	12	
IP Rating	Winding Number	17	
### RFI Suppression	Number of Poles	4	
Waveform Distortion NO LOAD < 2.5% NON-DISTORTING BALANCED LINEAR LOAD < 5.0% Short Circuit Ratio 1/Xd Steady State X/R Ratio N/A General Ratio Files Telephone Interference TIF Voltage Series Star 600 Voltage Parallel Star 300 Voltage Series Delta 346 kVA Base Rating (Class H) 31.3 Saturated Values in Per Unit at Base Ratings and Voltages Xd Dir. Axis Synchronous 1.634 X'd Dir. Axis Synchronous 1.634 X'd Dir. Axis Subtransient 0.113 X'q Quad. Axis Reactance 1.307 X'q Quad. Axis Subtransient 0.141 XL Stator Leakage Reactance 0.073 X2 Negative Sequence Reactance 0.044 Unsaturated Values in Per Unit at Base Ratings and Voltages Xd Dir. Axis Synchronous 1.961 X'd Dir. Axis Subtransient 0.154 X'd Quad. Axis Subtransien	IP Rating	IP23	
Short Circuit Ratio	RFI Suppression	EN 61000-6-2 & EN 61000-6-4, refer to factory for others	
Steady State X/R Ratio	Waveform Distortion	NO LOAD < 2.5% NON-DISTORTING BALANCED LINEAR LOAD < 5.0%	
Telephone Interference	Short Circuit Ratio	1/Xd	
Telephone Interference	Steady State X/R Ratio	N/A	
Voltage Series Star 600 Voltage Parallel Star 300 Voltage Series Delta 346 kVA Base Rating (Class H) 31.3 Saturated Values in Per Unit at Base Ratings and Voltages Xd Dir. Axis Synchronous 1.634 X'd Dir. Axis Synchronous 0.134 X"d Dir. Axis Subtransient 0.113 X'q Quad. Axis Reactance 1.307 X"q Quad. Axis Subtransient 0.141 XL Stator Leakage Reactance 0.073 X2 Negative Sequence Reactance 0.214 X0 Zero Sequence Reactance 0.044 Unsaturated Values in Per Unit at Base Ratings and Voltages Xd Dir. Axis Synchronous 1.961 X'd Dir. Axis Subtransient 0.154 X"d Dir. Axis Subtransient 0.154 X"d Dir. Axis Subtransient 0.132 Xq Quad. Axis Reactance 1.346 X"q Quad. Axis Reactance 0.062 XL Stator Leakage Reactance 0.062 X2 Negative Sequence Reactance 0.051 Time Constants (Seconds) 1.002 T'd TRANSIENT TIME CONST. 0		60 Hz	
Voltage Series Star 600 Voltage Parallel Star 300 Voltage Series Delta 346 kVA Base Rating (Class H) 31.3 Saturated Values in Per Unit at Base Ratings and Voltages Xd Dir. Axis Synchronous 1.634 X'd Dir. Axis Synchronous 0.134 X"d Dir. Axis Subtransient 0.113 X'q Quad. Axis Reactance 1.307 X"q Quad. Axis Subtransient 0.141 XL Stator Leakage Reactance 0.073 X2 Negative Sequence Reactance 0.214 X0 Zero Sequence Reactance 0.044 Unsaturated Values in Per Unit at Base Ratings and Voltages Xd Dir. Axis Synchronous 1.961 X'd Dir. Axis Subtransient 0.154 X"d Dir. Axis Subtransient 0.154 X"d Dir. Axis Subtransient 0.132 Xq Quad. Axis Reactance 1.346 X"q Quad. Axis Reactance 0.062 XL Stator Leakage Reactance 0.062 X2 Negative Sequence Reactance 0.051 Time Constants (Seconds) 1.002 T'd TRANSIENT TIME CONST. 0	Telephone Interference	TIF<75	
Voltage Parallel Star 300 Voltage Series Delta 346 kVA Base Rating (Class H) 31.3 Saturated Values in Per Unit at Base Ratings and Voltages Xd Dir. Axis Synchronous 1.634 X'd Dir. Axis Synchronous 1.634 X"d Dir. Axis Subtransient 0.134 X"d Dir. Axis Subtransient 0.113 Xq Quad. Axis Reactance 1.307 X"q Quad. Axis Subtransient 0.141 XL Stator Leakage Reactance 0.073 X2 Negative Sequence Reactance 0.044 X0 Zero Sequence Reactance 0.044 Unsaturated Values in Per Unit at Base Ratings and Voltages Xd Dir. Axis Synchronous Xd Dir. Axis Synchronous 1.961 X'd Dir. Axis Subtransient 0.154 X"d Dir. Axis Subtransient 0.132 Xq Quad. Axis Reactance 1.346 X"q Quad. Axis Subtransient 0.169 XL Stator Leakage Reactance 0.082 X2 Negative Sequence Reactance 0.051 X0 Zero Sequence Reactance 0.051 Time Constants (Seconds) 1.7d TRANSIENT TIME CONST.		600	
Voltage Series Delta 346 kVA Base Rating (Class H) 31.3 Saturated Values in Per Unit at Base Ratings and Voltages Xd Dir. Axis Synchronous 1.634 X'd Dir. Axis Subtransient 0.134 X"d Dir. Axis Subtransient 0.113 Xq Quad. Axis Reactance 1.307 X"q Quad. Axis Subtransient 0.141 XL Stator Leakage Reactance 0.073 X2 Negative Sequence Reactance 0.214 X0 Zero Sequence Reactance 0.044 Unsaturated Values in Per Unit at Base Ratings and Voltages Xd Dir. Axis Synchronous 1.961 X'd Dir. Axis Transient 0.154 X"d Dir. Axis Subtransient 0.132 Xq Quad. Axis Reactance 1.346 X"q Quad. Axis Subtransient 0.169 XL Stator Leakage Reactance 0.082 X2 Negative Sequence Reactance 0.051 X0 Zero Sequence Reactance 0.051 X0 Zero Sequence Reactance 0.051 Time Constants (Seconds) 1.7d TRANSIENT TIME CONST. 0.002 T"d O.C. FIELD TIME CONST. 0.559		300	
kVA Base Rating (Class H) 31.3 Saturated Values in Per Unit at Base Ratings and Voltages Xd Dir. Axis Synchronous 1.634 X'd Dir. Axis Transient 0.134 X"d Dir. Axis Subtransient 0.113 Xq Quad. Axis Reactance 1.307 X"q Quad. Axis Subtransient 0.141 XL Stator Leakage Reactance 0.073 X2 Negative Sequence Reactance 0.214 X0 Zero Sequence Reactance 0.044 Unsaturated Values in Per Unit at Base Ratings and Voltages Xd Dir. Axis Synchronous 1.961 X'd Dir. Axis Subtransient 0.154 X"d Dir. Axis Subtransient 0.132 Xq Quad. Axis Subtransient 0.132 Xq Quad. Axis Subtransient 0.169 XL Stator Leakage Reactance 0.082 X2 Negative Sequence Reactance 0.051 Time Constants (Seconds) T'd TRANSIENT TIME CONST. 0.002 T'd SUB-TRANSTIME CONST. 0.002 T'do O.C. FIELD TIME CONST. 0.559		346	
Xd Dir. Axis Synchronous 1.634 X'd Dir. Axis Transient 0.134 X"d Dir. Axis Subtransient 0.113 Xq Quad. Axis Reactance 1.307 X"q Quad. Axis Subtransient 0.141 XL Stator Leakage Reactance 0.073 X2 Negative Sequence Reactance 0.214 X0 Zero Sequence Reactance 0.044 Unsaturated Values in Per Unit at Base Ratings and Voltages Xd Dir. Axis Synchronous 1.961 X'd Dir. Axis Transient 0.154 X"d Dir. Axis Subtransient 0.132 Xq Quad. Axis Reactance 1.346 X"q Quad. Axis Subtransient 0.169 XL Stator Leakage Reactance 0.082 X2 Negative Sequence Reactance 0.051 Time Constants (Seconds) 0.02 T'd TRANSIENT TIME CONST. 0.02 T'd SUB-TRANSTIME CONST. 0.002 T'd O.C. FIELD TIME CONST. 0.559		31.3	
X'd Dir. Axis Transient 0.134 X"d Dir. Axis Subtransient 0.113 Xq Quad. Axis Reactance 1.307 X"q Quad. Axis Subtransient 0.141 XL Stator Leakage Reactance 0.073 X2 Negative Sequence Reactance 0.214 X0 Zero Sequence Reactance 0.044 Unsaturated Values in Per Unit at Base Ratings and Voltages Xd Dir. Axis Synchronous 1.961 X'd Dir. Axis Transient 0.154 X"d Dir. Axis Subtransient 0.132 Xq Quad. Axis Reactance 1.346 X"q Quad. Axis Subtransient 0.169 XL Stator Leakage Reactance 0.082 X2 Negative Sequence Reactance 0.257 X0 Zero Sequence Reactance 0.051 Time Constants (Seconds) T'd TRANSIENT TIME CONST. 0.002 T'd SUB-TRANSTIME CONST. 0.002 T'do O.C. FIELD TIME CONST. 0.559	Saturated Values in Per Unit at Base	Ratings and Voltages	
X"d Dir. Axis Subtransient 0.113 Xq Quad. Axis Reactance 1.307 X"q Quad. Axis Subtransient 0.141 XL Stator Leakage Reactance 0.073 X2 Negative Sequence Reactance 0.214 X0 Zero Sequence Reactance 0.044 Unsaturated Values in Per Unit at Base Ratings and Voltages Xd Dir. Axis Synchronous 1.961 X'd Dir. Axis Transient 0.154 X"d Dir. Axis Subtransient 0.132 Xq Quad. Axis Reactance 1.346 X"q Quad. Axis Subtransient 0.169 XL Stator Leakage Reactance 0.082 X2 Negative Sequence Reactance 0.051 Time Constants (Seconds) 0.051 Time Constants (Seconds) 0.002 T'd SUB-TRANSTIME CONST. 0.002 T'do O.C. FIELD TIME CONST. 0.559	Xd Dir. Axis Synchronous	1.634	
Xq Quad. Axis Reactance 1.307 X"q Quad. Axis Subtransient 0.141 XL Stator Leakage Reactance 0.073 X2 Negative Sequence Reactance 0.214 X0 Zero Sequence Reactance 0.044 Unsaturated Values in Per Unit at Base Ratings and Voltages Xd Dir. Axis Synchronous 1.961 X'd Dir. Axis Transient 0.154 X"d Dir. Axis Subtransient 0.132 Xq Quad. Axis Reactance 1.346 X"q Quad. Axis Subtransient 0.169 XL Stator Leakage Reactance 0.082 X2 Negative Sequence Reactance 0.257 X0 Zero Sequence Reactance 0.051 Time Constants (Seconds) 0.02 T'd TRANSIENT TIME CONST. 0.002 T'd SUB-TRANSTIME CONST. 0.002 T'do O.C. FIELD TIME CONST. 0.559	X'd Dir. Axis Transient	0.134	
X"q Quad. Axis Subtransient 0.141 XL Stator Leakage Reactance 0.073 X2 Negative Sequence Reactance 0.214 X0 Zero Sequence Reactance 0.044 Unsaturated Values in Per Unit at Base Ratings and Voltages Xd Dir. Axis Synchronous 1.961 X'd Dir. Axis Transient 0.154 X"d Dir. Axis Subtransient 0.132 Xq Quad. Axis Reactance 1.346 X"q Quad. Axis Subtransient 0.169 XL Stator Leakage Reactance 0.082 X2 Negative Sequence Reactance 0.257 X0 Zero Sequence Reactance 0.051 Time Constants (Seconds) 0.02 T'd TRANSIENT TIME CONST. 0.002 T'd SUB-TRANSTIME CONST. 0.002 T'do O.C. FIELD TIME CONST. 0.559	X"d Dir. Axis Subtransient	0.113	
XL Stator Leakage Reactance 0.073 X2 Negative Sequence Reactance 0.214 X0 Zero Sequence Reactance 0.044 Unsaturated Values in Per Unit at Base Ratings and Voltages Xd Dir. Axis Synchronous 1.961 X'd Dir. Axis Transient 0.154 X"d Dir. Axis Subtransient 0.132 Xq Quad. Axis Reactance 1.346 X"q Quad. Axis Subtransient 0.169 XL Stator Leakage Reactance 0.082 X2 Negative Sequence Reactance 0.257 X0 Zero Sequence Reactance 0.051 Time Constants (Seconds) T'd TRANSIENT TIME CONST. 0.02 T'd SUB-TRANSTIME CONST. 0.002 T'do O.C. FIELD TIME CONST. 0.559	Xq Quad. Axis Reactance	1.307	
X2 Negative Sequence Reactance 0.214 X0 Zero Sequence Reactance 0.044 Unsaturated Values in Per Unit at Base Ratings and Voltages Xd Dir. Axis Synchronous 1.961 X'd Dir. Axis Transient 0.154 X"d Dir. Axis Subtransient 0.132 Xq Quad. Axis Reactance 1.346 X"q Quad. Axis Subtransient 0.169 XL Stator Leakage Reactance 0.082 X2 Negative Sequence Reactance 0.257 X0 Zero Sequence Reactance 0.051 Time Constants (Seconds) T'd TRANSIENT TIME CONST. 0.02 T'd SUB-TRANSTIME CONST. 0.002 T'do O.C. FIELD TIME CONST. 0.559	X"q Quad. Axis Subtransient	0.141	
X0 Zero Sequence Reactance 0.044 Unsaturated Values in Per Unit at Base Ratings and Voltages Xd Dir. Axis Synchronous 1.961 X'd Dir. Axis Transient 0.154 X"d Dir. Axis Subtransient 0.132 Xq Quad. Axis Reactance 1.346 X"q Quad. Axis Subtransient 0.169 XL Stator Leakage Reactance 0.082 X2 Negative Sequence Reactance 0.257 X0 Zero Sequence Reactance 0.051 Time Constants (Seconds) 0.02 T'd TRANSIENT TIME CONST. 0.02 T'd SUB-TRANSTIME CONST. 0.002 T'do O.C. FIELD TIME CONST. 0.559	XL Stator Leakage Reactance	0.073	
Unsaturated Values in Per Unit at Base Ratings and VoltagesXd Dir. Axis Synchronous1.961X'd Dir. Axis Transient0.154X"d Dir. Axis Subtransient0.132Xq Quad. Axis Reactance1.346X"q Quad. Axis Subtransient0.169XL Stator Leakage Reactance0.082X2 Negative Sequence Reactance0.257X0 Zero Sequence Reactance0.051Time Constants (Seconds)T'd TRANSIENT TIME CONST.0.02T"d SUB-TRANSTIME CONST.0.002T'do O.C. FIELD TIME CONST.0.559	X2 Negative Sequence Reactance	0.214	
Xd Dir. Axis Synchronous 1.961 X'd Dir. Axis Transient 0.154 X"d Dir. Axis Subtransient 0.132 Xq Quad. Axis Reactance 1.346 X"q Quad. Axis Subtransient 0.169 XL Stator Leakage Reactance 0.082 X2 Negative Sequence Reactance 0.257 X0 Zero Sequence Reactance 0.051 Time Constants (Seconds) T'd TRANSIENT TIME CONST. 0.02 T'd SUB-TRANSTIME CONST. 0.002 T'do O.C. FIELD TIME CONST. 0.559	X0 Zero Sequence Reactance	0.044	
X'd Dir. Axis Transient 0.154 X"d Dir. Axis Subtransient 0.132 Xq Quad. Axis Reactance 1.346 X"q Quad. Axis Subtransient 0.169 XL Stator Leakage Reactance 0.082 X2 Negative Sequence Reactance 0.257 X0 Zero Sequence Reactance 0.051 Time Constants (Seconds) T'd TRANSIENT TIME CONST. 0.02 T'd SUB-TRANSTIME CONST. 0.002 T'do O.C. FIELD TIME CONST. 0.559	Unsaturated Values in Per Unit at Ba	se Ratings and Voltages	
X"d Dir. Axis Subtransient 0.132 Xq Quad. Axis Reactance 1.346 X"q Quad. Axis Subtransient 0.169 XL Stator Leakage Reactance 0.082 X2 Negative Sequence Reactance 0.257 X0 Zero Sequence Reactance 0.051 Time Constants (Seconds) T'd TRANSIENT TIME CONST. 0.02 T'd SUB-TRANSTIME CONST. 0.002 T'do O.C. FIELD TIME CONST. 0.559	Xd Dir. Axis Synchronous	1.961	
Xq Quad. Axis Reactance 1.346 X"q Quad. Axis Subtransient 0.169 XL Stator Leakage Reactance 0.082 X2 Negative Sequence Reactance 0.257 X0 Zero Sequence Reactance 0.051 Time Constants (Seconds) T'd TRANSIENT TIME CONST. 0.02 T"d SUB-TRANSTIME CONST. 0.002 T'do O.C. FIELD TIME CONST. 0.559	X'd Dir. Axis Transient	0.154	
X"q Quad. Axis Subtransient 0.169 XL Stator Leakage Reactance 0.082 X2 Negative Sequence Reactance 0.257 X0 Zero Sequence Reactance 0.051 Time Constants (Seconds) T'd TRANSIENT TIME CONST. 0.02 T"d SUB-TRANSTIME CONST. 0.002 T'do O.C. FIELD TIME CONST. 0.559	X"d Dir. Axis Subtransient	0.132	
X"q Quad. Axis Subtransient 0.169 XL Stator Leakage Reactance 0.082 X2 Negative Sequence Reactance 0.257 X0 Zero Sequence Reactance 0.051 Time Constants (Seconds) T'd TRANSIENT TIME CONST. 0.02 T"d SUB-TRANSTIME CONST. 0.002 T'do O.C. FIELD TIME CONST. 0.559	Xq Quad. Axis Reactance	1.346	
X2 Negative Sequence Reactance 0.257 X0 Zero Sequence Reactance 0.051 Time Constants (Seconds) T'd TRANSIENT TIME CONST. 0.02 T''d SUB-TRANSTIME CONST. 0.002 T'do O.C. FIELD TIME CONST. 0.559		0.169	
X2 Negative Sequence Reactance 0.257 X0 Zero Sequence Reactance 0.051 Time Constants (Seconds) T'd TRANSIENT TIME CONST. 0.02 T''d SUB-TRANSTIME CONST. 0.002 T'do O.C. FIELD TIME CONST. 0.559	XL Stator Leakage Reactance	0.082	
X0 Zero Sequence Reactance 0.051 Time Constants (Seconds) T'd TRANSIENT TIME CONST. 0.02 T'd SUB-TRANSTIME CONST. 0.002 T'do O.C. FIELD TIME CONST. 0.559		0.257	
T'd TRANSIENT TIME CONST. 0.02 T"d SUB-TRANSTIME CONST. 0.002 T'do O.C. FIELD TIME CONST. 0.559		0.051	
T"d SUB-TRANSTIME CONST. 0.002 T'do O.C. FIELD TIME CONST. 0.559	Time Constants (Seconds)		
T"d SUB-TRANSTIME CONST. 0.002 T'do O.C. FIELD TIME CONST. 0.559	T'd TRANSIENT TIME CONST.	0.02	
T'do O.C. FIELD TIME CONST. 0.559		0.002	
Ta ARMATURE TIME CONST. 0.006		0.559	
	Ta ARMATURE TIME CONST.	0.006	




Resistances in Ohms (Ω) at 22°C	
Stator Winding Resistance (Ra)	$0.402~\Omega$ per phase series star connected
Rotor Winding Resistance (Rf)	0.747 Ω
Exciter Stator Winding Resistance	15.42 Ω
Exciter Rotor Winding Resistance	
	0.106 Ω per phase 0.503 Ω
Positive Sequence Resistance (R1)	
Negative Sequence Resistance (R2	0.579 Ω
Zero Sequence Resistance (R0)	0.503 Ω
Aux Winding Resistance	N/A
Mechanical data	
Cooling Air	0.126 m³/sec
	All alternator rotors are dynamically balanced to better than
Shaft and Keys	BS6861: Part 1 Grade 2.5 for minimum vibration in operation.
Bearing	Single Bearing
Weight Complete Alternator	121.1 kg
Weight Wound Stator	49 kg
Weight Wound Rotor	43.4 kg 0.159 kam²
Moment of Inertia	0.159 kgm ²
Shipping weight in a Crate	159 kg
Packing Crate Size	930X590X760 mm
Maximum Over Speed	2250 RPM for two minutes
Bearing Drive End	N/A
Bearing Non-Drive End	Ball Bearing, 6305-2RS1



Three Phase Efficiency Curves

60Hz Curves

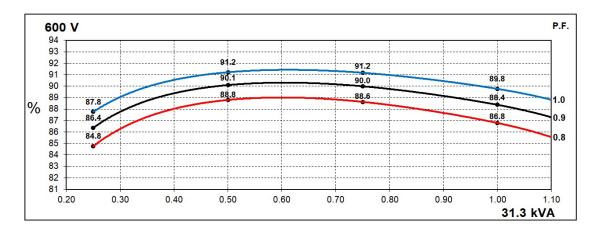




S0L2-M1 Winding 17

Locked Rotor Motor Starting Curves

60Hz

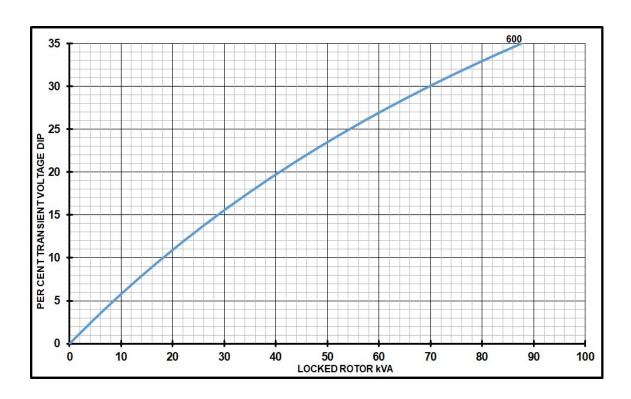

Transient Voltage Dip Scaling Factor		Transient Voltage Rise Scaling Factor		
Lagging PF	Scaling Factor	Lagging PF	Scaling Factor	
<= 0.4	1.00	<= 0.4	1.25	
0.5	0.95	0.5	1.20	
0.6	0.90	0.6	1.15	
0.7	0.86	0.7	1.10	
0.8	0.83	> 0.7	1.00	
0.9	0.75			
0.95	0.70			

Note: To determine % Transient Voltage Dip or Rise at various PF, multiply the % Voltage Dip from the curve directly by the scaling factor.


0.65

STAMFORD

S0L2-M1 Winding 17

Three-phase Short Circuit Decrement Curve

60Hz

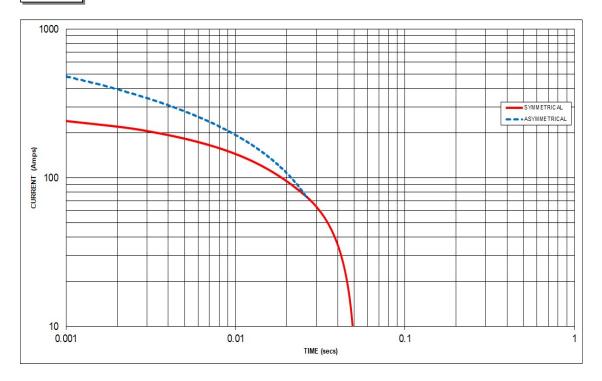

Note 1

The following multiplication factors should be used to adjust the values from curve between time 0.001 seconds and the minimum current point in respect of nominal operating voltage :

50Hz		60Hz	
Voltage	Factor	Voltage	Factor
-	-	600V	X 1.00
-	-	-	-
-	-	-	-
-	-	-	-

The sustained current value is constant irrespective of voltage level

Note 2

The following multiplication factor should be used to convert the values calculated in accordance with NOTE 1 to those applicable to the various types of short circuit:

	3-phase	2-phase L-L	1-phase L-N
Instantaneous	x 1.00	x 0.87	x 1.30
Minimum	x 1.00	x 1.80	x 3.20
Sustained	N/A	N/A	N/A
Max. sustained duration	10 sec.	5 sec.	2 sec.

All other times are unchanged

Note 3

Curves are drawn for Star connected machines under no-load excitation at rated speeds. For other connection the following multipliers should be applied to current values as shown:


Parallel Star = Curve current value X 2

Series Delta = Curve current value X 1.732



Typical Alternator Operating Charts

600V/60Hz

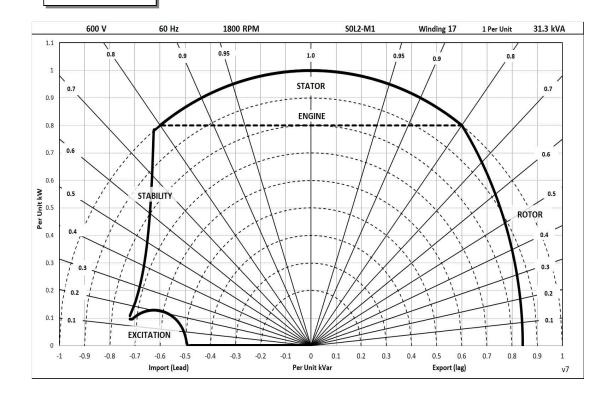



RATINGS AT 0.8 POWER FACTOR

	Class - Temp Rise	Standby - 163/27°C	Standby - 150/40°C	Cont. H - 125/40°C	Cont. F - 105/40°C
-A	Series Star (V)				
50 Hz	Parallel Star (V)	N/A	N/A	N/A	N/A
	Series Delta (V)				
l	kVA				
	kW	N/A	N/A	N/A	N/A
	Efficiency (%)				,, .
	kW Input				
				-	-
60	Series Star (V)	600	600	600	600
Hz	Parallel Star (V)	300	300	300	300
	Series Delta (V)	346	346	346	346
l	kVA	34.1	32.9	31.3	28.2
	kW	27.3	26.3	25.0	22.6
	Efficiency (%)	85.7	86.2	86.8	87.7
	kW Input	31.8	30.5	28.8	25.7

De-Rates

All values tabulated above are subject to the following reductions:

- 3% for every 500 meters by which the operating altitude exceeds 1000 meters above mean sea level
- 3% for every 5° C by which the operational ambient temperature exceeds 40° C
- For any other operating conditions impacting the cooling circuit please refer to applications

Note: Requirement for operating in an ambient exceeding 60°C and altitude exceeding 4000 meters must be referred to applications.

Dimensional and Torsional Drawing

For dimensional and torsional information please refer to the alternator General Arrangement and rotor drawings available on our website (http://stamford-avk.com/)

Note: Continuous development of our products means that the information contained in our data sheets can change without notice, and specifications should always be confirmed with Cummins Generator Technologies prior to purchase.







View our videos at youtube.com/stamfordavk

news.stamford-avk.com

For Applications Support: applications@cummins.com

For Customer Service: service-engineers@stamford-avk.com

For General Enquiries: info@cumminsgeneratortechnologies.com

Copyright 2019. Cummins Generator Technologies Ltd. All rights reserved.

Cummins and the Cummins logo are registered trade marks of Cummins Inc.

STAMFORD is a registered trade mark of Cummins Generator Technologies Ltd.

