

**Technical Data Sheet for AvK-Alternators**

FM 7.3-5

Date:	08/01/14	Customer:	GENERIC DATASHEET only
Project No.:		AvK Reference:	dsg114m2_6_60_690_A048M990

Object data:	
Site:	Prime Mover:
Application: Stationary Power Plant	Manufacturer:

Generator data:					
Generator:	DSG 114 M2/6	Poles:	6	Standards: IEC 60034	
Rated power:	5000 kVA	4000 kWe	4124 kWm		
Power factor:	0.80				
Power at pf 1,0	4031 kVA	4031 kWe	4124 kWm		
Rated voltage:	0.69 kV				
Speed:	1200 1/min				
Frequency:	60 Hz	Voltage range / frequency range:			
Rated current:	4183.7 A	Zone A according IEC 60034-1 (dU = +/-5%, df = +/-2%)			
Winding pitch:	ca. 5/6				
Insulation class:	Stator: Class H	Rotor: Class H	Temperature rise:	H	
Ambient temperature:	40 ° C	Environment:	Standard environment		
Site altitude:	1000 m	Filter:			
Enclosure:	IP23				
Cooling:	IC 01 - Open-circuit ventilation				
Coolant:	Ambient Air	Temperature	40 ° C	Temperature Air inlet	40 ° C
		Coolant:		generator:	
		Cooling air vol.:	3.6 m³/s	Cooling water quantity:	n/a
Moment of inertia (I):	400 kgm²	Weight:	12600 Kg	Losses (environment):	124 KW
				Losses (cooling):	n/a

Wires:	4 terminals, starpoint connected in terminal box
Operation mode:	Single mode
Regulators:	
Voltage regulator:	DECS 100

Electrical data: (acc. IEC)					
Efficiencies:	110%	100%	75%	50%	25%
Power factor 0.8	96,85	97	97	96,7	95
Power factor 0.9	97,25	97,38	97,33	96,95	95,18
Power factor 1.0	97,64	97,75	97,65	97,2	95,35

Reactances and time constants											
	unsaturated		saturated			unsaturated		saturated			
X _d	2.25	2.03	p.u.	X _q	1.13	1.11	p.u.	T _{d0'}	3.3 s	T _{d0''}	0.03456 s
X _{d'}	0.273	0.273	p.u.	X _{q'}	1.13	1.11	p.u.	T _{d'}	0.40 s	T _{q0'}	0.4 s
X _{d''}	0.174	0.158	p.u.	X _{q''}	0.174	0.174	p.u.	T _{d''}	0.02 s	T _{q0''}	0.25977 s
X ₂	0.183	0.166	p.u.	X ₀	0.052	0.047	p.u.	T _a	0.06 s	T _{q'}	0.4 s
X _{1s}	n.a.	0.095	p.u.							T _{q''}	0.04 s
Short circuit ratio saturated: 0.49					Z _n 0.095 Ohm						

Short circuit data:			
Initial short circuit current (3-phase):	I _{k''}	26479 A	
Max. peak current (3-phase):	I _s	67405 A	
Sustained short circuit current:	I _k	12551 A	Minimum 3 x rated current for max.10 s
Initial short circuit torque:	M _{k2}	327.4 kNm	
	M _{k3}	196.4 kNm	
Max. faulty synchron moment:	M _f	703.9 kNm	
Rated kVA torque:	M _{SN}	39.79 kNm	
Rated torque	M _N	31.83 kNm	
Shaft torque	M _{Sh}	32.81 kNm	

Load application:	
max. load application: 2747 kVA (corresponds to 54,95 % from 5000 kVA) for Power factor 0.4 15% transient voltage drop	Power: 5000 kVA Power factor: 0.8 transient voltage drop: -21.4 %

Remarks:

Alternator : DSG 114 M2/6

Rated output [kVA]

5000

Rated power factor:

0.8

Rated voltage [kV]: 0.69


Rated frequency [Hz]

60

Rated speed [rpm]

1200


Wirkungsgrad-Kennlinie - Efficiency Curve

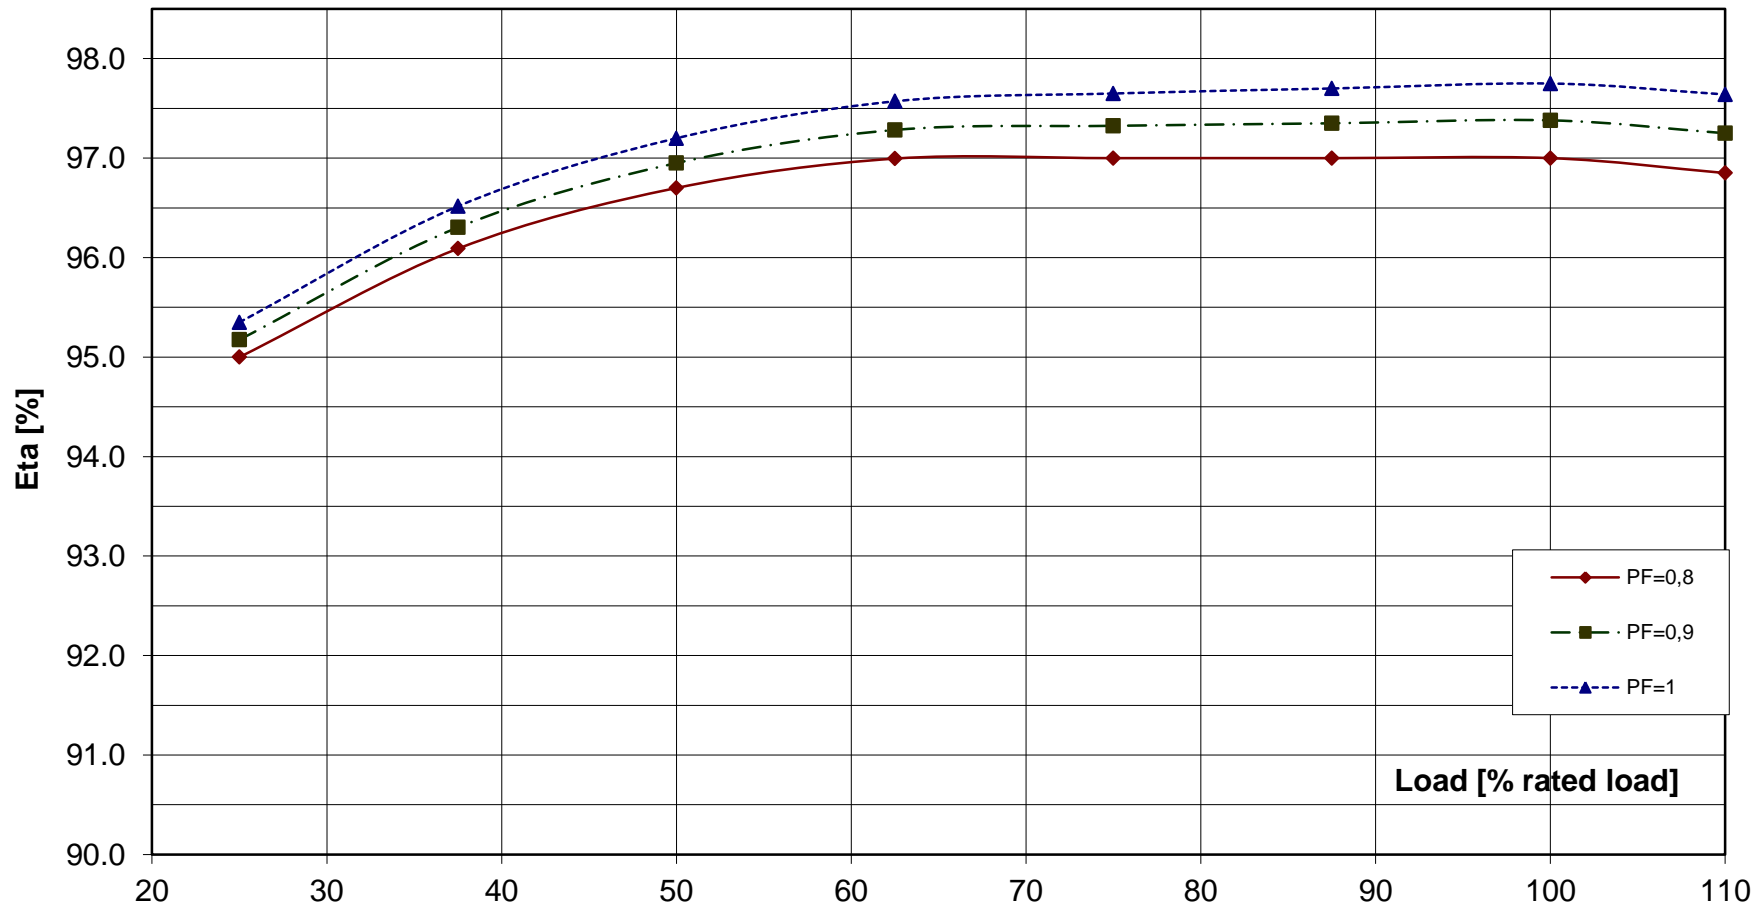

Alternator : DSG 114 M2/6

Rated output [kVA]	5000	Rated power factor:	0.8	Rated voltage [kV]:	0.69
Rated frequency [Hz]	60	Rated speed [rpm]	1200		

Transient Voltage rise or drop for sudden load removal or application

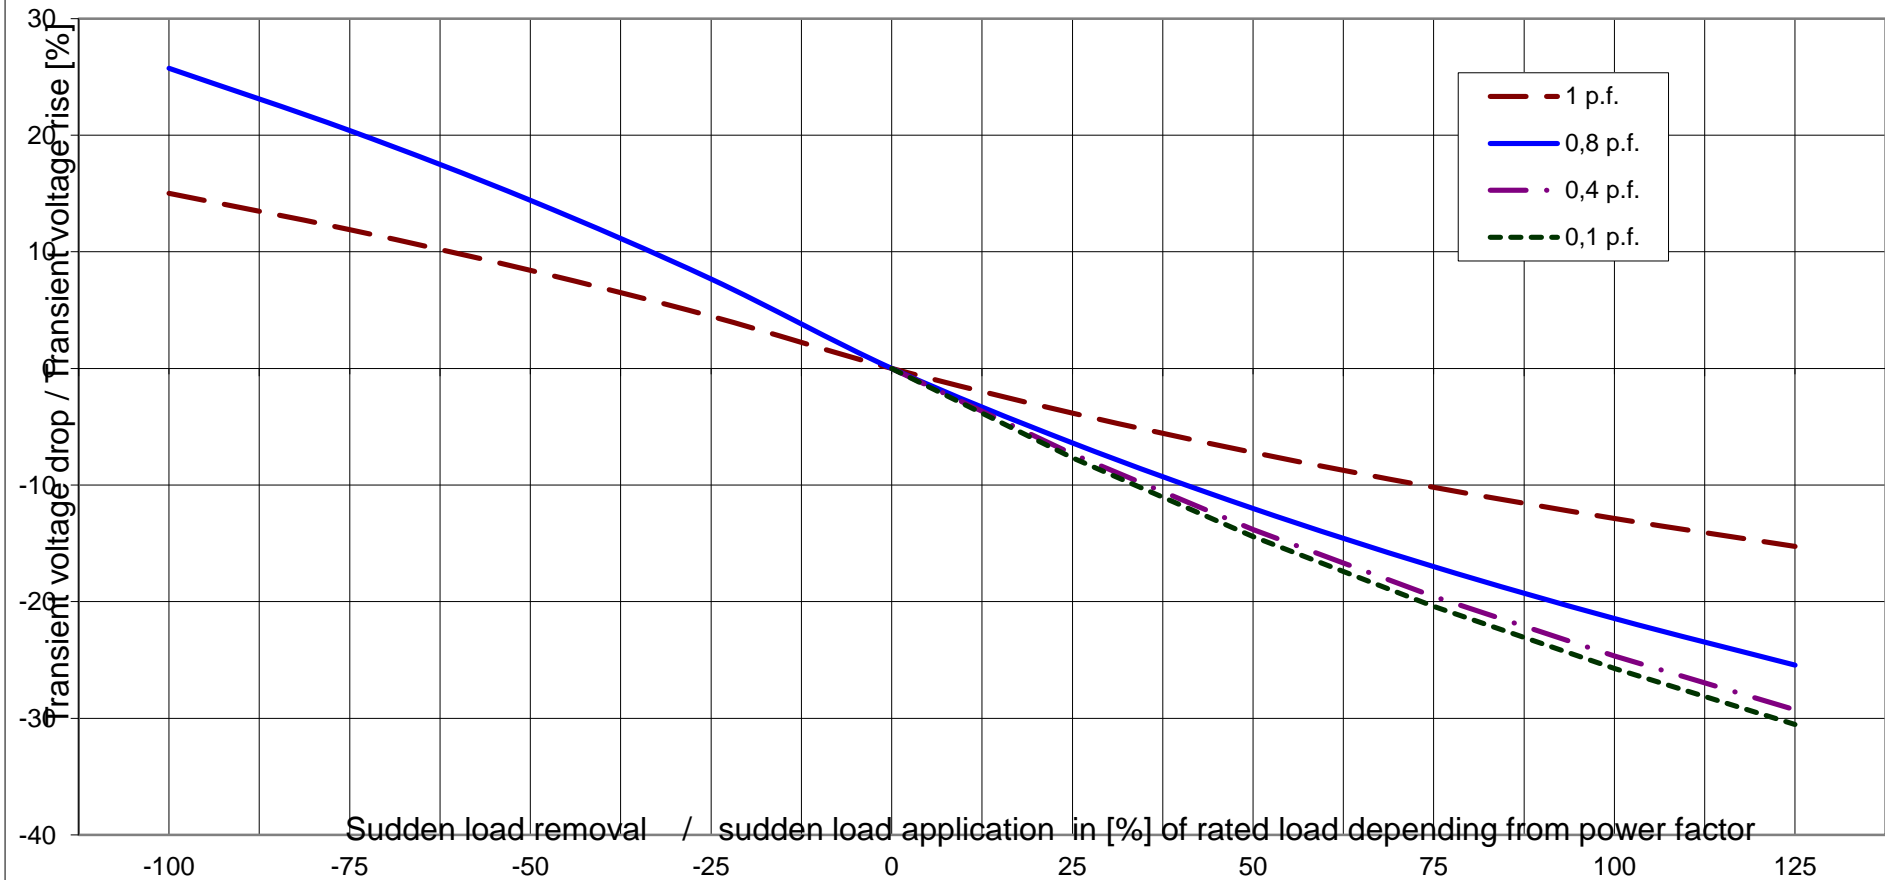




Technisches Datenblatt - Diagramme
Technical data sheet - Diagrams

ING-FCD-0112

Alternator : **DSG 114 M2/6**

Rated output [kVA]	5000	Rated power factor:	0.8	Rated voltage [kV]:	0.69
Rated frequency [Hz]	60	Rated speed [rpm]	1200	MSN related to kVA:	39.79 KNm

Kurzschlußmomenten-Verlauf 2-poliger KS
Short circuit torque at 2-phase SC

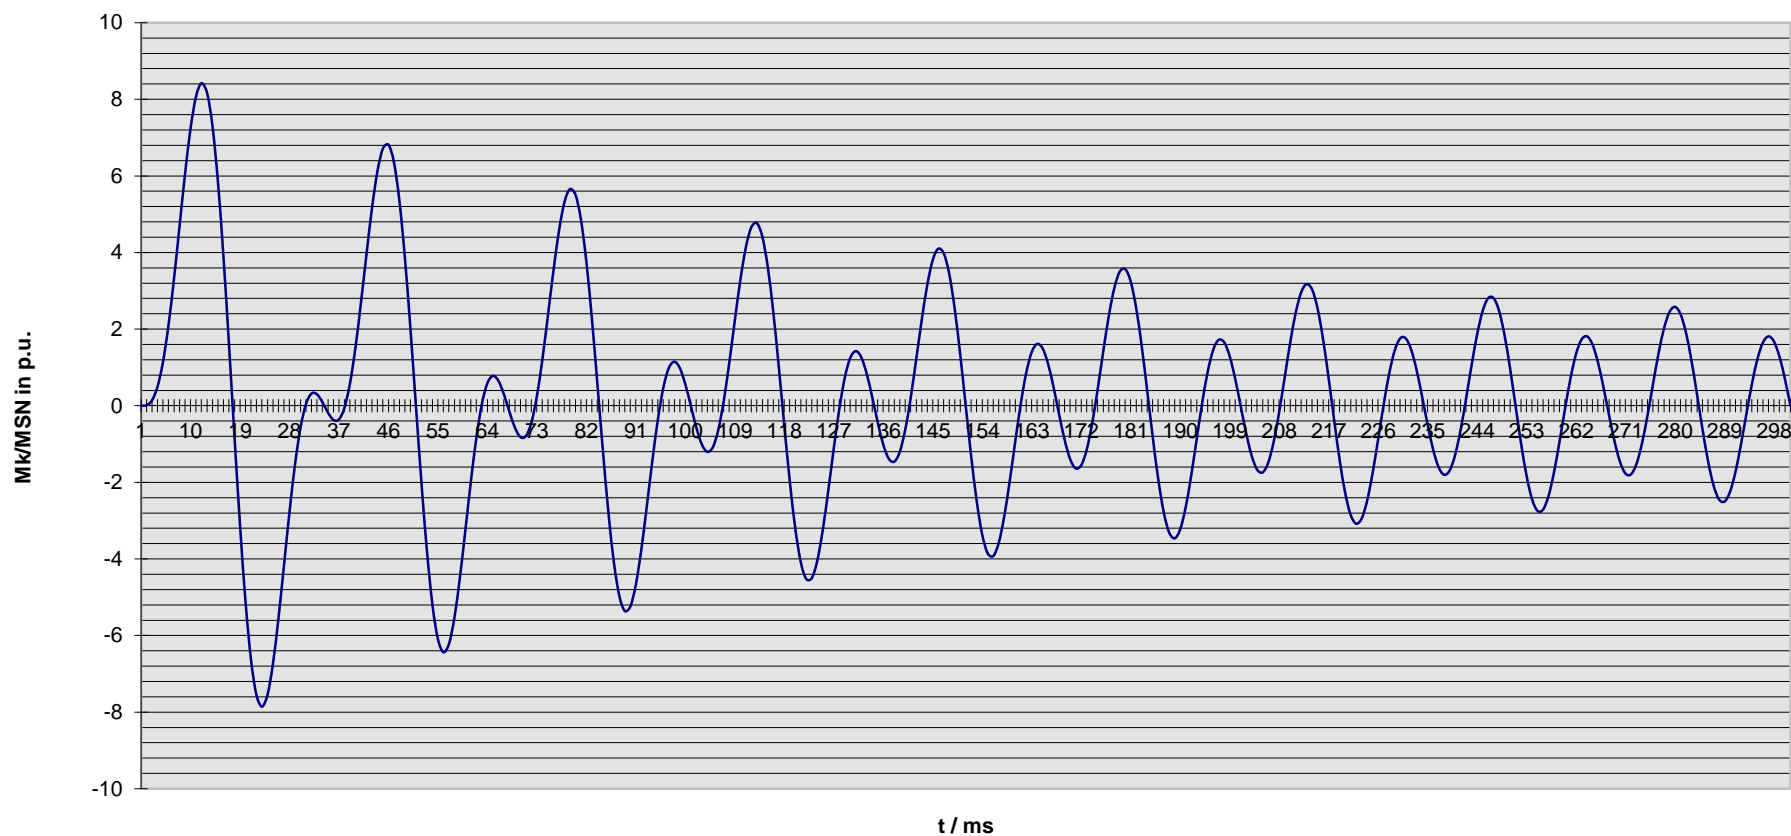

Nenn Daten / nominal data

DSG 114 M2/6

Leistung S_N : **5000 kVA**

$\cos \varphi$: **0.80**

Rating

p.f.

Spannung U_N : **0.69 kV**

Strom I_N : **4184 A**

Voltage

Current

Frequenz f : **60 Hz**

Drehzahl n : **1,200 min⁻¹**

Frequency


Speed

Schutzart **IP23**

Protection

Kurzschlussstrom $I_{k3\text{phasig}} / I_N$ [p.u.]
Short-circuit current $I_{k3\text{phase}} / I_N$ [p.u.]

Stosskurzschluss-Strom, 3-phasig, asymmetrisch /
Sudden short circuit current, 3-phase, asymmetrical

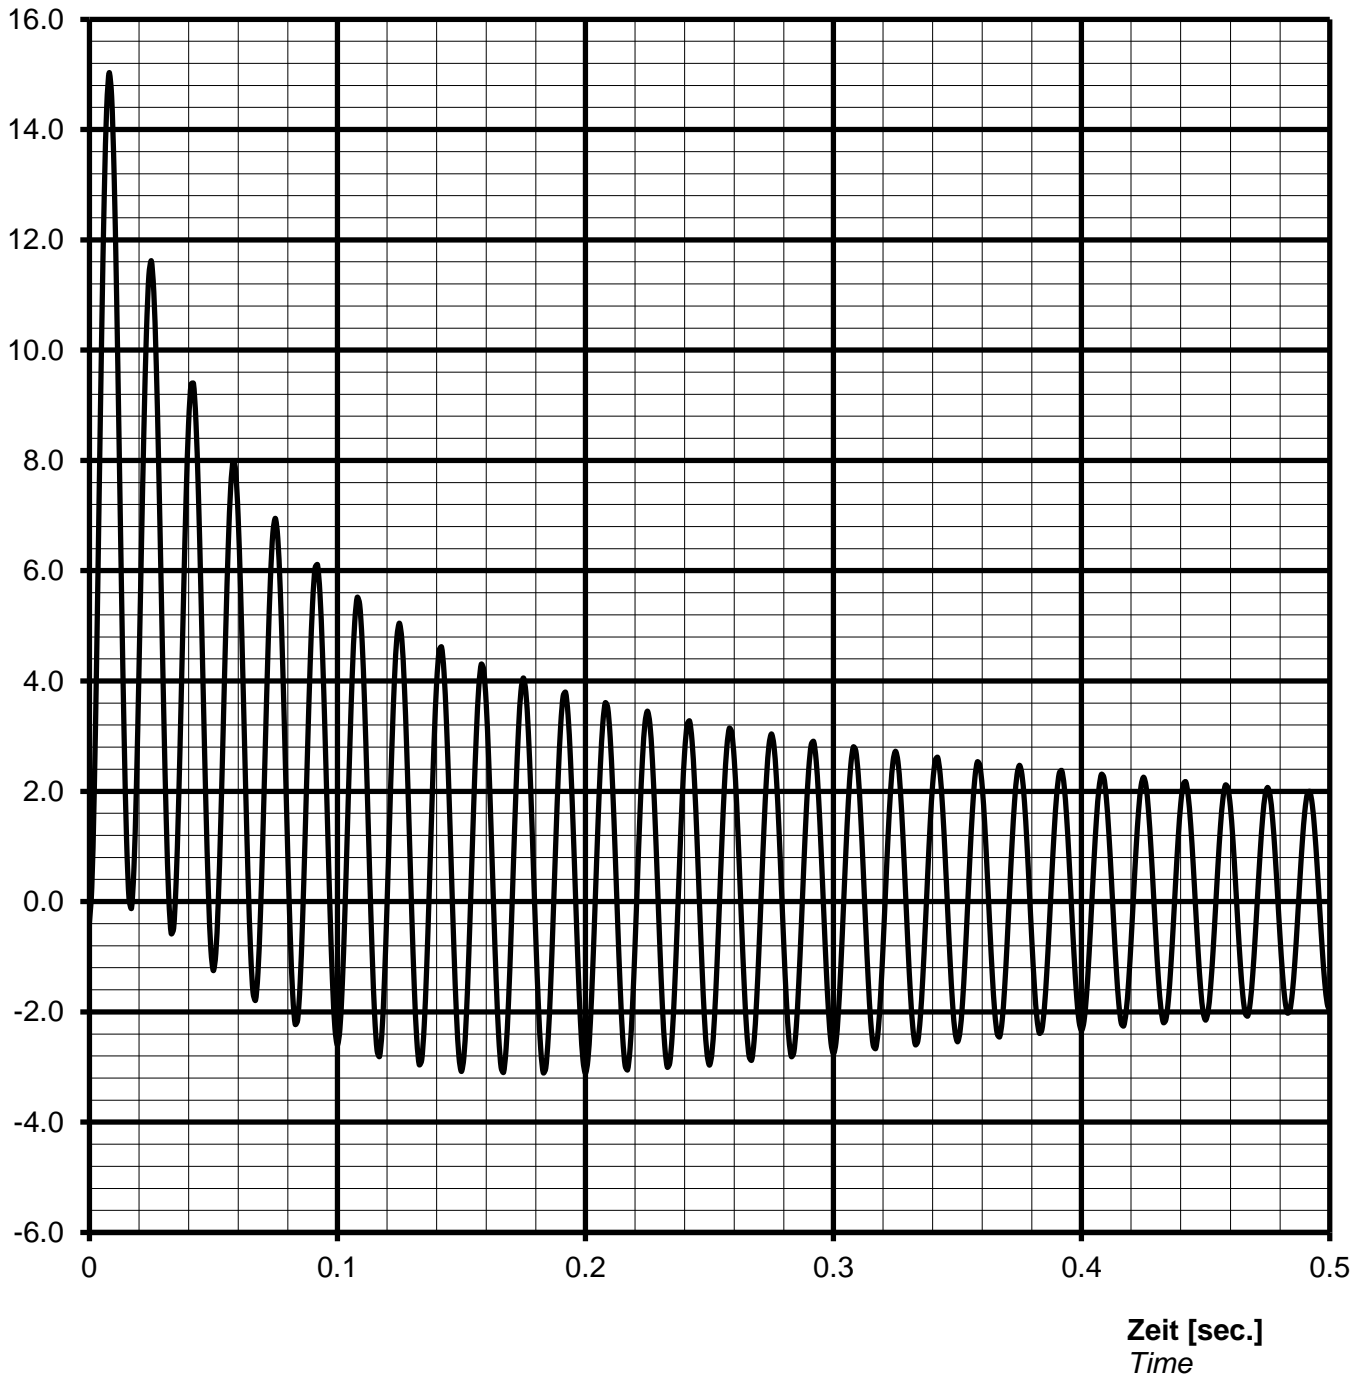

Notizen / remarks:

Maximum asymmetric peak value $I_{\text{peak}} = 62890 \text{ A}$ or 15.03 p.u.

Nenn Daten / nominal data

DSG 114 M2/6

Leistung S_N : **5000** kVA

$\cos \varphi$: **0.80**

Rating

p.f.

Spannung U_N : **0.69** kV

Strom I_N : **4184** A

Voltage

Current

Frequenz f: **60** Hz

Drehzahl n: **1200** min⁻¹


Frequency

Speed

Schutzart **IP23**

Protection

Überlast Kennlinie Overload capability

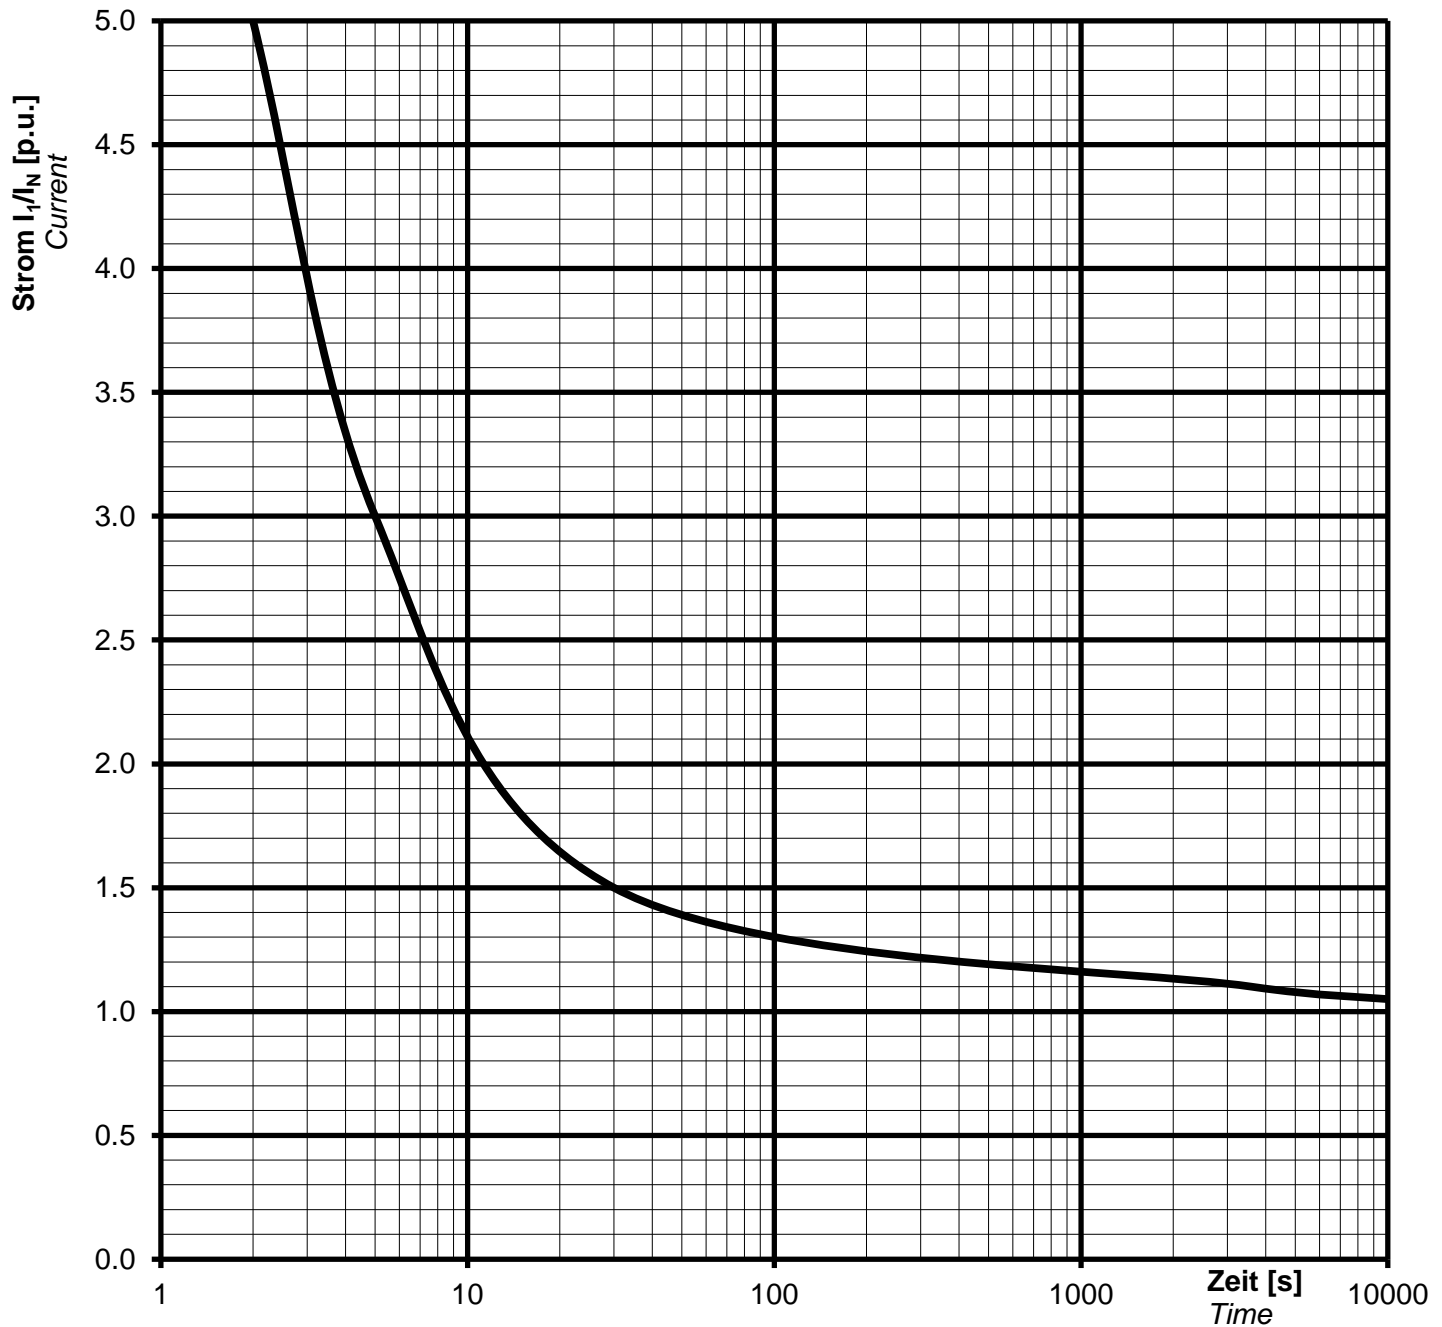

Notizen / remarks:

Strom / Zeit Kriterien:

$$(I / I_N)^2 \cdot t = 45s$$

Current/time characteristics:

$$1,5 \cdot I_N \text{ for } 30 \text{ s}$$

$$1,1 \cdot I_N \text{ for } 1 \text{ h in } 6 \text{ h}$$

Nenndaten / nominal data

DSG 114 M2/6

Rating S_N : **5000 kVA**

p.f. **0.80**

Bemessungsleistung

Leistungsfaktor $\cos \varphi$:

Nominal voltage U_N : **0.69 kV**

Nominal current I_N : **4184 A**

Bemessungsspannung

Bemessungsstrom

Frequency f_N : **60 Hz**

Speed n : **1200 min⁻¹**


Frequenz

Drehzahl

Protection: **IP23**

Schutzart

Inverse current or unbalanced negative sequence current

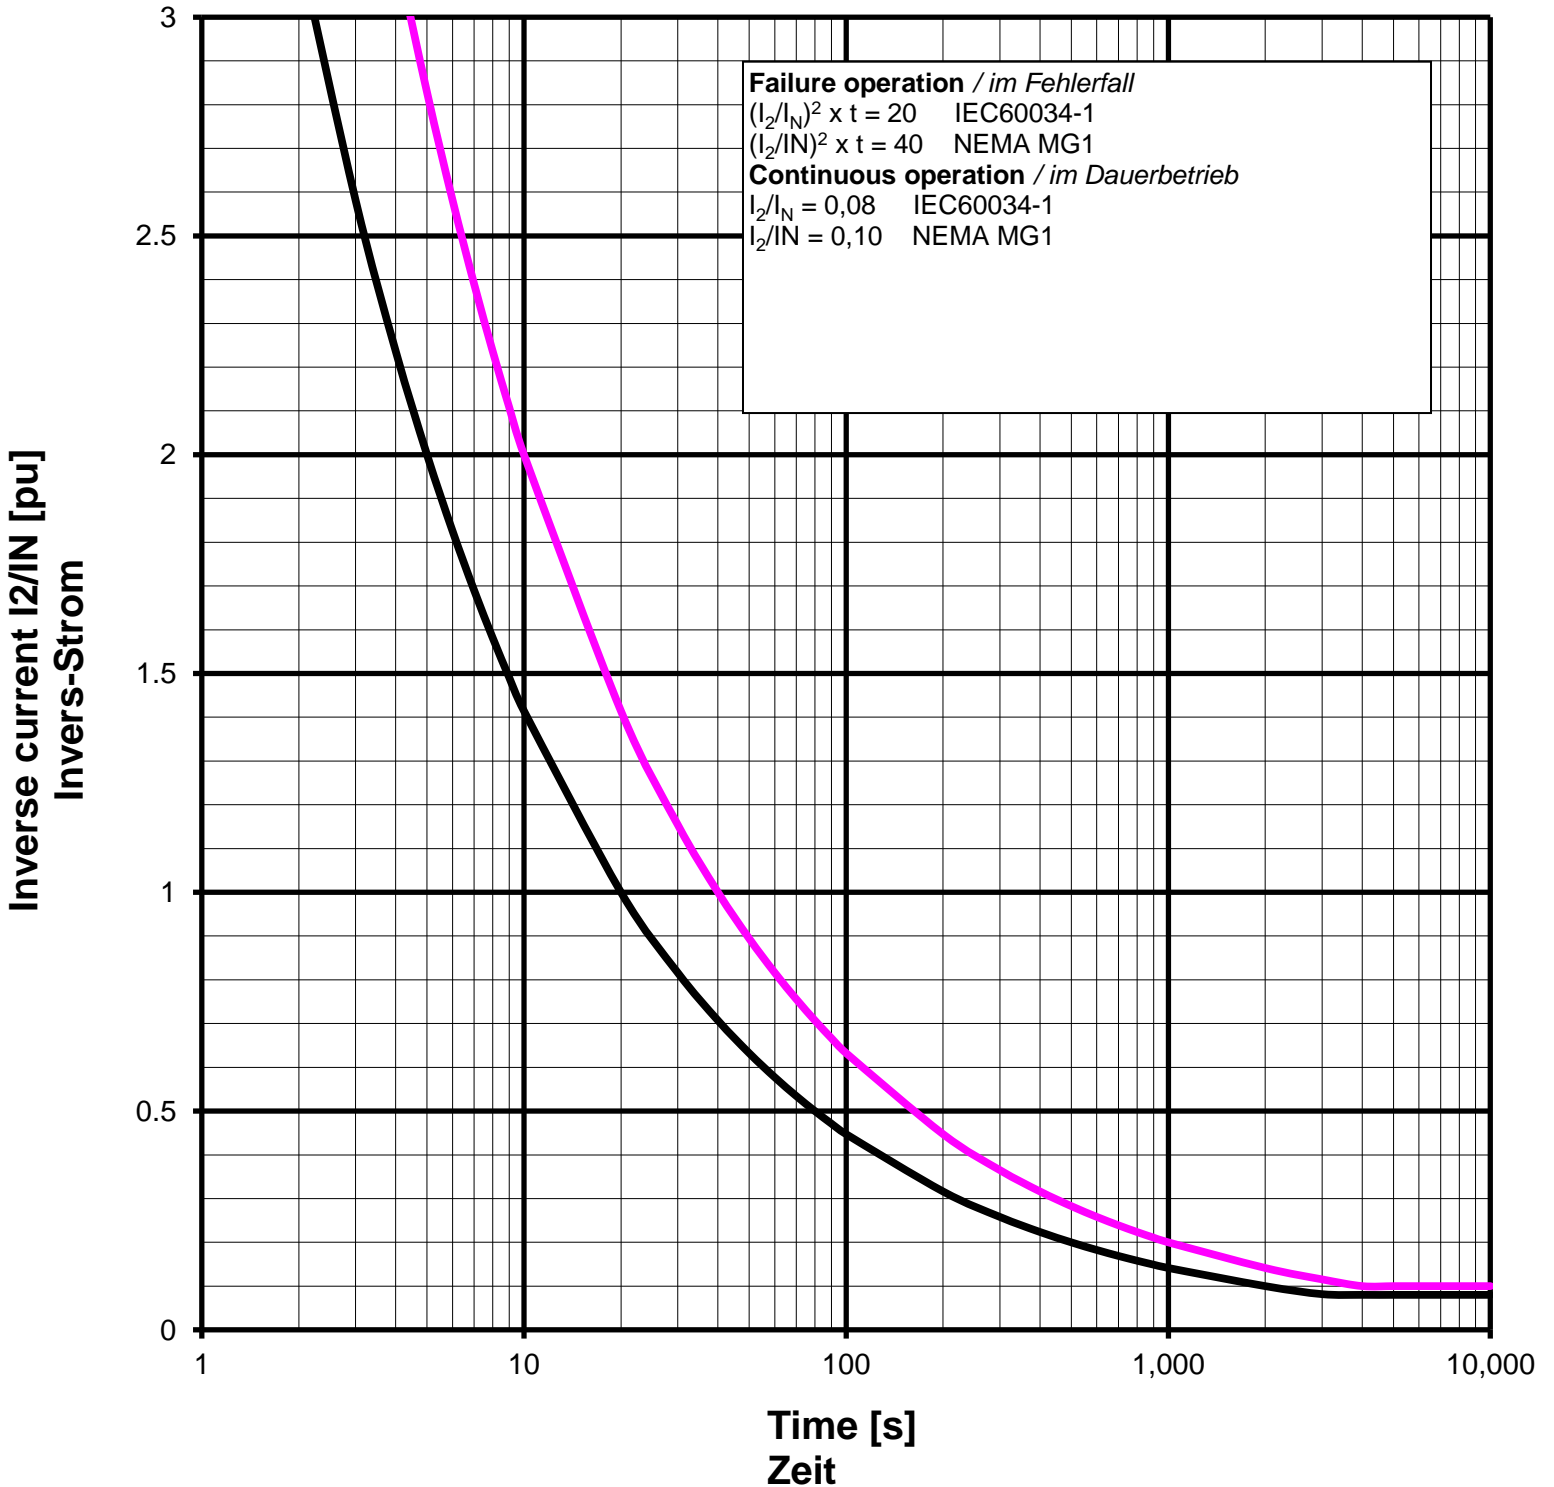

Remarks / Notizen:



Technische Daten selbstregelnden Drehstrom-Synchrongenerator
technical data for self regulating three phase alternator

ING-FCD-0112


TYPE

DSG 114 M2/6

Projekt:

Order Nr.:

Capability (P-Q) Diagram

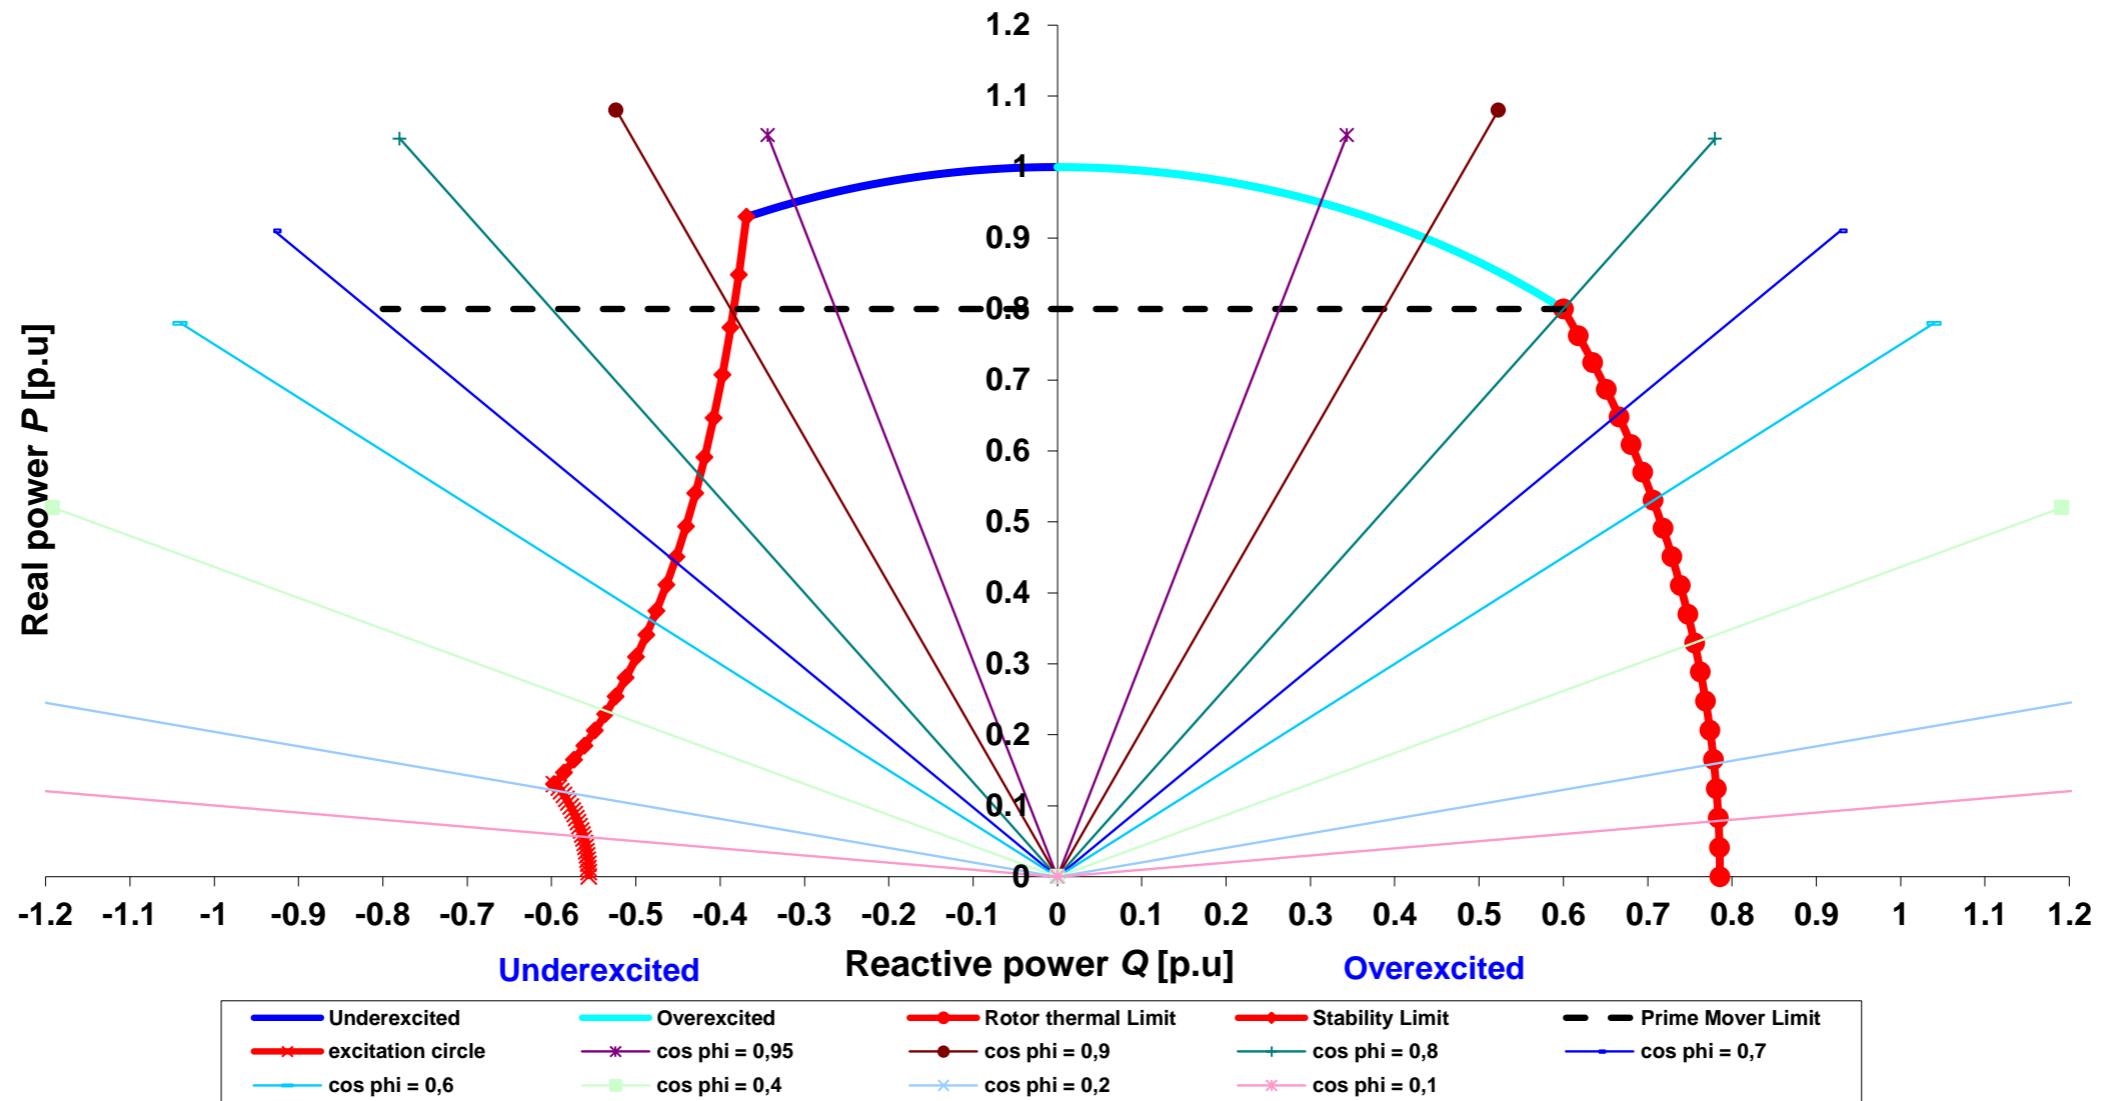


Cummins Generator Technologies

Datum / date:

21/01/2014

TYPE	DSG 114 M2/6	Projekt:		Order Nr.:	
------	--------------	----------	--	------------	--

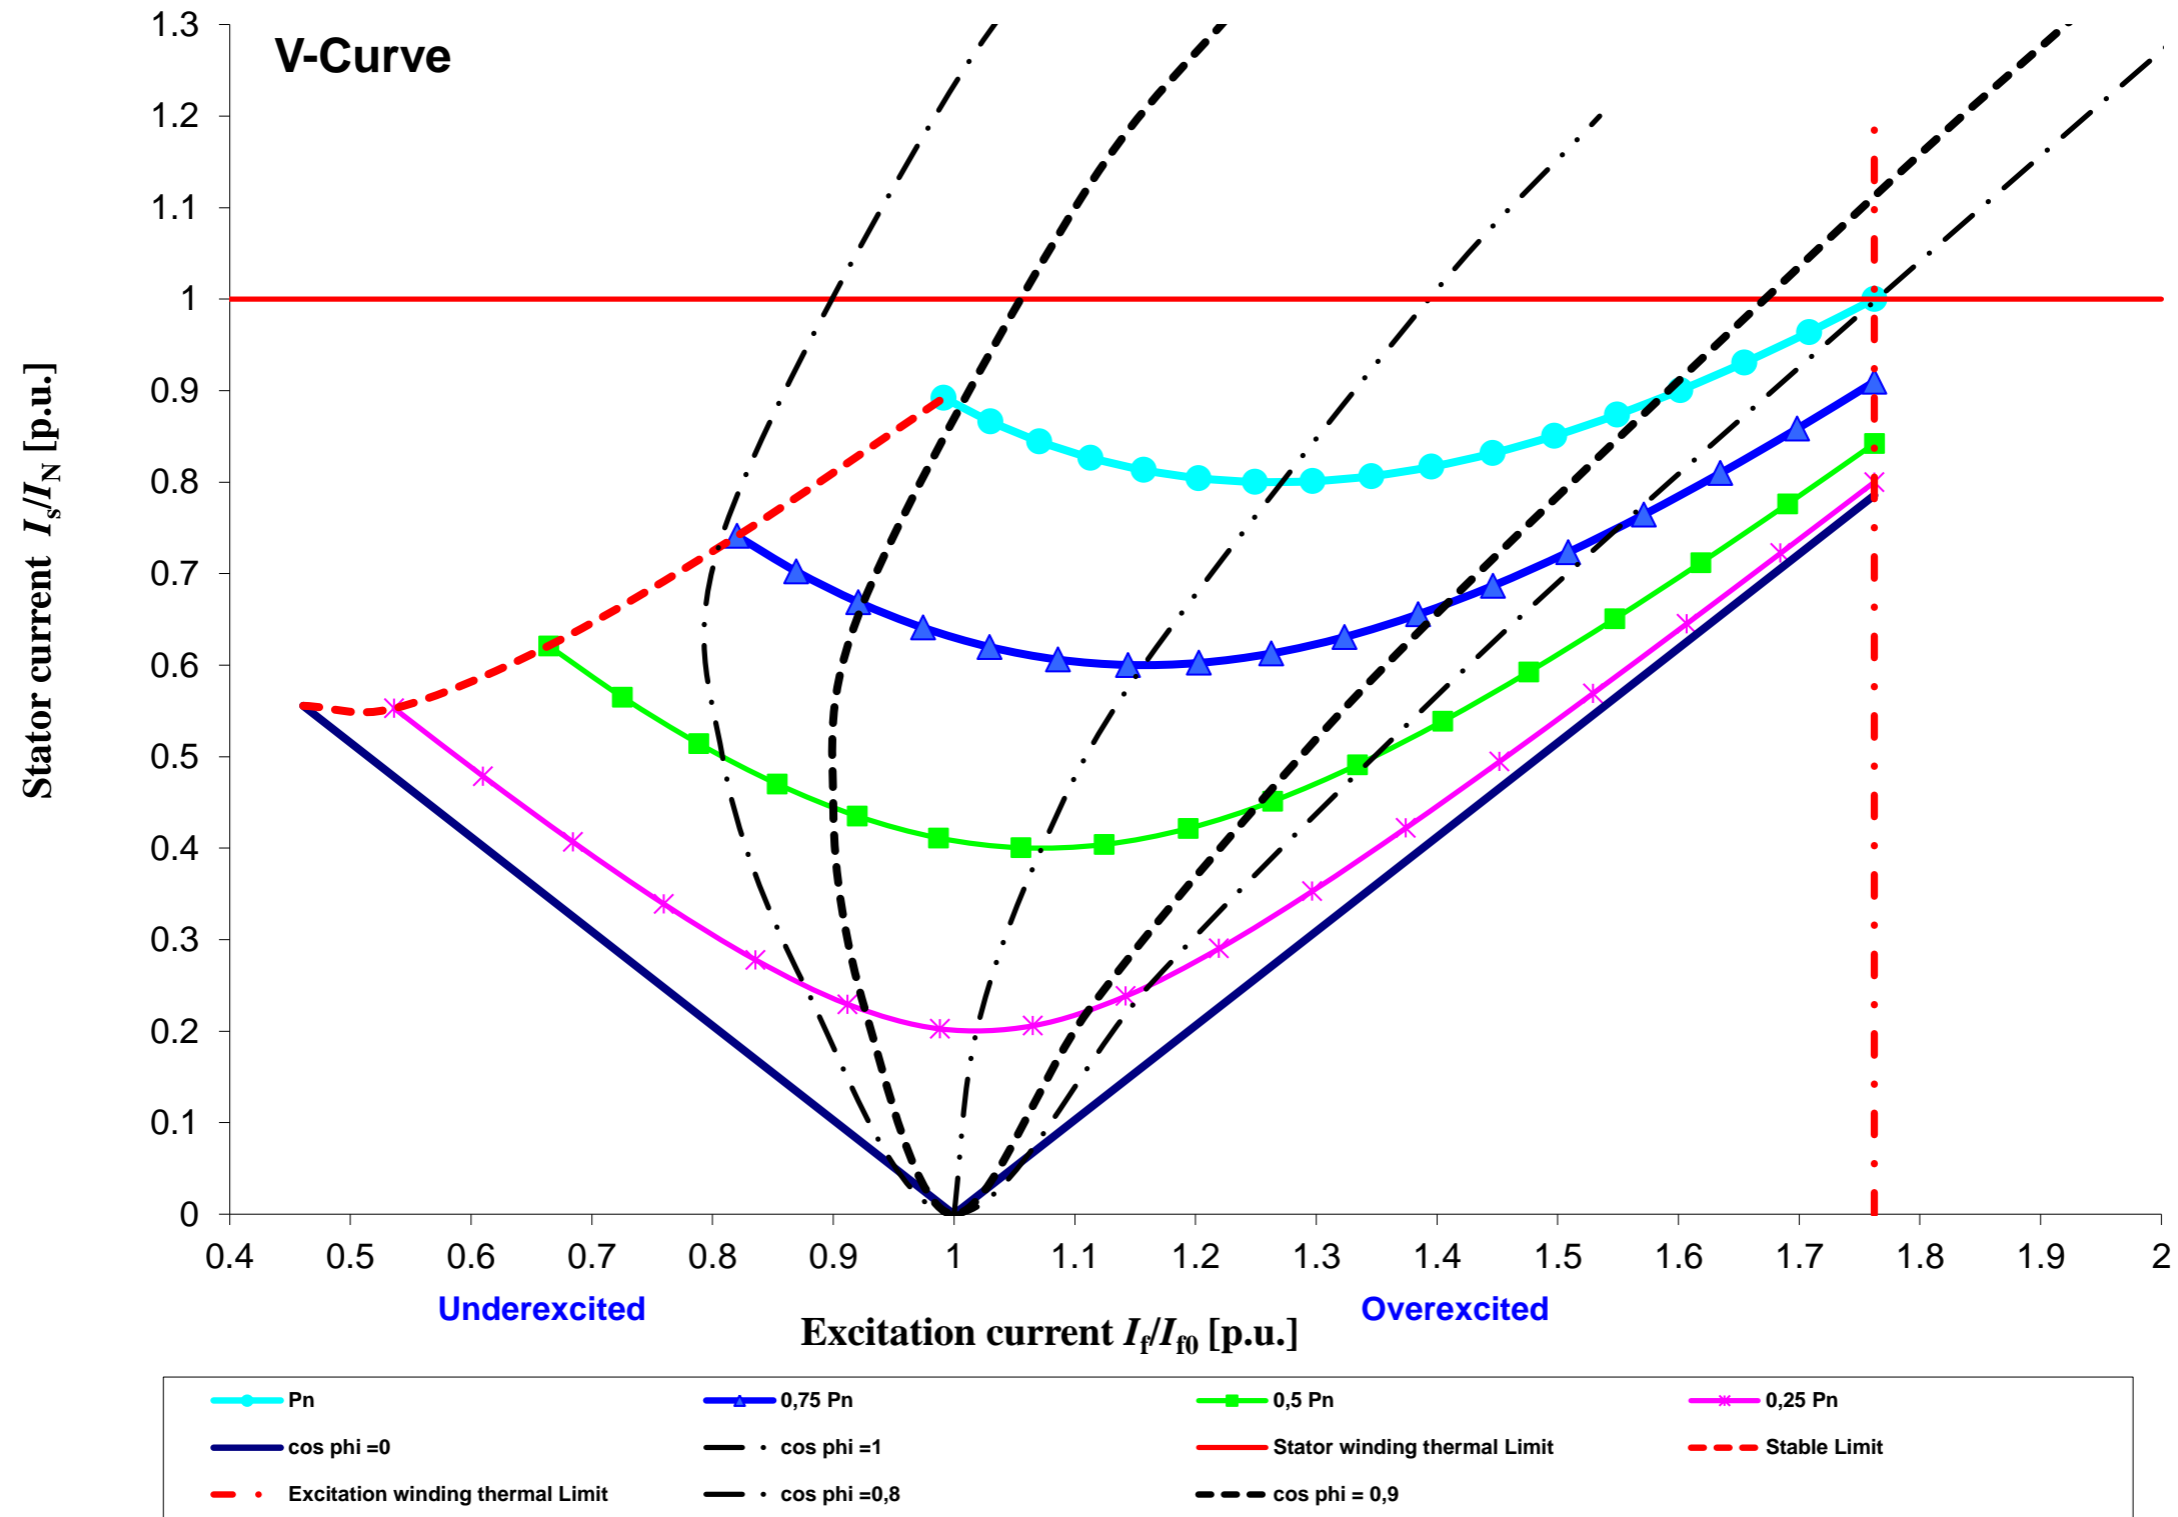

Cummins Generator Technologies	Datum / date:	
	21/01/2014	