



Technical Data Sheet for AvK-Alternators

FM 7.3-5

Date:	03/10/13	Customer:	GENERIC DATASHEET only
Project No.:		AvK Reference:	DSG114M2_6_60_480

Object data:	
Site:	Prime Mover:
Application: Stationary Power Plant	Manufacturer:

Generator data:					
Generator:	DSG 114 M2/6	Poles:	6	Standards: IEC 60034	
Rated power:	5940 kVA	4752 kWe	4909 kWm		
Power factor:	0.80				
Power at pf 1,0	4796 kVA	4796 kWe	4909 kWm		
Rated voltage:	0.48 kV				
Speed:	1200 1/min				
Frequency:	60 Hz		Voltage range / frequency range:		
Rated current:	7144.7 A		Zone A according IEC 60034-1 (dU = +/-5%, df = +/-2%)		
Winding pitch:	ca. 5/6				
Insulation class:	Stator: Class H	Rotor: Class H	Temperature rise:		H
Ambient temperature:	40 °C		Environment:	Standard environment	
Site altitude:	1000 m				
Enclosure:	IP23		Filter:		
Cooling:	IC 01 - Open-circuit ventilation				
Coolant:	Ambient Air	Temperature	40 °C	Temperature Air inlet	40 °C
		Coolant:		generator:	
		Cooling air vol.:	3.6 m³/s	Cooling water quantity:	n/a
Moment of inertia (I):	400 kgm²	Weight:	12600 Kg	Losses (environment):	157 KW
				Losses (cooling):	n/a

Wires:	4 terminals, starpoint connected in terminal box
Operation mode:	Single mode
Regulators:	
Voltage regulator:	DECS 100

Electrical data: (acc. IEC)					
Efficiencies:	110%	100%	75%	50%	25%
Power factor 0.8	96,64	96,8	96,9	96,6	95,1
Power factor 0.9	97,12	97,25	97,25	96,9	95,35
Power factor 1.0	97,59	97,7	97,6	97,2	95,6

Reactances and time constants											
	unsaturated		saturated			unsaturated		saturated			
X_d	2.20	1.98	p.u.	X_q	1.10	1.08	p.u.	$T_{d0'}$	3.5 s	$T_{d0''}$	0.03419 s
X_d'	0.253	0.253	p.u.	X_q'	1.10	1.08	p.u.	T_d'	0.40 s	$T_{q0'}$	0.4 s
X_d''	0.163	0.148	p.u.	X_q''	0.163	0.163	p.u.	T_d''	0.02 s	$T_{q0''}$	0.26994 s
X_2	0.171	0.155	p.u.	X_0	0.048	0.044	p.u.	T_a	0.06 s	$T_{q1'}$	0.4 s
X_{1s}	n.a.	0.089	p.u.							$T_{q1''}$	0.04 s
Short circuit ratio saturated: 0.51					Z_n 0.039 Ohm						


Short circuit data:		
Initial short circuit current (3-phase):	I_k'	48275 A
Max. peak current (3-phase):	I_s	122888 A
Sustained short circuit current:	I_k	21434 A
Minimum 3 x rated current for max.10 s		
Initial short circuit torque:	M_{k2}	415.2 kNm
	M_{k3}	249.1 kNm
Max. faulty synchron moment:	M_f	892.7 kNm
Rated kVA torque:	M_{SN}	47.27 kNm
Rated torque	M_N	37.82 kNm
Shaft torque	M_{Sh}	39.07 kNm

Load application:	
max. load application: 3522 kVA (corresponds to 59,29 % from 5940 kVA) for Power factor 0.4 15% transient voltage drop	Power: 5940 kVA Power factor: 0.8 transient voltage drop: -20.2 %

Remarks:

Alternator :	DSG 114 M2/6		
Rated output [kVA]	5940	Rated power factor:	0.8
Rated frequency [Hz]	60	Rated speed [rpm]	1200
			Rated voltage [kV]: 0.48

Wirkungsgrad-Kennlinie - Efficiency Curve

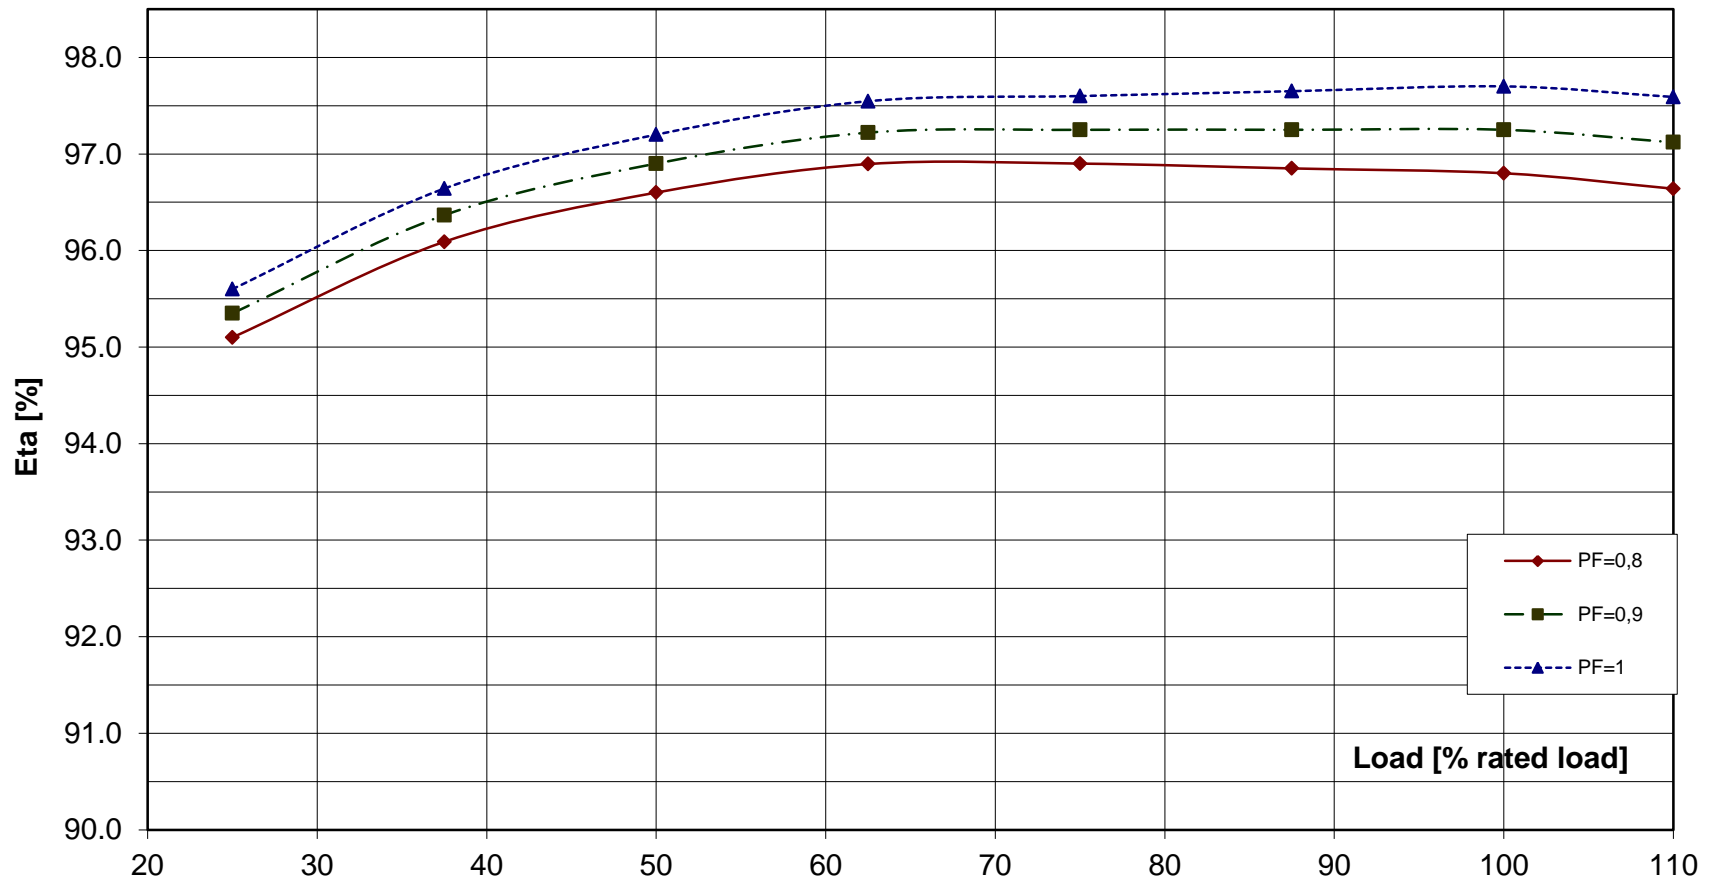

Alternator : DSG 114 M2/6

Rated output [kVA]

5940

Rated power factor:

0.8

Rated voltage [kV]: 0.48


Rated frequency [Hz]

60

Rated speed [rpm]

1200

Transient Voltage rise or drop for sudden load removal or application

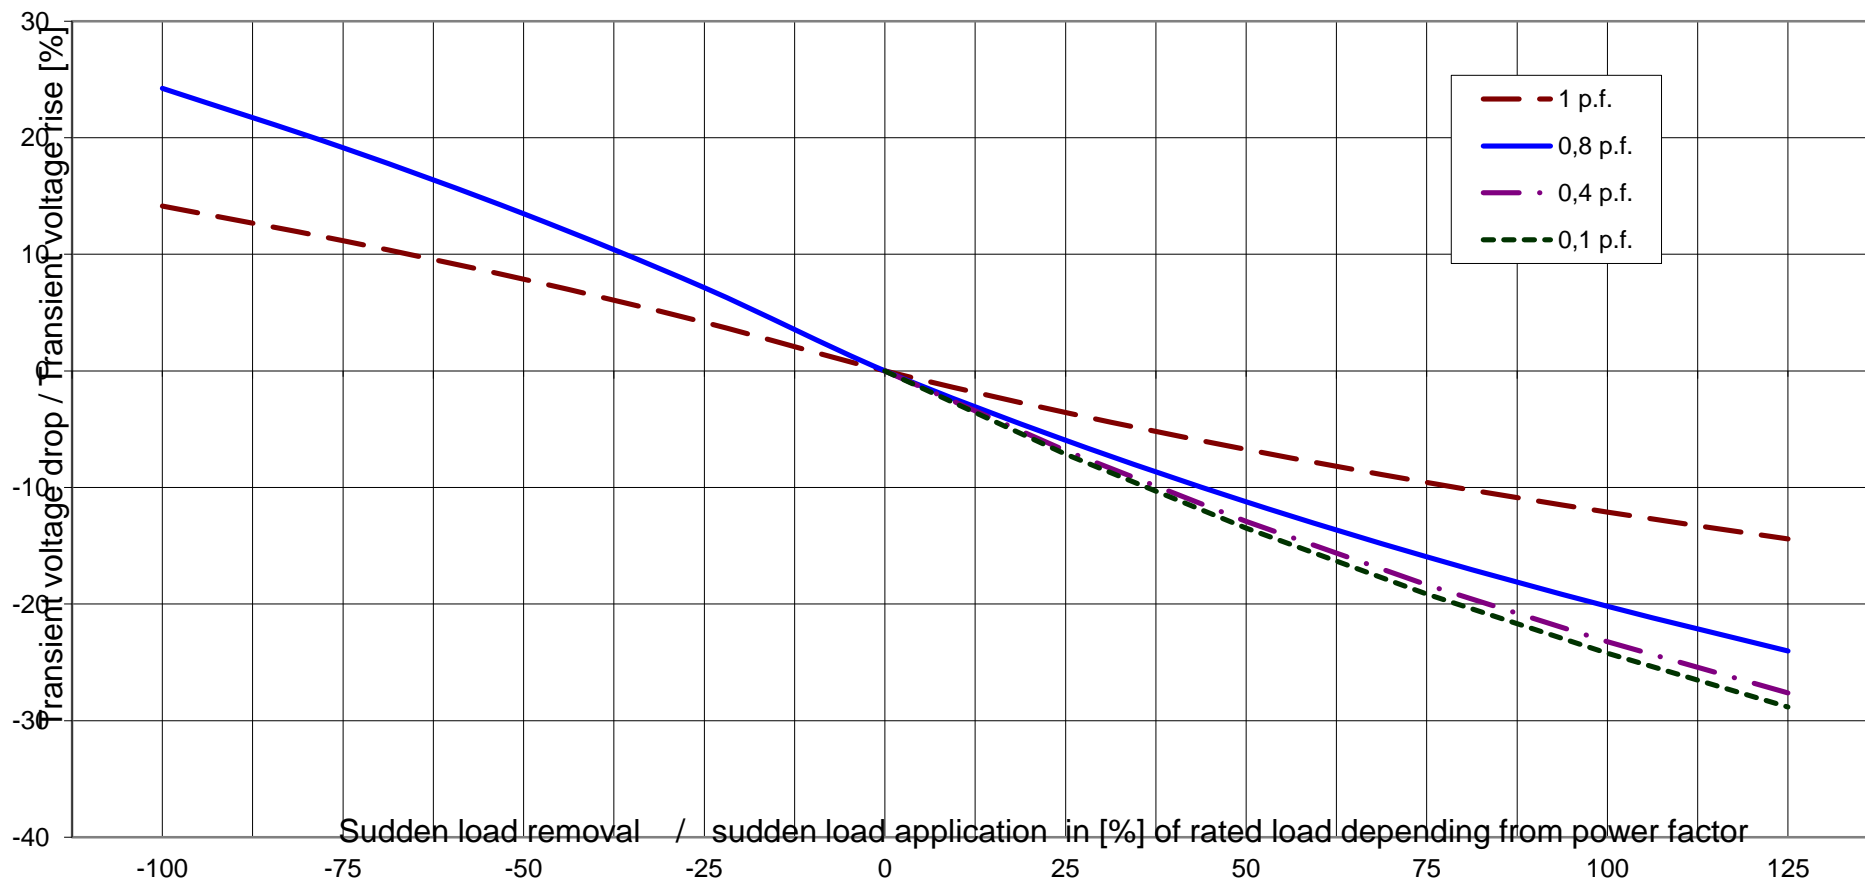




Technisches Datenblatt - Diagramme
Technical data sheet - Diagrams

ING-FCD-0112

Alternator : DSG 114 M2/6

Rated output [kVA]	5940	Rated power factor:	0.8	Rated voltage [kV]:	0.48
Rated frequency [Hz]	60	Rated speed [rpm]	1200	MSN related to kVA:	47.27 KNm

Kurzschlußmomenten-Verlauf 2-poliger KS
Short circuit torque at 2-phase SC

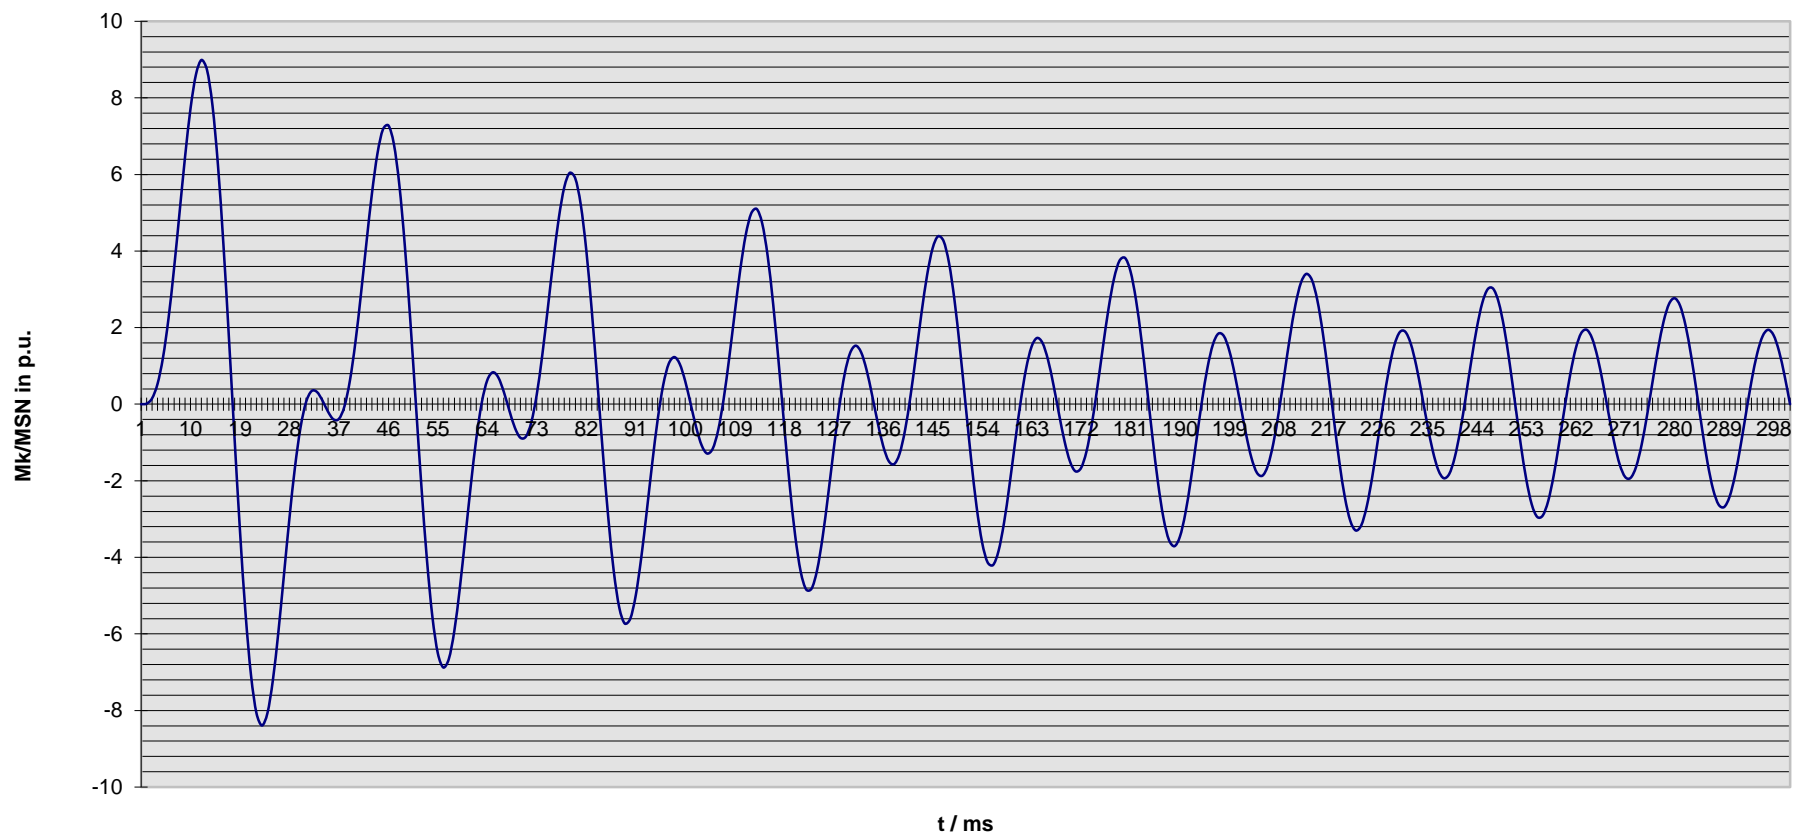

Nennwerten / nominal data

DSG 114 M2/6

Leistung S_N : **5940** kVA

$\cos \varphi$: **0.80**

Rating

p.f.

Spannung U_N : **0.48** kV

Strom I_N : **7145** A

Voltage

Current

Frequenz f : **60** Hz

Drehzahl n : **1,200** min⁻¹

Frequency


Speed

Schutzart **IP23**

Protection

Kurzschlussstrom $I_{k3\text{phasig}} / I_N$ [p.u.]
Short-circuit current $I_{k3\text{phase}} / I_N$ [p.u.]

Stosskurzschluss-Strom, 3-phasig, asymmetrisch /
Sudden short circuit current, 3-phase, asymmetrical

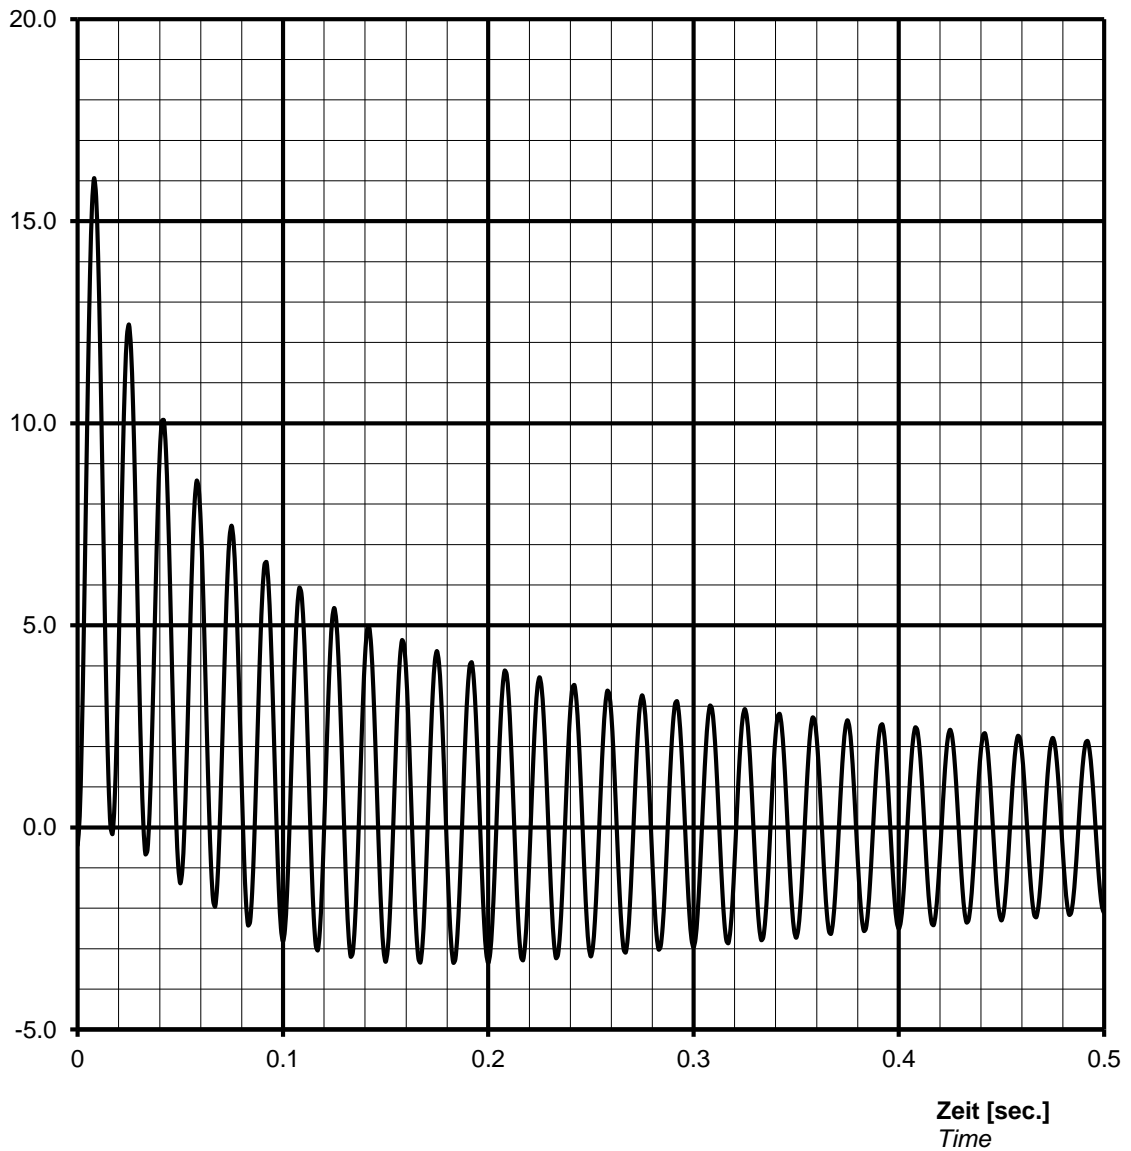

Notizen / remarks:

Maximum asymmetric peak value

$I_{\text{speak}} =$ ##### A or 16.07 p.u.


Nenndaten / nominal data

DSG 114 M2/6

Leistung S_N : **5940** kVA
Rating
 Spannung U_N : **0.48** kV
Voltage
 Frequenz f : **60** Hz
Frequency
 Schutzart **IP23**
Protection

$\cos \varphi$: **0.80**
p.f.
 Strom I_N : **7145** A
Current
 Drehzahl n : **1200** min⁻¹
Speed

Überlast Kennlinie
Overload capability

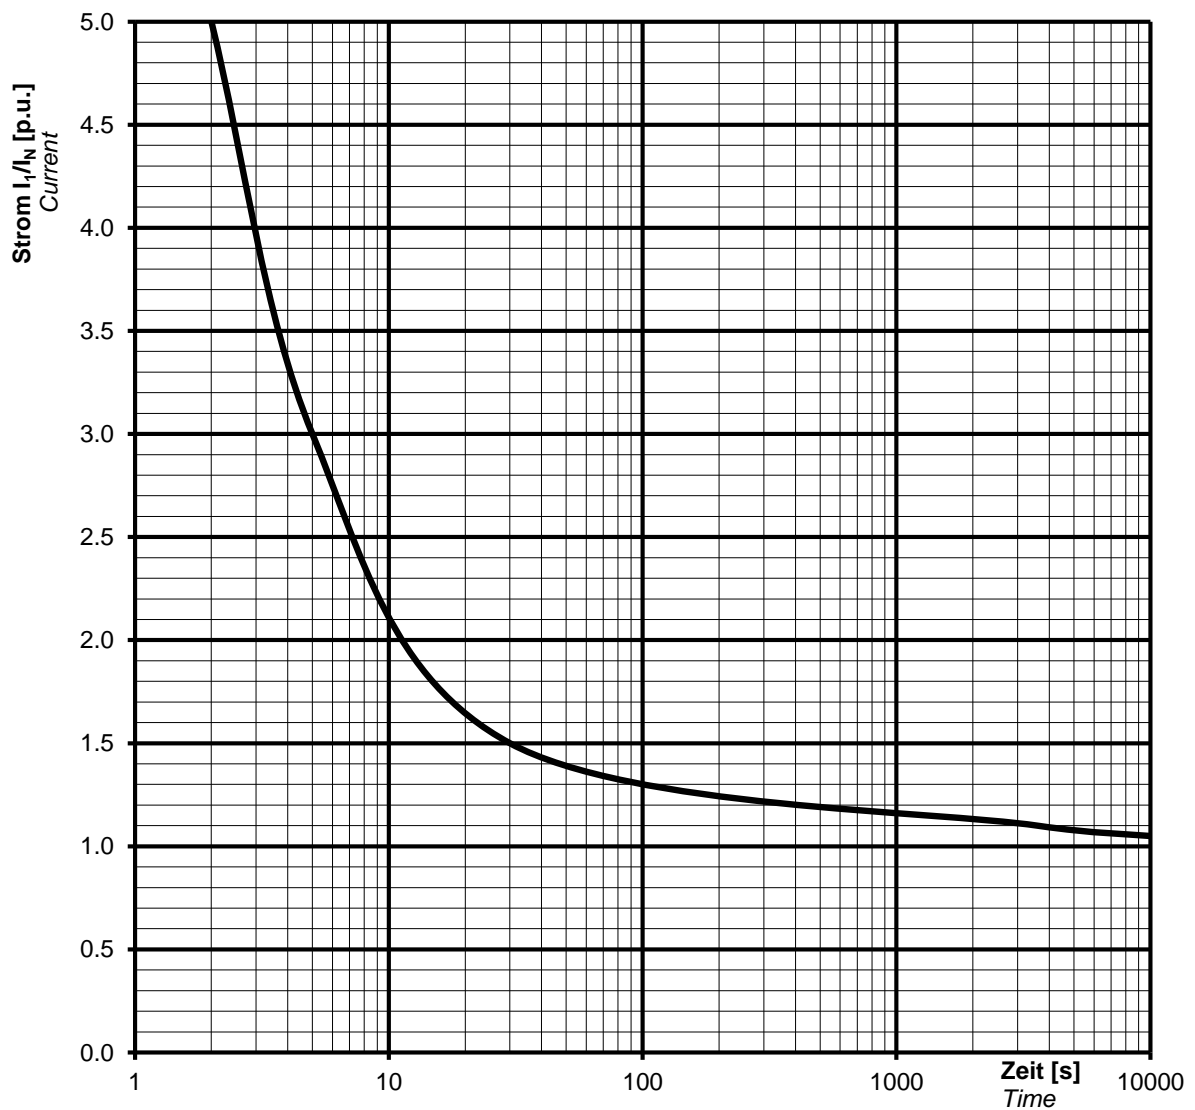

Notizen / remarks:

Strom / Zeit Kriterien: $(I / I_N)^2 \cdot t = 45s$
Current/time characteristics: 1,5 * I_N for 30 s
 1,1 * I_N for 1 h in 6h

Neendaten / nominal data

DSG 114 M2/6

Rating S_N : **5940 kVA**

Bemessungsleistung

Nominal voltage U_N : **0.48 kV**

Bemessungsspannung

Frequency f_N : **60 Hz**

Frequenz

Protection: **IP23**

Schutzart

p.f. **0.80**

Leistungsfaktor $\cos \varphi$:


Nominal current I_N : **7145 A**

Bemessungsstrom

Speed n : **1200 min⁻¹**

Drehzahl

Inverse current or unbalanced negative sequence current

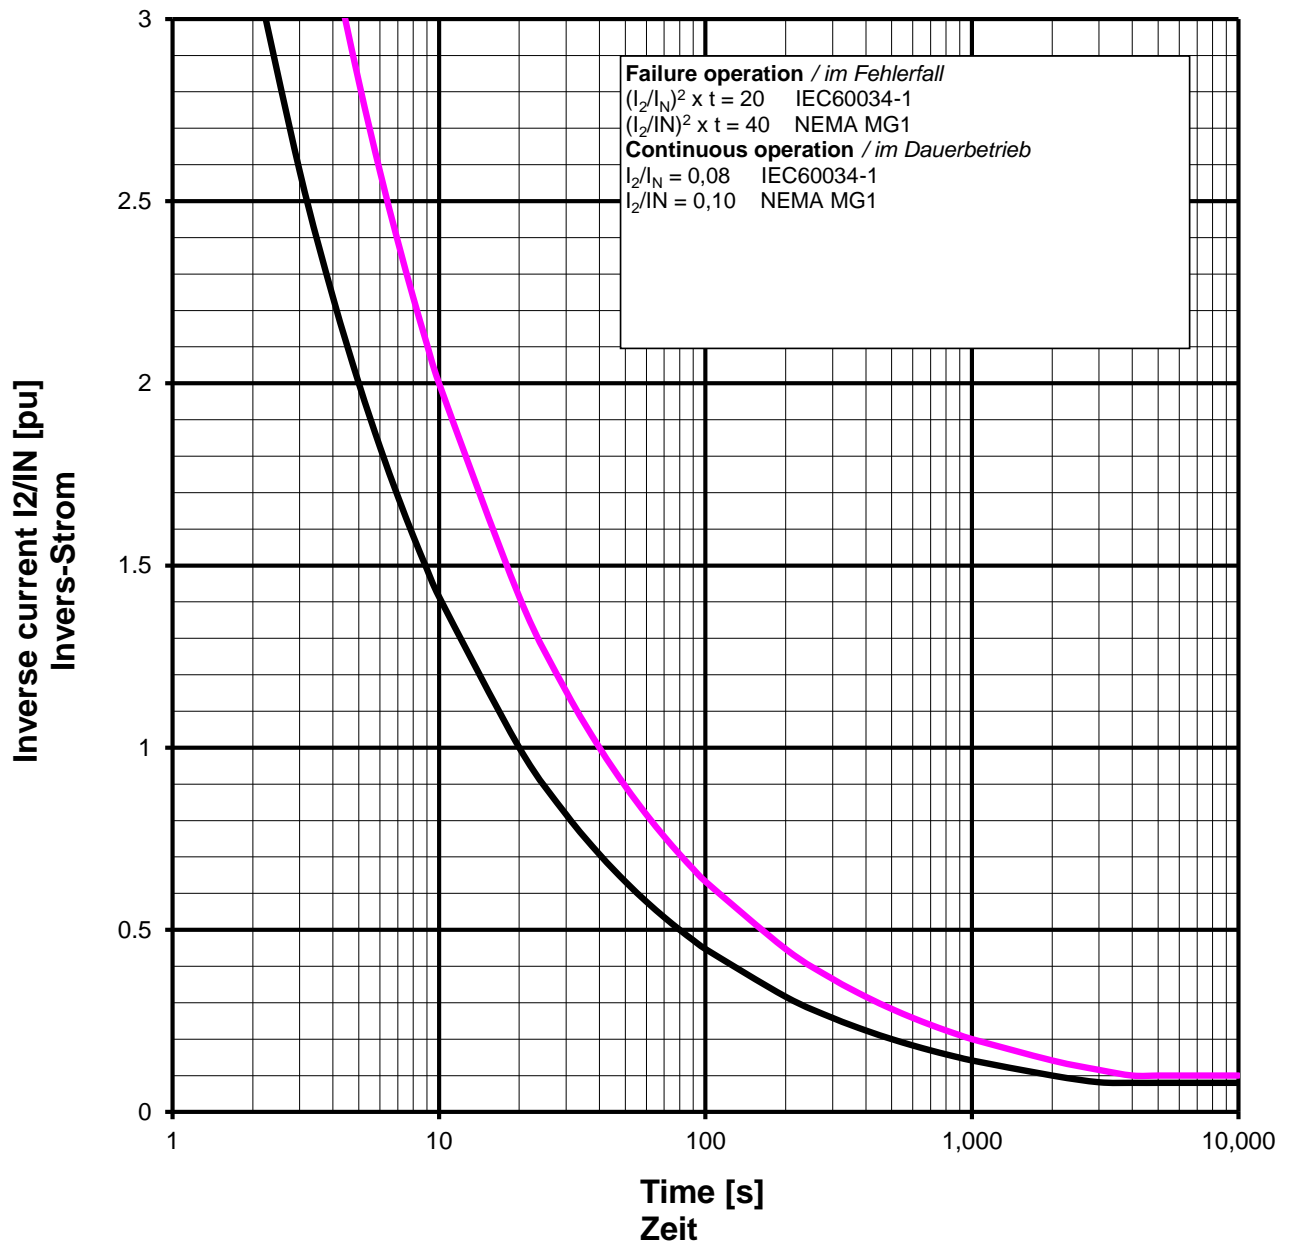

Remarks / Notizen:

All data according IEC 60034-1, NEMA MG1



Technische Daten selbstregelnden Drehstrom-Synchrongenerator
 technical data for self regulating three phase alternator

ING-FCD-0112


TYPE

DSG 114 M2/6

Projekt:

Order Nr.:

Capability (P-Q) Diagram

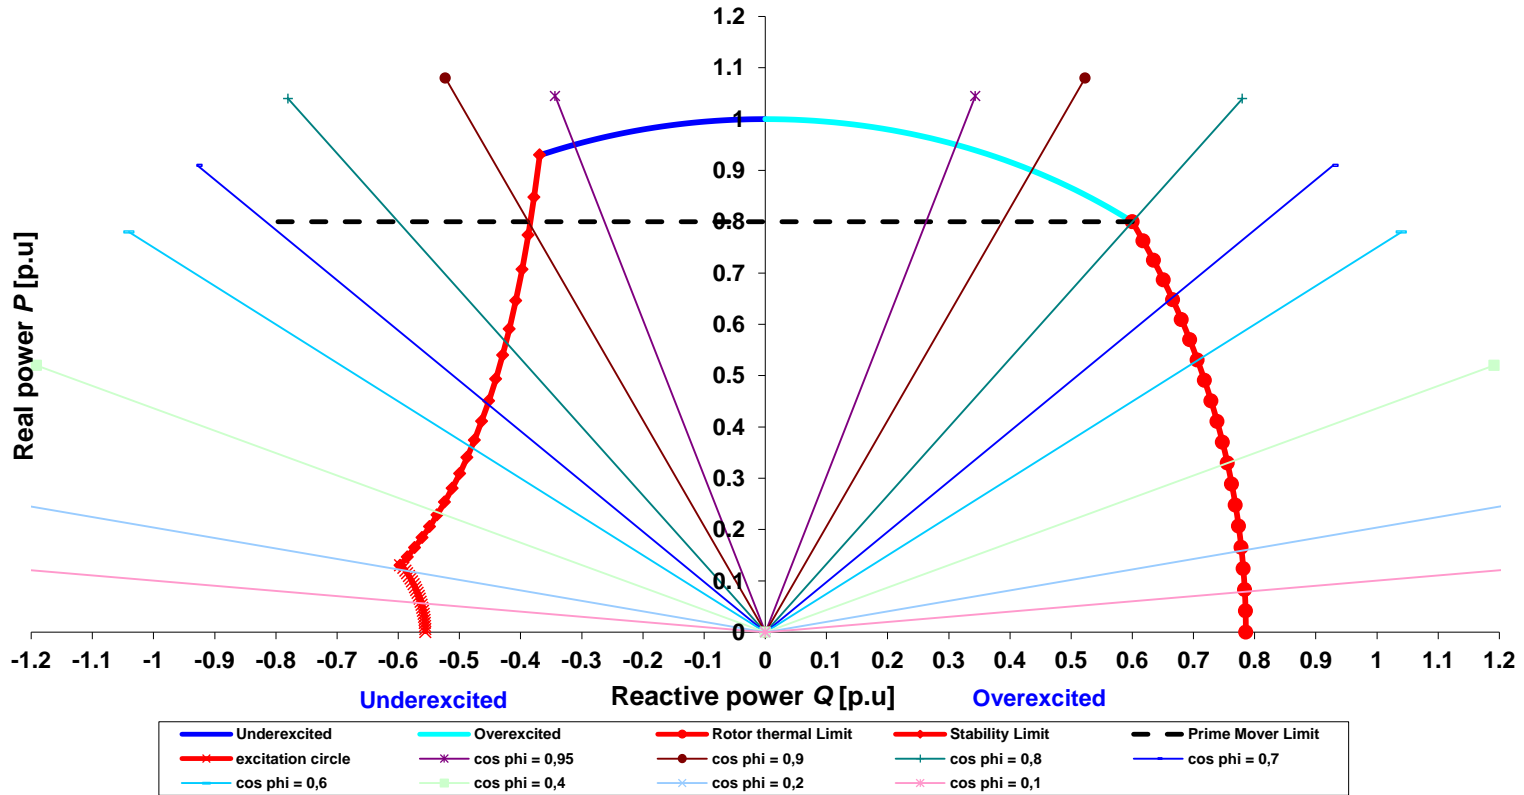

Cummins Generator Technologies

Datum / date:

03/10/2013



Technische Daten selbstregelnden Drehstrom-Synchrongenerator
 technical data for self regulating three phase alternator


ING-FCD-0112

TYPE

DSG 114 M2/6

Projekt:

Order Nr.:

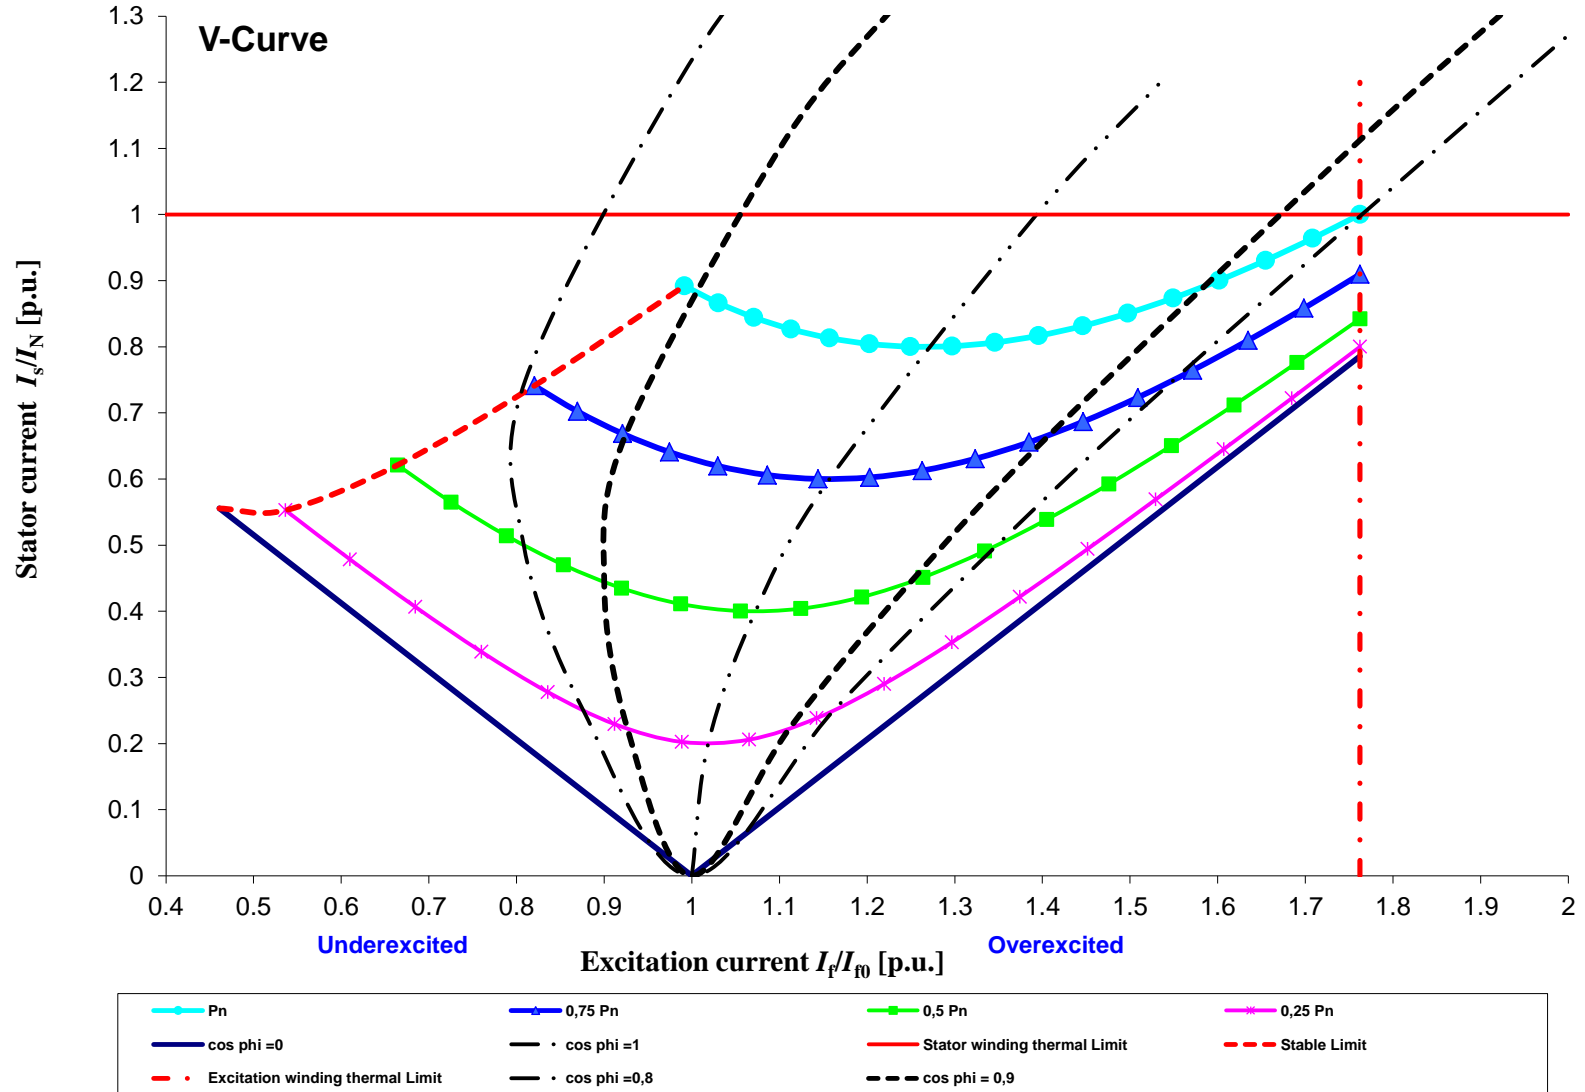

Cummins Generator Technologies

Datum / date:

03/10/2013