D66–2006	ISSUE C
FIRST W.O.	

IF IN DOUBT–ASK
DO NOT SCALE

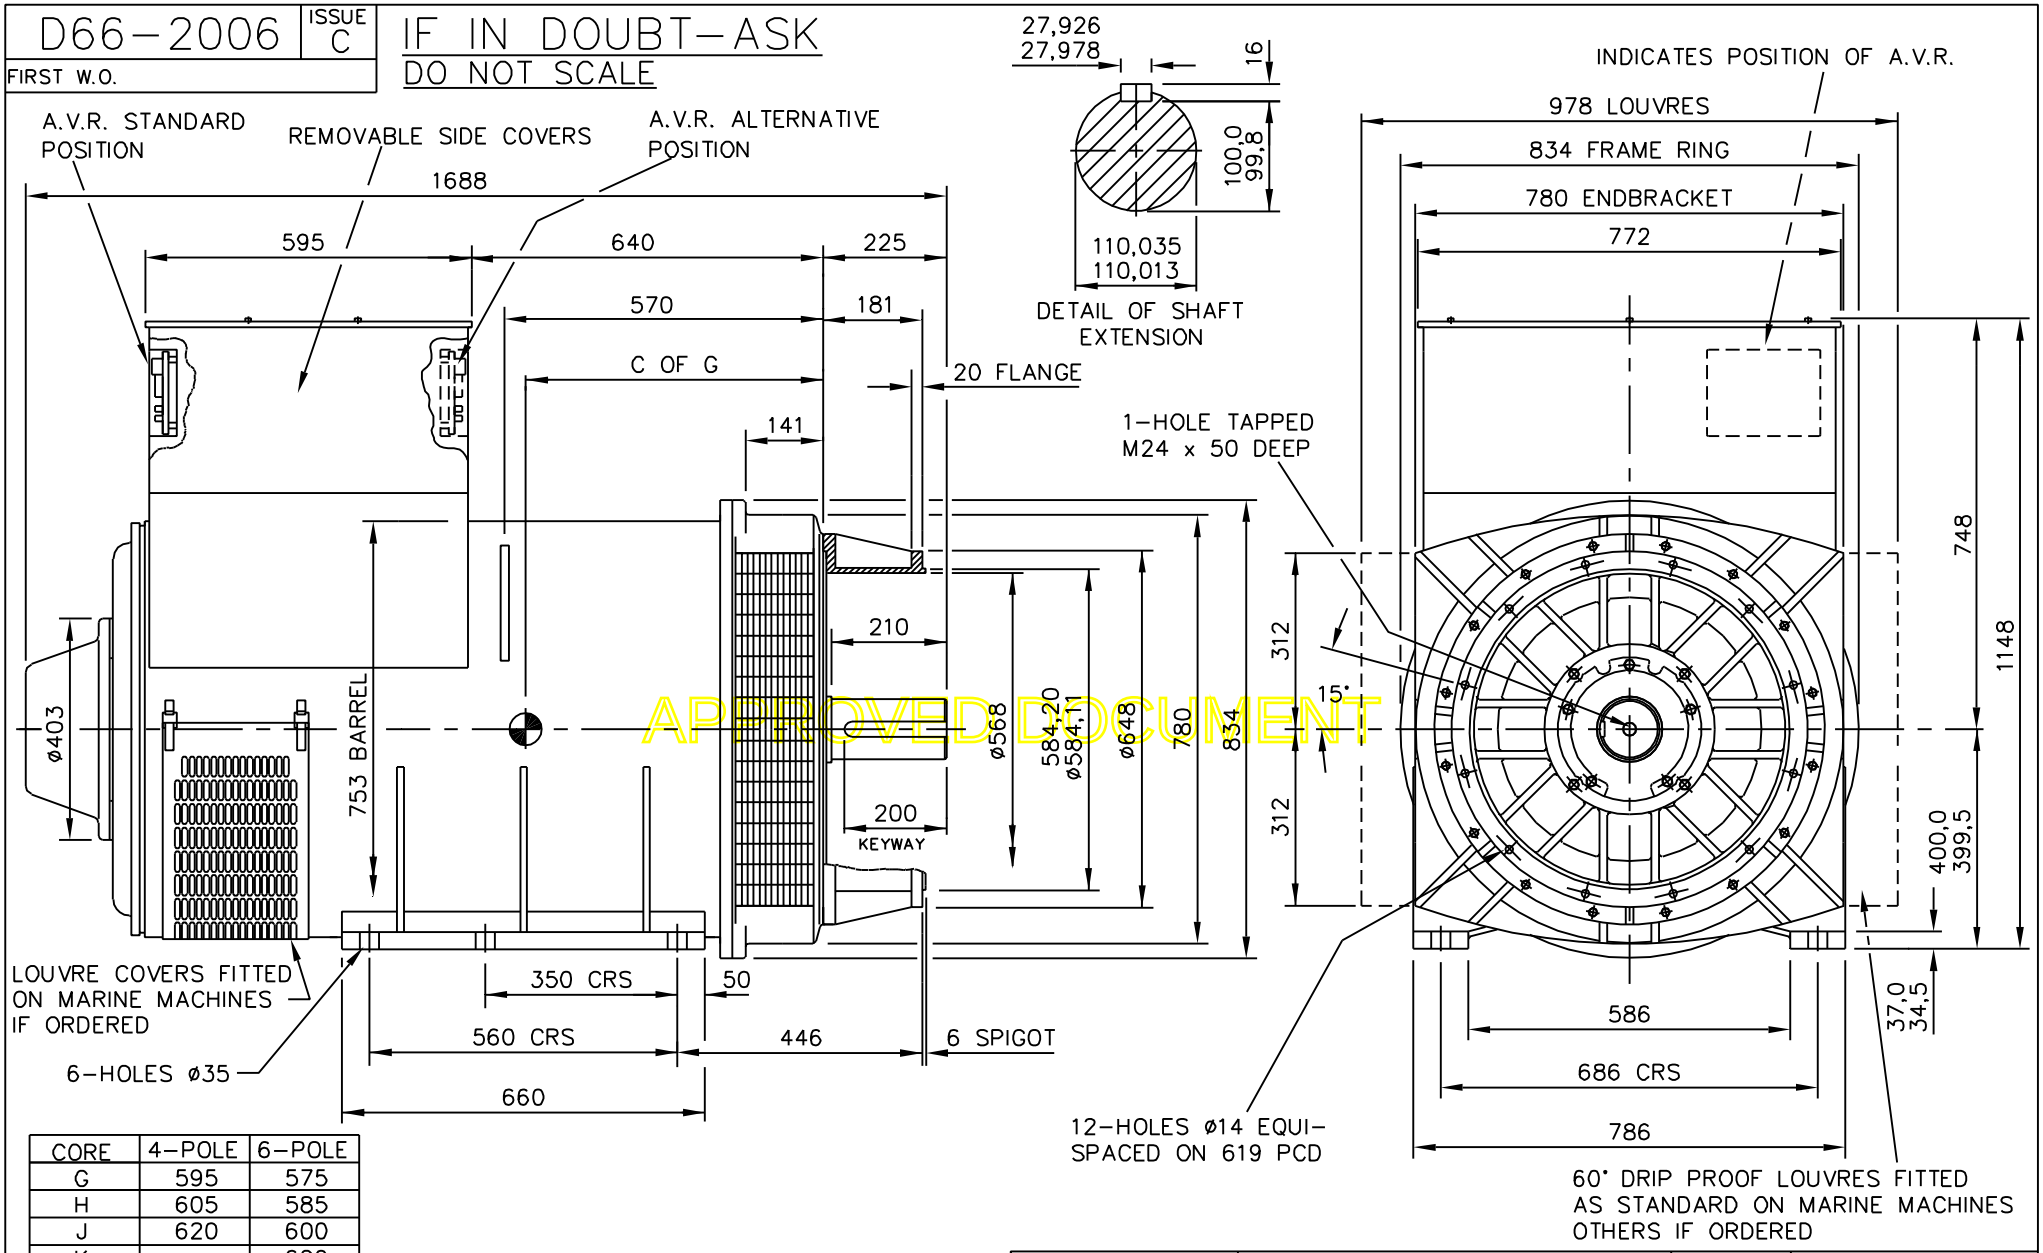

APPROVED DOCUMENT

CORE	4–POLE	6–POLE
G	595	575
H	605	585
J	620	600
K		620

NOTE; –
CUSTOMER MAY CUT CABLE ENTRY HOLES AS REQUIRED IN ANY OF THE FOUR TERMINAL BOX SIDES SUBJECT TO POSITION OF AVR, TERMINALS, ETC.

MOD'N	ISSUE	DRAWN	DATE	ALTERATION
4–8664–02	C	USD	15.09.06	CHANGE OF COMPANY NAME
4–7147–11	B	U.S.D	08.02.06	NDE LOUVRED PANEL REPLACED BY MESH COVER
4/2766/2	A	A.J.B.	12.06.00	ORIGINAL ISSUE

CERTIFIED PRINT (ONLY IF SIGNED)		
BY		
DATE		
DRAWN	A.J.B.	12.06.00
CHECKED		
APPROVED		

HC/CG6
2GHJ(4 POLE)/2GHJK(6 POLE)
ALTERNATOR
ADAPTOR – SAE 1/2

CUMMINS GENERATOR TECHNOLOGIES LTD.
STAMFORD ENGLAND

SCALE	FIRST W.O.
1:10	UNIT OF MEASUREMENT MILLIMETRES (mm)

D66–2006 ISSUE C