



## Technical Data Sheet for AvK-Alternators

FM 7.3-5

Date:	09/01/14	Customer:	GENERIC DATASHEET only
Project No.:		AvK Reference:	dig130h_4_50_10500_A048N003

### Object data:

Site:		Prime Mover:	
Application:	Stationary Power Plant	Manufacturer:	

### Generator data:

Generator:	DIG 130 h/4	Poles:	4	Standards:	IEC 60034
Rated power:	2100 kVA	1680 kWe	1750 kWm		
Power factor:	0.80				
Power at pf 1,0	1698 kVA	1698 kWe	1750 kWm		
Rated voltage:	10.5 kV				
Speed:	1500 1/min				
Frequency:	50 Hz			Voltage range / frequency range:	
Rated current:	115.5 A			Zone A according IEC 60034-1 (dU = +/-5%, df = +/-2%)	
Winding pitch:	ca. 5/6				
Insulation class:	Stator: Class F	Rotor: Class F		Temperature rise:	F
Ambient temperature:	40 ° C		Environment:	Standard environment	
Site altitude:	1000 m				
Enclosure:	IP23		Filter:		
Cooling:	IC 01 - Open-circuit ventilation				
Coolant:	Ambient Air	Temperature	40 ° C	Temperature Air inlet	40 ° C
		Coolant:		generator:	
		Cooling air vol.:	3.0 m³/s	Cooling water quantity:	n/a
Moment of inertia (I):	85 kgm²	Weight:	6300 Kg	Losses (environment):	70 KW
				Losses (cooling):	n/a

Wires:	4 terminals, starpoint connected in terminal box
Operation mode:	Single mode
Regulators:	
Voltage regulator:	DECS 100

### Electrical data: (acc. IEC)

Efficiencies:	110%	100%	75%	50%	25%
Power factor 0.8	95,8	96	96	95,5	93,3
Power factor 0.9	96,32	96,5	96,4	95,75	93,5
Power factor 1.0	96,85	97	96,8	96	93,7

### Reactances and time constants

	unsaturated	saturated		unsaturated	saturated					
$x_d$	2.30	2.07 p.u.	$x_q$	1.15	1.13 p.u.	$T_{d0'}$	2.9 s	$T_{d0''}$	0.03217 s	
$x_d'$	0.304	0.304 p.u.	$x_q'$	1.15	1.13 p.u.	$T_{d'}$	0.40 s	$T_{q0'}$	0.4 s	
$x_d''$	0.208	0.189 p.u.	$x_q''$	0.208	0.208 p.u.	$T_{d''}$	0.02 s	$T_{q0''}$	0.22115 s	
$x_2$	0.218	0.198 p.u.	$x_0$	0.063	0.057 p.u.	$T_a$	0.07 s	$T_{q'}$	0.4 s	
$x_{1s}$	n.a.	0.113 p.u.						$T_{q''}$	0.04 s	

Short circuit ratio saturated: 0.48	$Z_n$ 52.500 Ohm
-------------------------------------	------------------

### Short circuit data:

Initial short circuit current (3-phase):	$I_k''$	611 A	
Max. peak current (3-phase):	$I_s$	1555 A	
Sustained short circuit current:	$I_k$	346 A	Minimum 3 x rated current for max.10 s
Initial short circuit torque:	$M_{k2}$	92.0 kNm	
	$M_{k3}$	55.2 kNm	
Max. faulty synchron moment:	$M_f$	197.8 kNm	
Rated kVA torque:	$M_{SN}$	13.37 kNm	
Rated torque	$M_N$	10.70 kNm	
Shaft torque	$M_{Sh}$	11.15 kNm	


### Load application:

max. load application: 1036 kVA (corresponds to 49,34 % from 2100 kVA) for Power factor 0.4 15% transient voltage drop	Power: 2100 kVA Power factor: 0.8 transient voltage drop: -23.3 %
---	---

### Remarks:

<b>Alternator :</b>	<b>DIG 130 h/4</b>			
Rated output [kVA]	2100	Rated power factor:	0.8	Rated voltage [kV]: 10.5
Rated frequency [Hz]	50	Rated speed [rpm]	1500	


### Wirkungsgrad-Kennlinie - Efficiency Curve

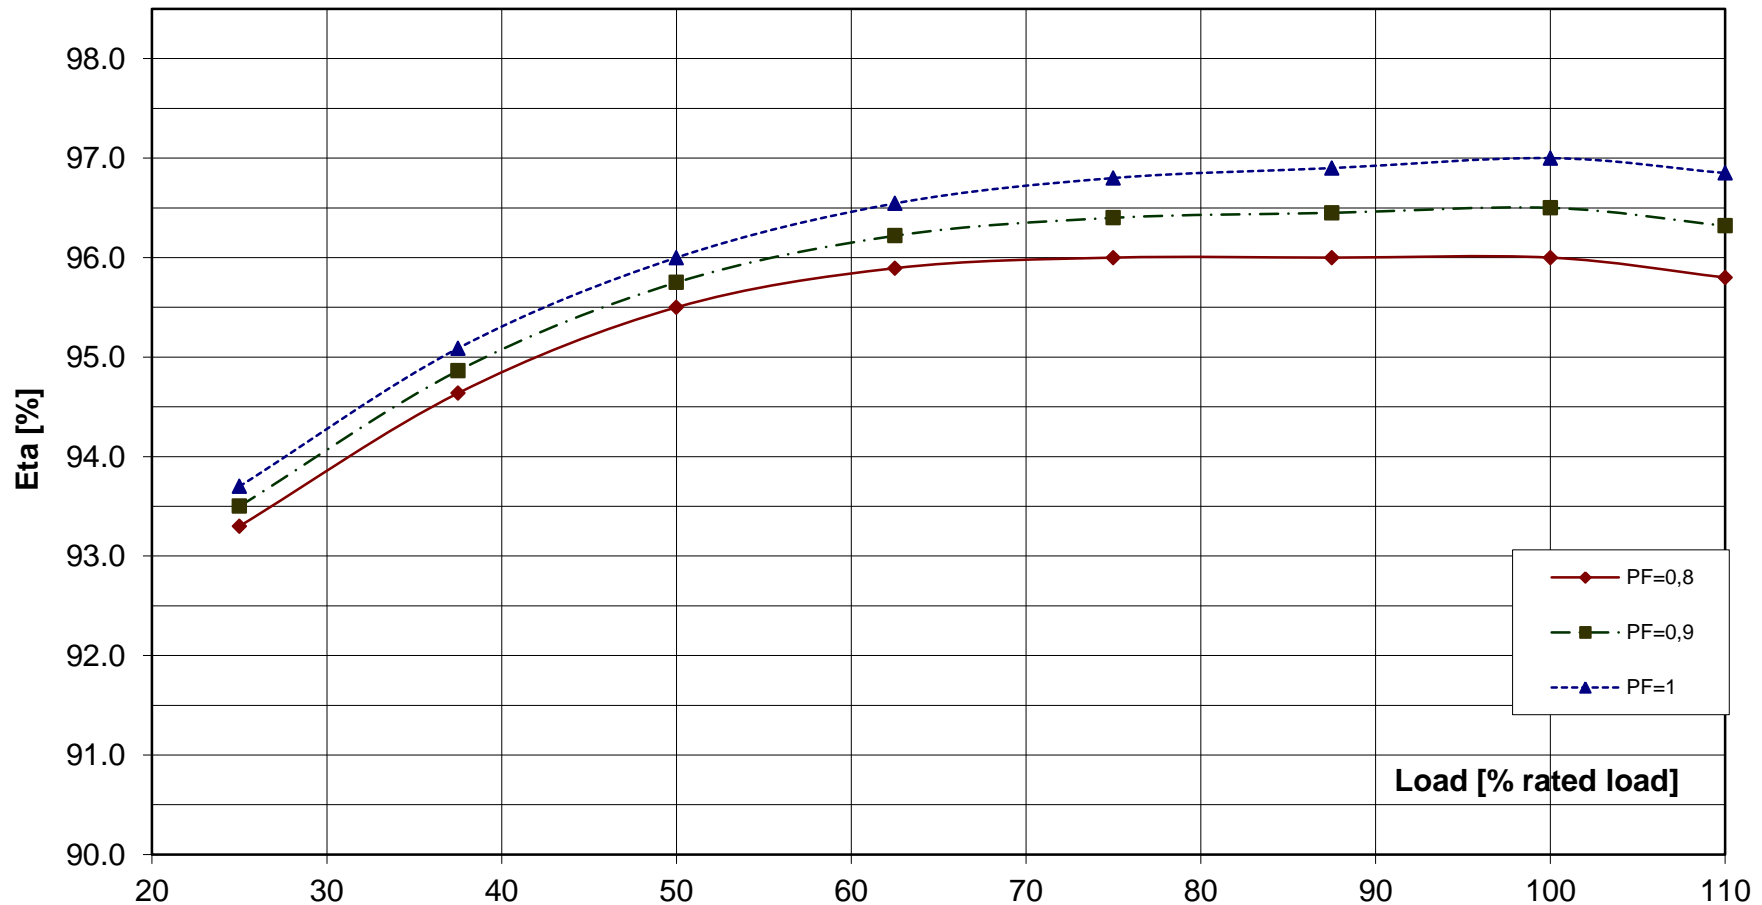

**Alternator : DIG 130 h/4**

Rated output [kVA]	2100	Rated power factor:	0.8	Rated voltage [kV]:	10.5
Rated frequency [Hz]	50	Rated speed [rpm]	1500		

**Transient Voltage rise or drop for sudden load removal or application**

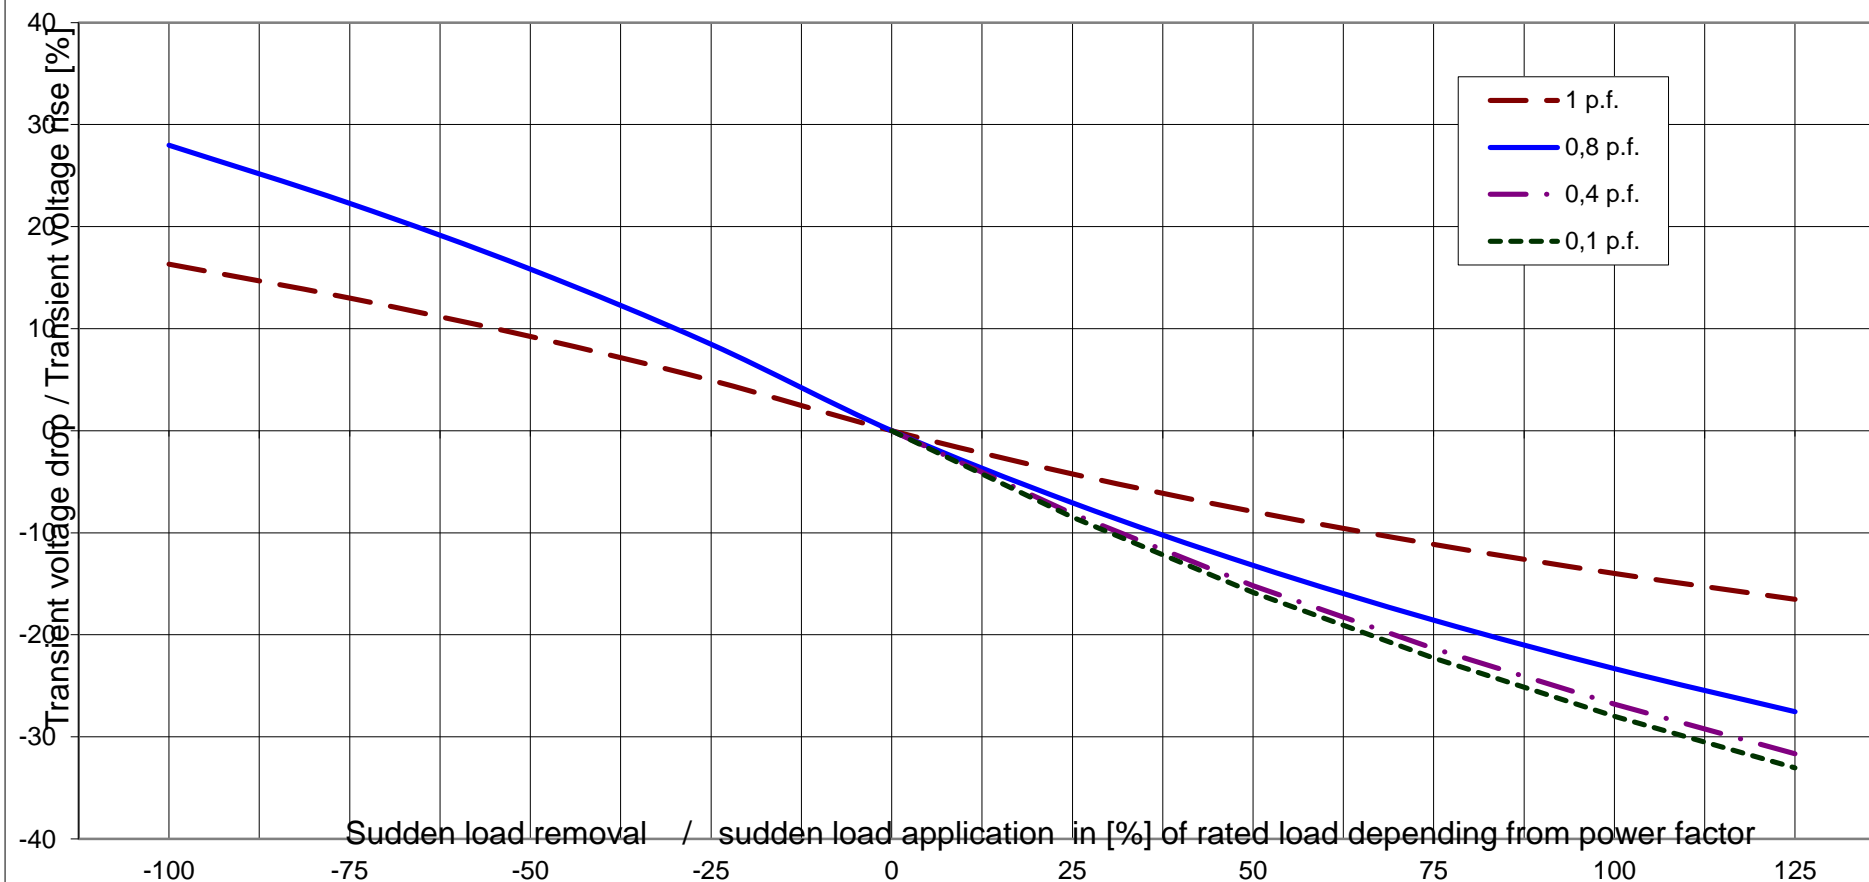




Technisches Datenblatt - Diagramme  
Technical data sheet - Diagrams

ING-FCD-0112

Alternator : **DIG 130 h/4**

Rated output [kVA]	2100	Rated power factor:	0.8	Rated voltage [kV]:	10.5
Rated frequency [Hz]	50	Rated speed [rpm]	1500	MSN related to kVA:	13.37 KNm

Kurzschlußmomenten-Verlauf 2-poliger KS  
Short circuit torque at 2-phase SC

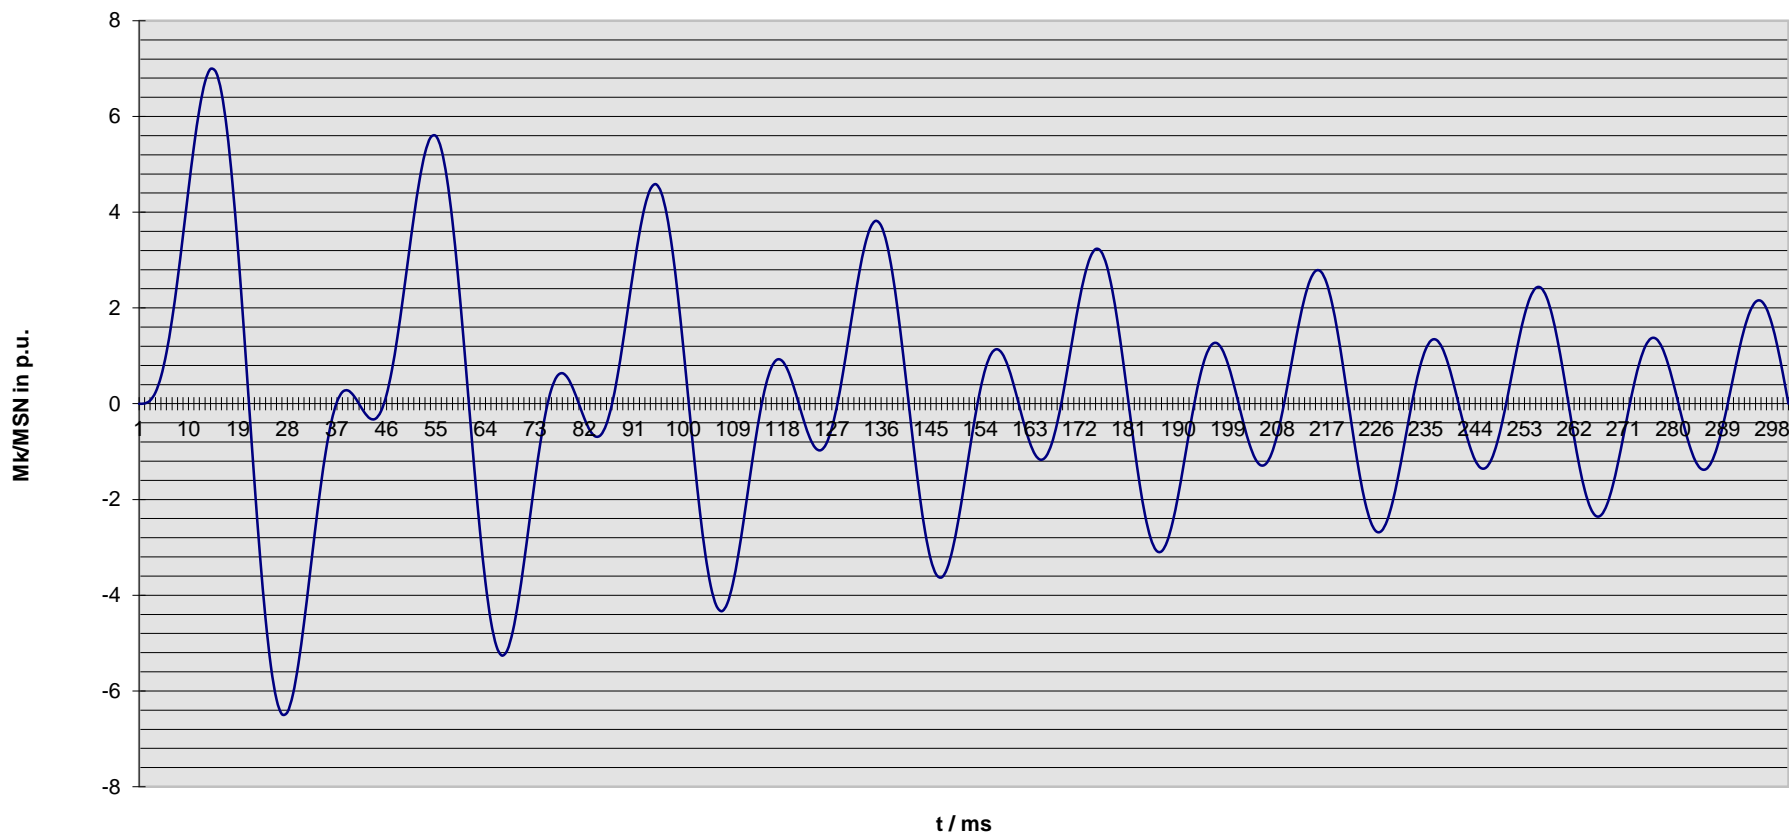

**Nenndaten / nominal data**

**DIG 130 h/4**

Leistung  $S_N$ : **2100 kVA**

$\cos \varphi$ : **0.80**

*Rating*

*p.f.*

Spannung  $U_N$ : **10.50 kV**

Strom  $I_N$ : **115 A**

*Voltage*

*Current*

Frequenz  $f$ : **50 Hz**

Drehzahl  $n$ : **1,500 min<sup>-1</sup>**

*Frequency*


*Speed*

Schutzart **IP23**

*Protection*

**Kurzschlussstrom  $I_{k3\text{phasig}} / I_N$  [p.u.]**  
**Short-circuit current  $I_{k3\text{phase}} / I_N$  [p.u.]**

**Stosskurzschluss-Strom, 3-phasig, asymmetrisch /**  
*Sudden short circuit current, 3-phase, asymmetrical*

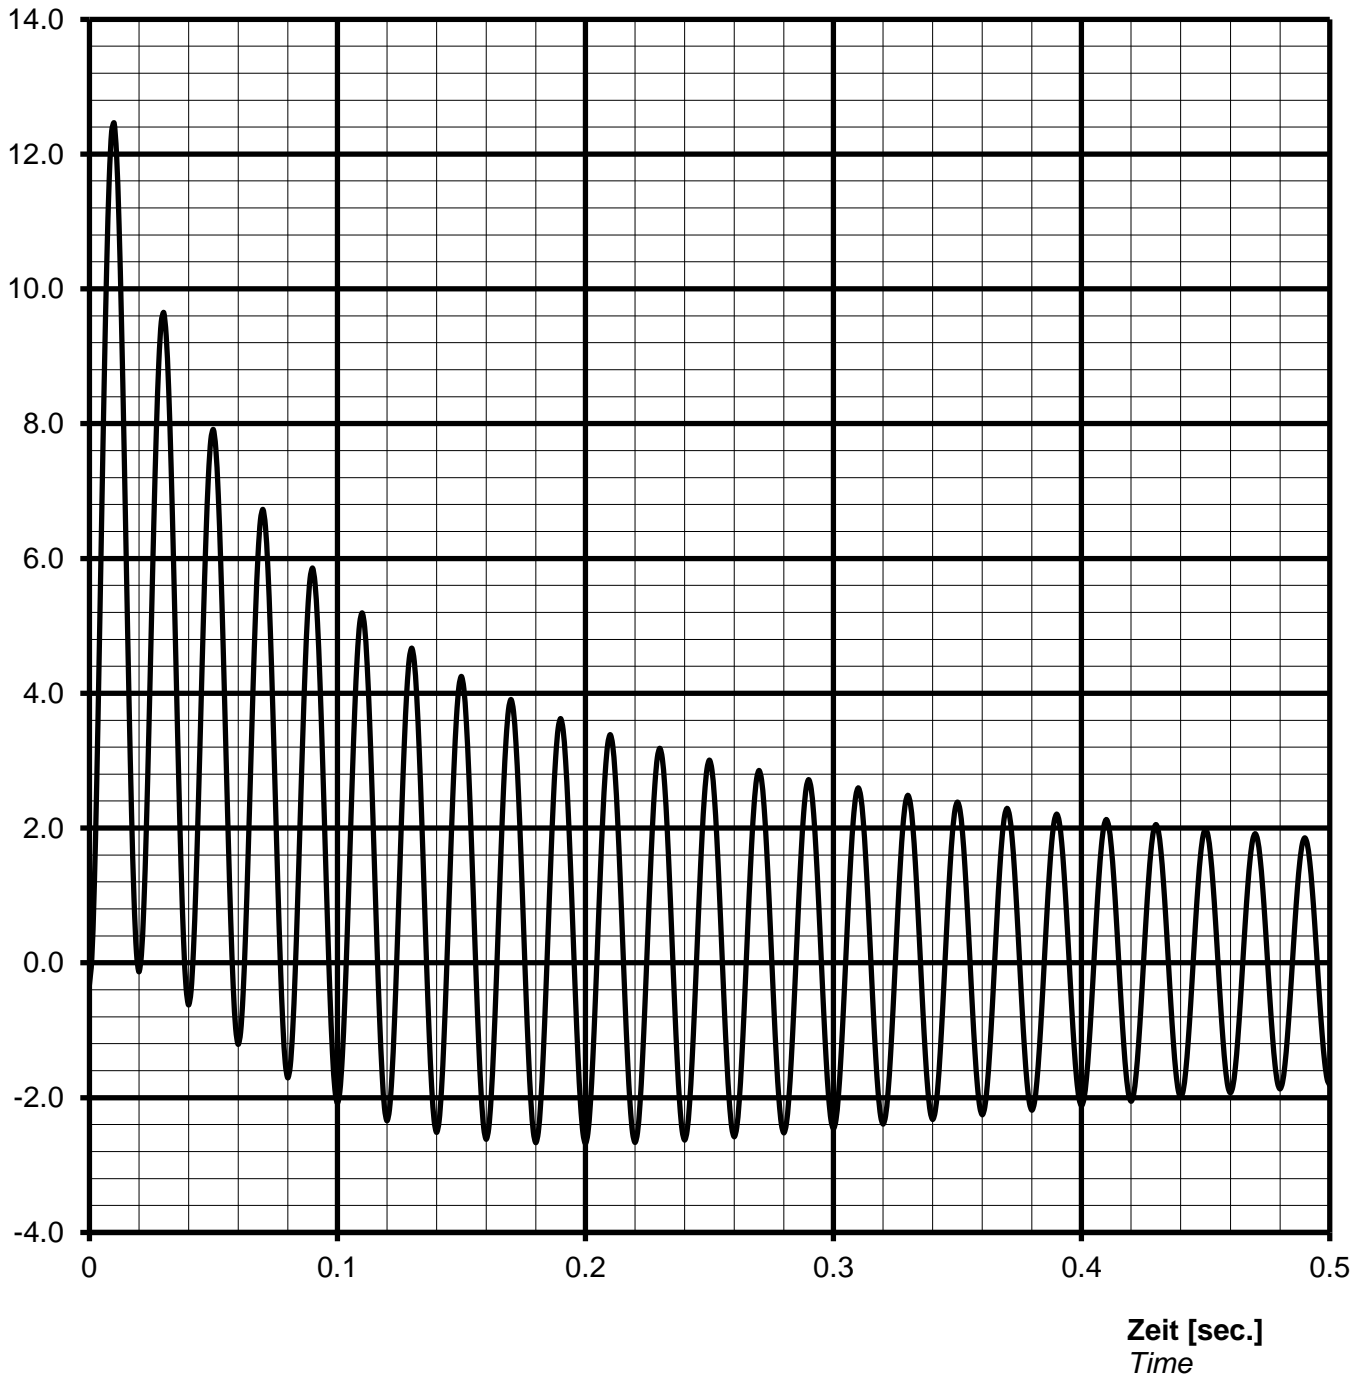

**Notizen / remarks:**

**Maximum asymmetric peak value**  $I_{\text{peak}} =$  **1439 A** or **12.46 p.u.**

#### Nennwerten / nominal data

DIG 130 h/4

Leistung  $S_N$ : **2100 kVA**

$\cos \varphi$ : **0.80**

Rating

p.f.

Spannung  $U_N$ : **10.50 kV**

Strom  $I_N$ : **115 A**

Voltage

Current

Frequenz f: **50 Hz**

Drehzahl n: **1500 min<sup>-1</sup>**


Frequency

Speed

Schutzart **IP23**

Protection

#### Überlast Kennlinie Overload capability

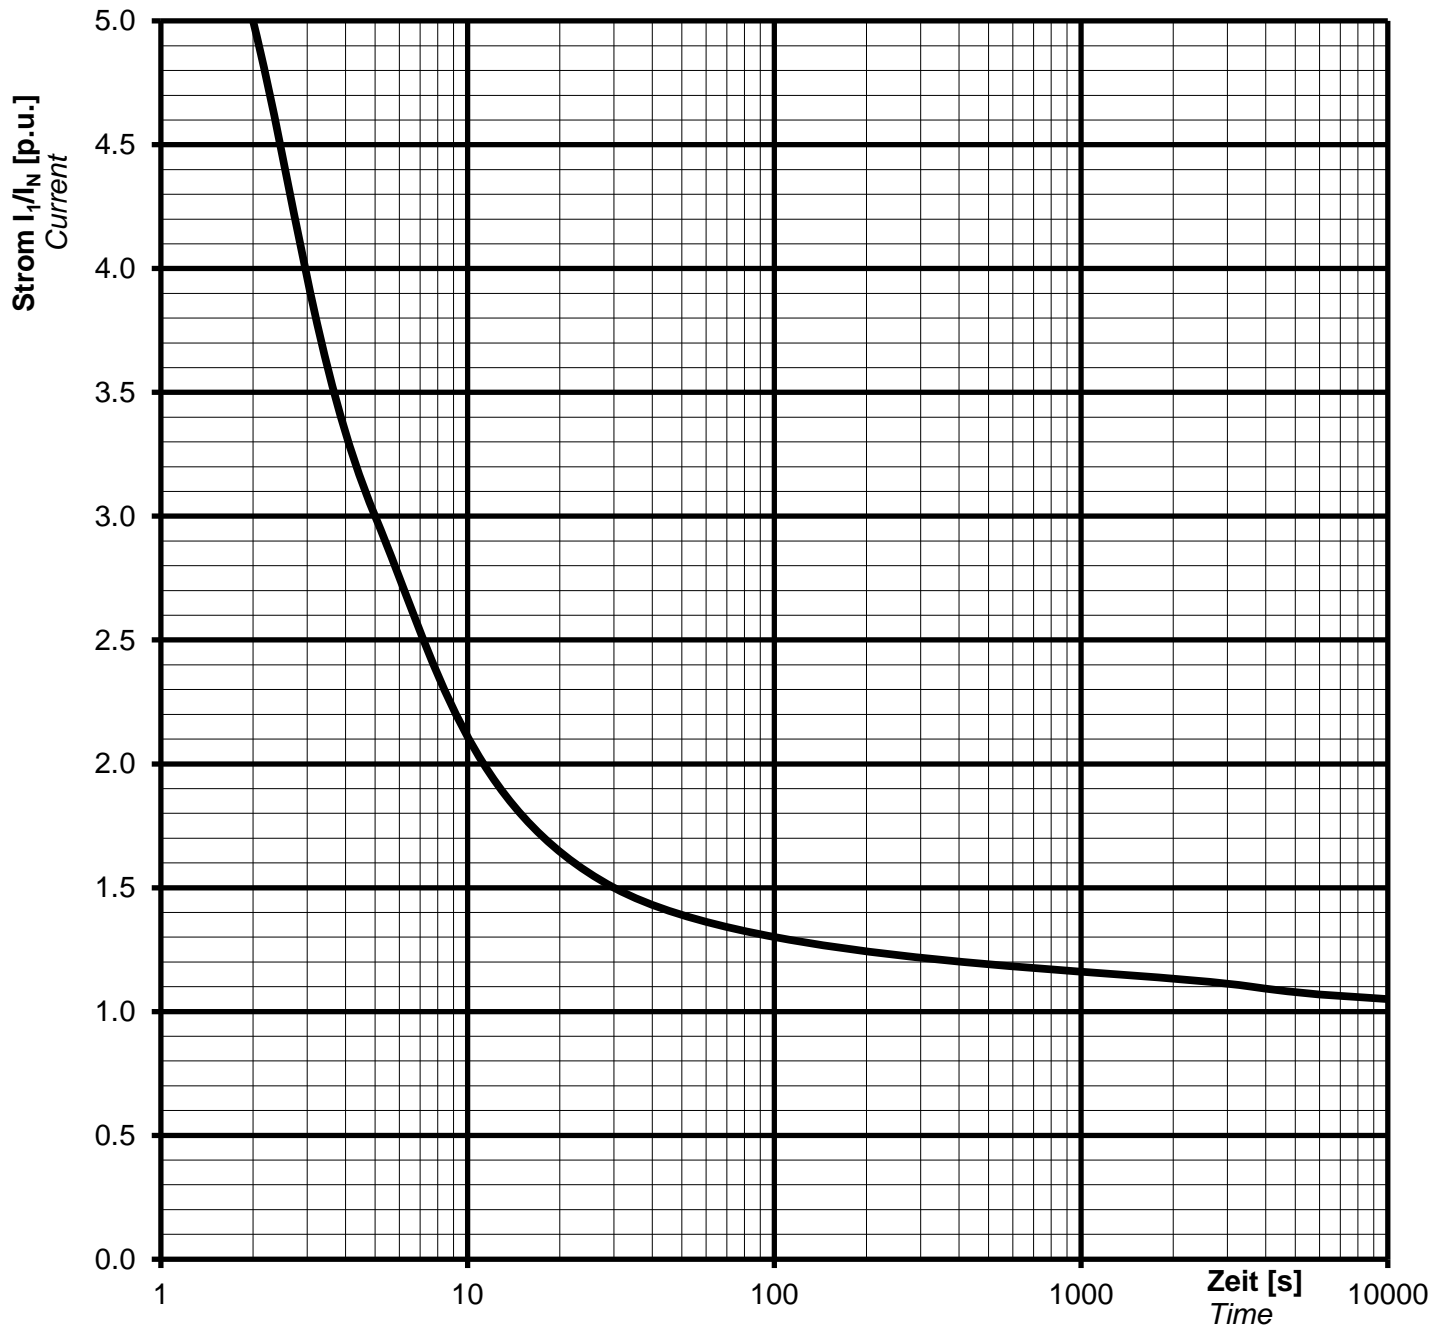

#### Notizen / remarks:

Strom / Zeit Kriterien:

$$(I / I_N)^2 \cdot t = 45s$$

Current/time characteristics:

$$1,5 \cdot I_N \text{ for } 30 \text{ s}$$

$$1,1 \cdot I_N \text{ for } 1 \text{ h in } 6 \text{ h}$$

**Nenndaten / nominal data**

**DIG 130 h/4**

Rating  $S_N$ : **2100 kVA**

*p.f.* **0.80**

*Bemessungsleistung*

Leistungsfaktor  $\cos \varphi$ :

Nominal voltage  $U_N$ : **10.50 kV**

Nominal current  $I_N$ : **115 A**

*Bemessungsspannung*

*Bemessungsstrom*

Frequency  $f_N$ : **50 Hz**

Speed  $n$ : **1500 min<sup>-1</sup>**


*Frequenz*

*Drehzahl*

Protection: **IP23**

*Schutzart*

**Inverse current or unbalanced negative sequence current**

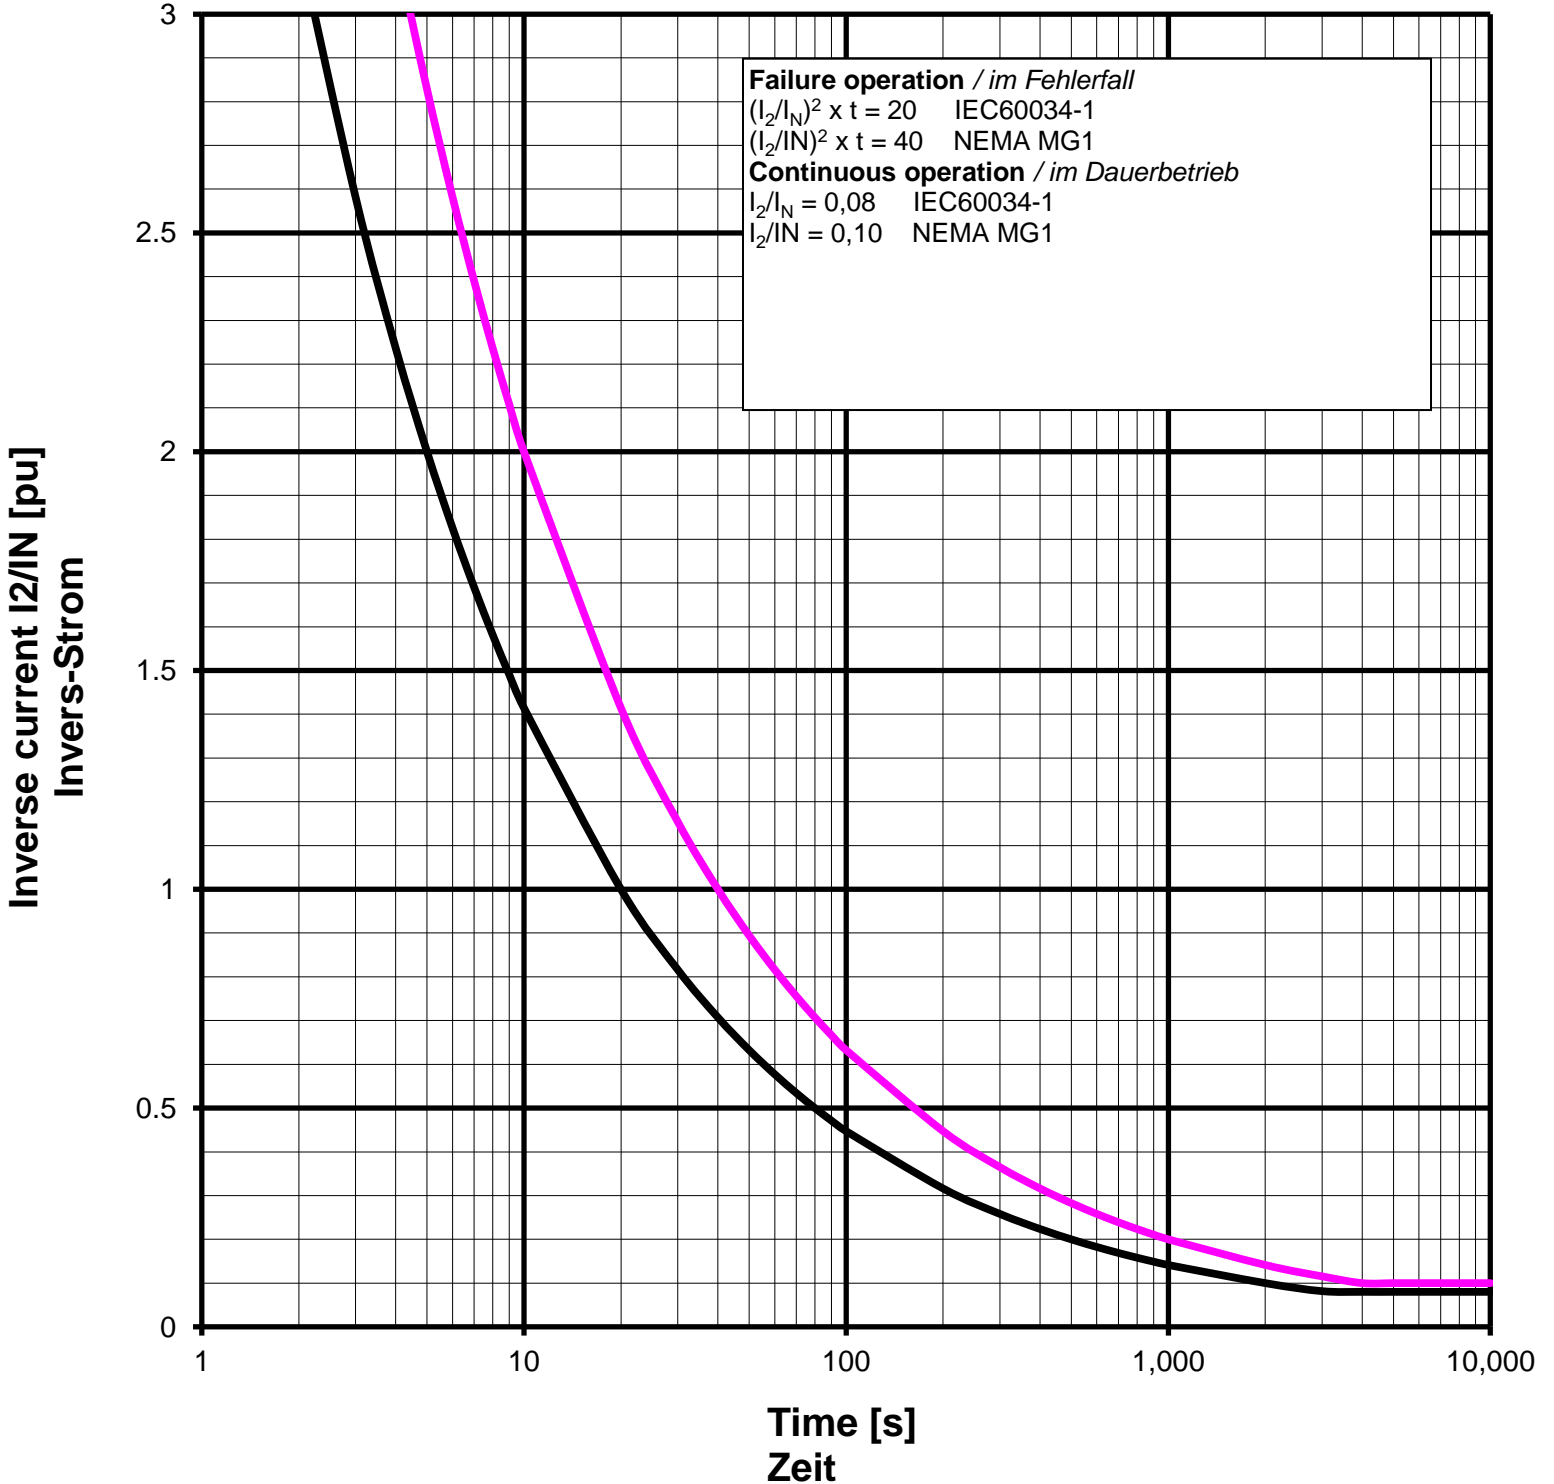

Remarks / Notizen:



Technische Daten selbstregelnden Drehstrom-Synchrongenerator  
technical data for self regulating three phase alternator

ING-FCD-0112


TYPE

DIG 130 h/4

Projekt:

Order Nr.:

### Capability (P-Q) Diagram

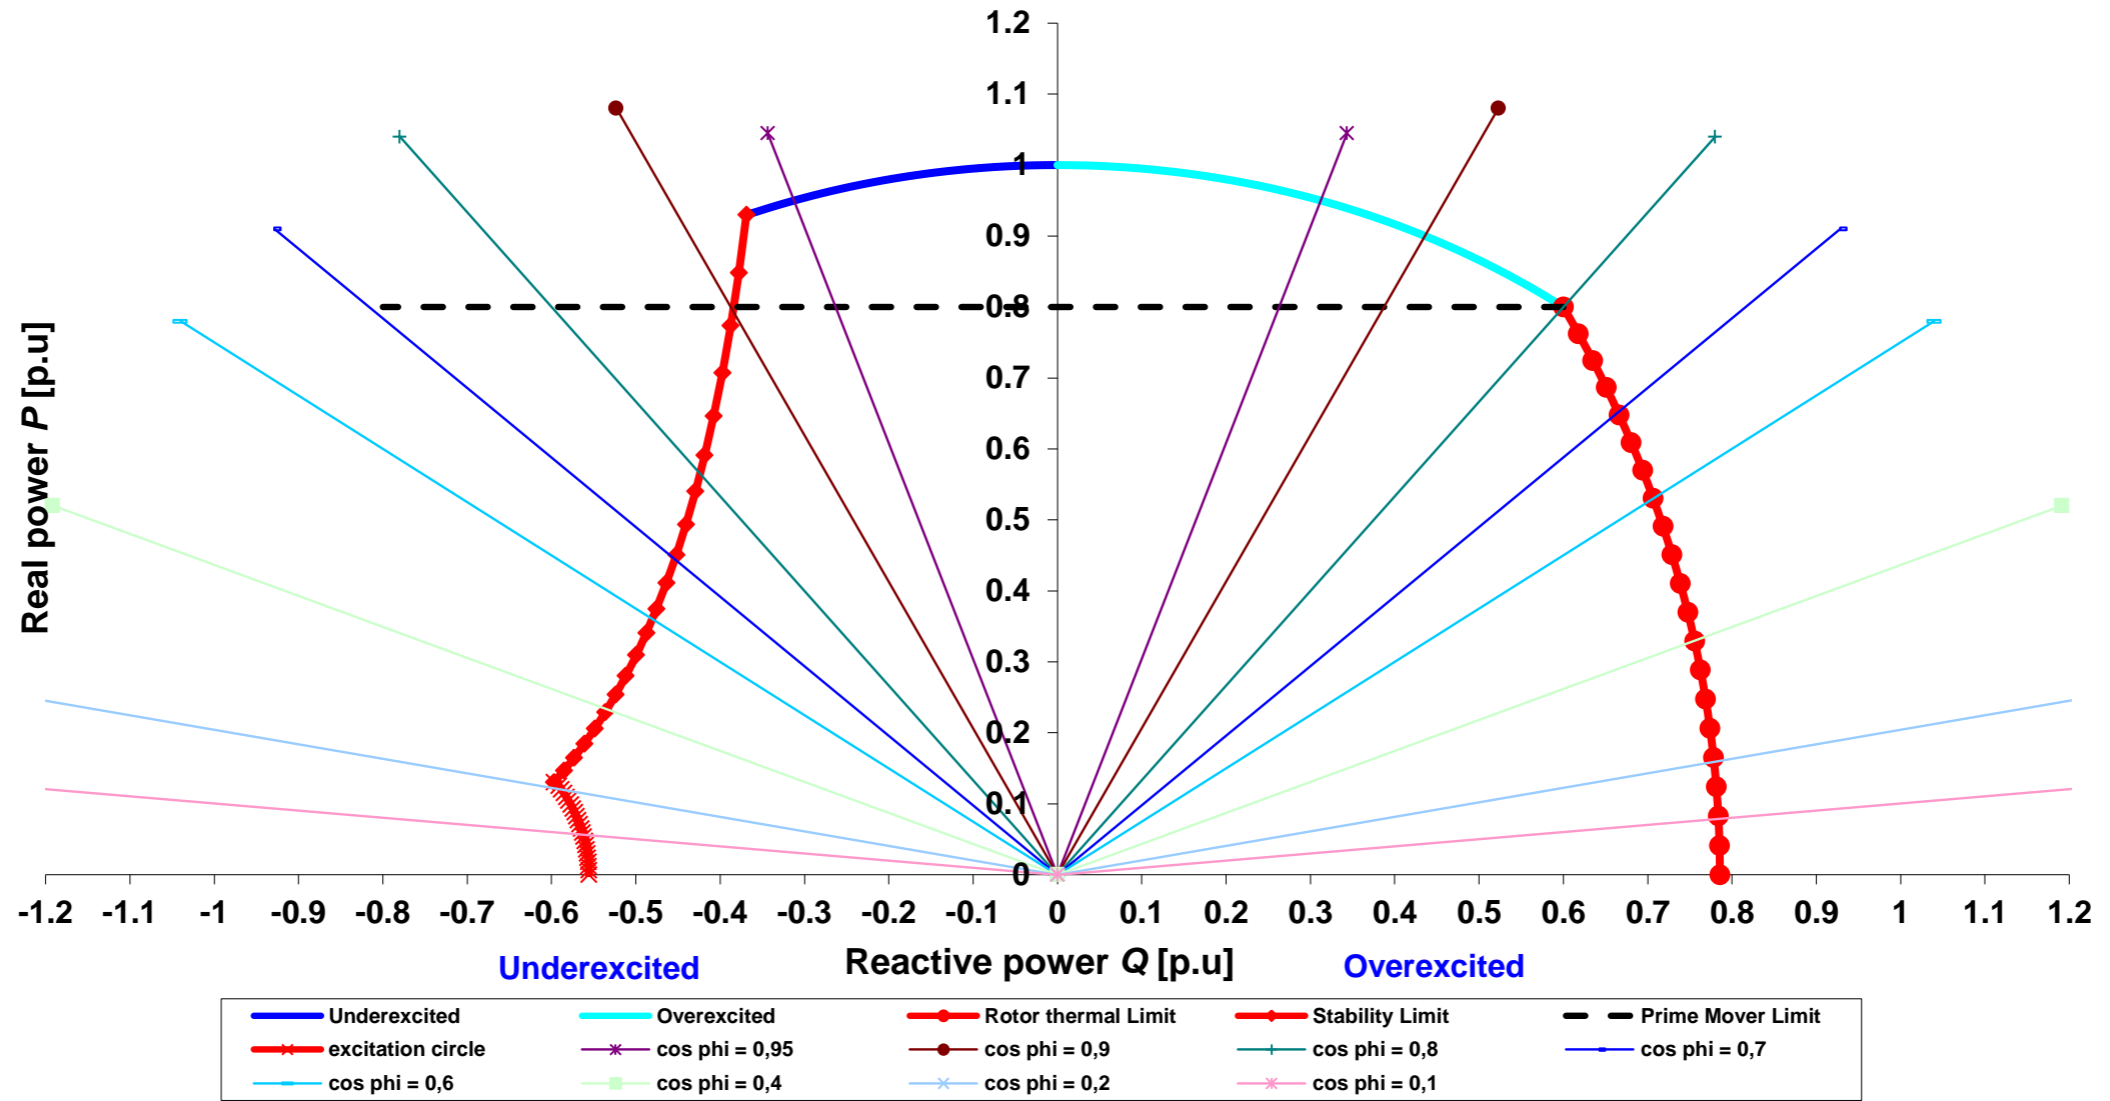


Cummins Generator Technologies

Datum / date:

21/01/2014



TYPE	DIG 130 h/4	Projekt:		Order Nr.:	
------	-------------	----------	--	------------	--

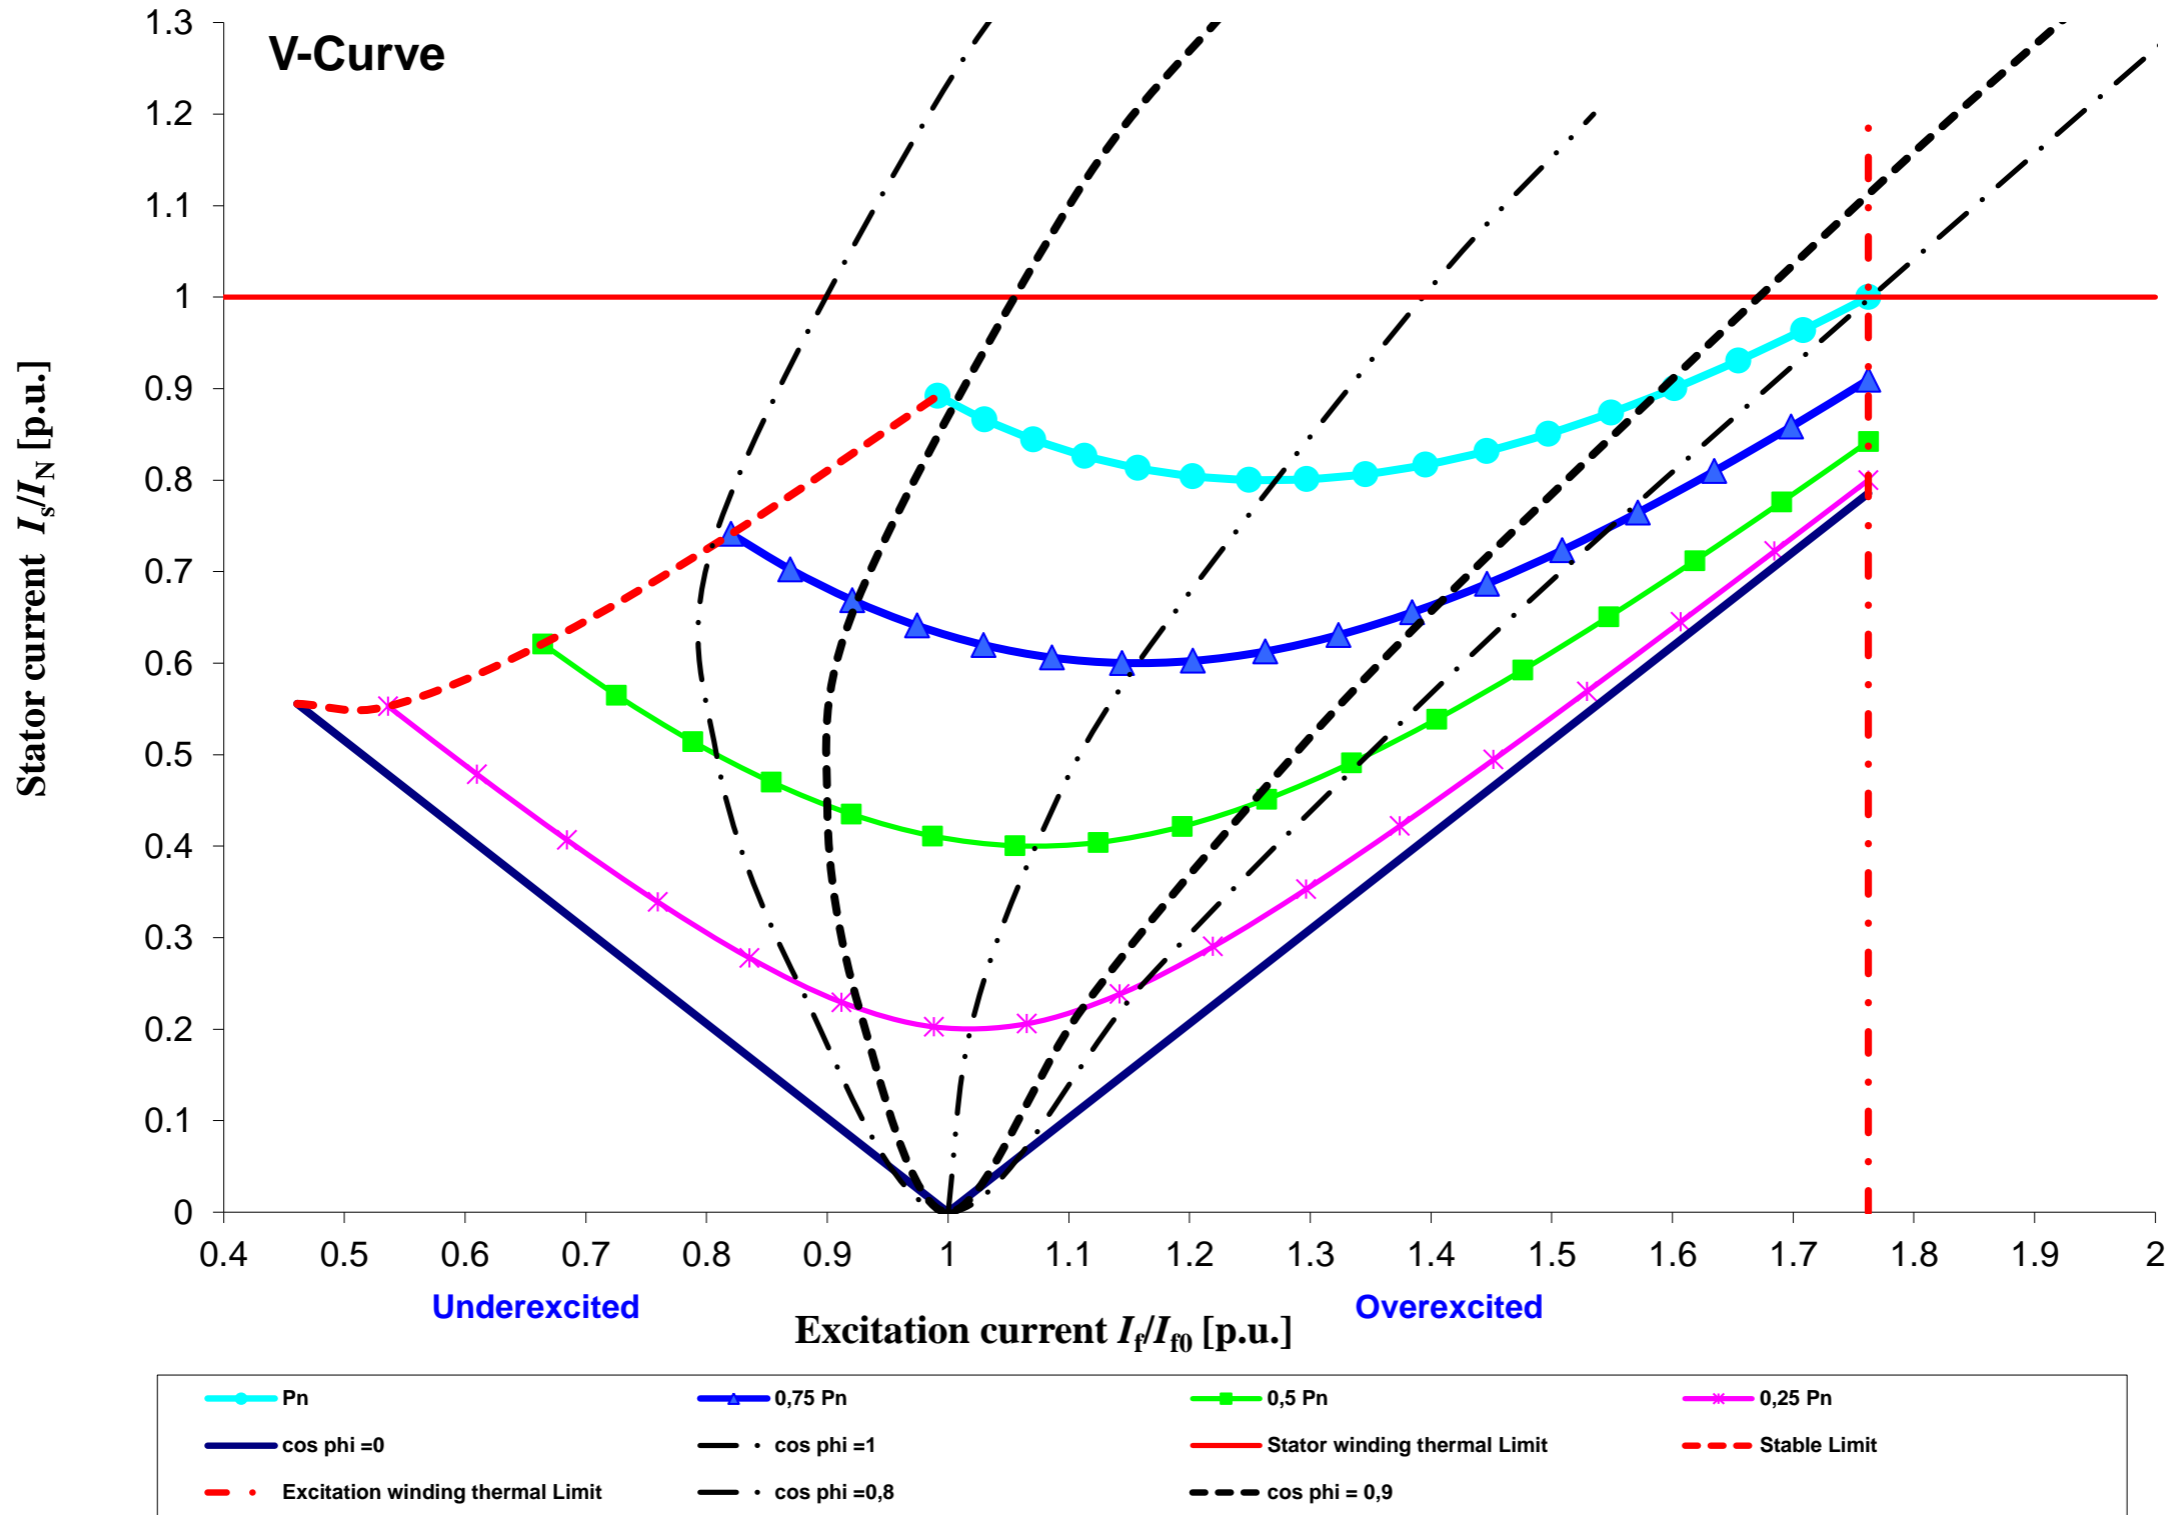

Cummins Generator Technologies	Datum / date:	
	21/01/2014	