

**Technical Data Sheet for AvK-Alternators**

FM 7.3-5

Date:	08/01/14	Customer:	GENERIC DATASHEET only
Project No.:		AvK Reference:	dsg099I2_10_50_690_A048M979

Object data:

Site:		Prime Mover:	
Application:	Stationary Power Plant	Manufacturer:	

Generator data:

Generator:	DSG 99 L2/10	Poles:	10	Standards:	IEC 60034
Rated power:	2000 kVA	1600 kWe	1677 kWm		
Power factor:	0.80				
Power at pf 1,0	1624 kVA	1624 kWe	1677 kWm		
Rated voltage:	0.69 kV				
Speed:	600 1/min				
Frequency:	50 Hz			Voltage range / frequency range:	
Rated current:	1673.5 A			Zone A according IEC 60034-1 (dU = +/-5%, df = +/-2%)	

Winding pitch:	ca. 5/6
----------------	---------

Insulation class:	Stator: Class H	Rotor: Class H	Temperature rise:	H
-------------------	-----------------	----------------	-------------------	---

Ambient temperature:	40 ° C	Environment:	Standard environment
----------------------	--------	--------------	----------------------

Site altitude:	1000 m		
----------------	--------	--	--

Enclosure:	IP23	Filter:	
------------	------	---------	--

Cooling:	IC 01 - Open-circuit ventilation
----------	----------------------------------

Coolant:	Ambient Air	Temperature	40 ° C	Temperature Air inlet	40 ° C
----------	-------------	-------------	--------	-----------------------	--------

		Coolant:		generator:	
--	--	----------	--	------------	--

		Cooling air vol.:	1.8 m³/s	Cooling water quantity:	n/a
--	--	-------------------	----------	-------------------------	-----

Moment of inertia (I):	300 kgm²	Weight:	8850 Kg	Losses (environment):	77 KW
------------------------	----------	---------	---------	-----------------------	-------

		Losses (cooling):	n/a		
--	--	-------------------	-----	--	--

Wires:	4 terminals, starpoint connected in terminal box
--------	--

Operation mode:	Single mode
-----------------	-------------

Regulators:	
-------------	--

Voltage regulator:	DECS 100
--------------------	----------

Electrical data: (acc. IEC)

Efficiencies:	110%	100%	75%	50%	25%
Power factor 0.8	95,17	95,4	95,65	95,55	94
Power factor 0.9	95,93	96,13	96,25	96	94,3
Power factor 1.0	96,69	96,85	96,85	96,45	94,6

Reactances and time constants

	unsaturated		saturated							
X_d	1.85	1.67 p.u.	X_q	0.93	0.91 p.u.	$T_{d0'}$	2 s	$T_{d0''}$	0.02555 s	
X_d'	0.245	0.245 p.u.	X_q'	0.93	0.91 p.u.	$T_{d'}$	0.26 s	$T_{q0'}$	0.34 s	
X_d''	0.179	0.163 p.u.	X_q''	0.179	0.179 p.u.	$T_{d''}$	0.017 s	$T_{q0''}$	0.17665 s	
X_2	0.188	0.171 p.u.	X_0	0.054	0.049 p.u.	T_a	0.045 s	$T_{q'}$	0.34 s	
X_{1s}	n.a.	0.098 p.u.						$T_{q''}$	0.034 s	

Short circuit ratio saturated:	0.6	Z_n	0.238 Ohm
--------------------------------	-----	-------	-----------

Short circuit data:

Initial short circuit current (3-phase):	I_k''	10267 A	
Max. peak current (3-phase):	I_s	26136 A	
Sustained short circuit current:	I_k	5020 A	Minimum 3 x rated current for max.10 s

Initial short circuit torque:	M_{k2}	253.9 kNm
-------------------------------	----------	-----------

	M_{k3}	152.3 kNm
--	----------	-----------

Max. faulty synchron moment:	M_f	545.9 kNm
------------------------------	-------	-----------

Rated kVA torque:	M_{SN}	31.83 kNm
-------------------	----------	-----------

Rated torque	M_N	25.46 kNm
--------------	-------	-----------

Shaft torque	M_{Sh}	26.69 kNm
--------------	----------	-----------

Load application:

max. load application: 1225 kVA (corresponds to 61,22 % from 2000 kVA) for Power factor 0.4 15% transient voltage drop	Power: 2000 kVA Power factor: 0.8 transient voltage drop: -19.7 %
---	---

Remarks:

Alternator : DSG 99 L2/10

Rated output [kVA]

2000

Rated power factor:

0.8

Rated voltage [kV]: 0.69


Rated frequency [Hz]

50

Rated speed [rpm]

600


Wirkungsgrad-Kennlinie - Efficiency Curve

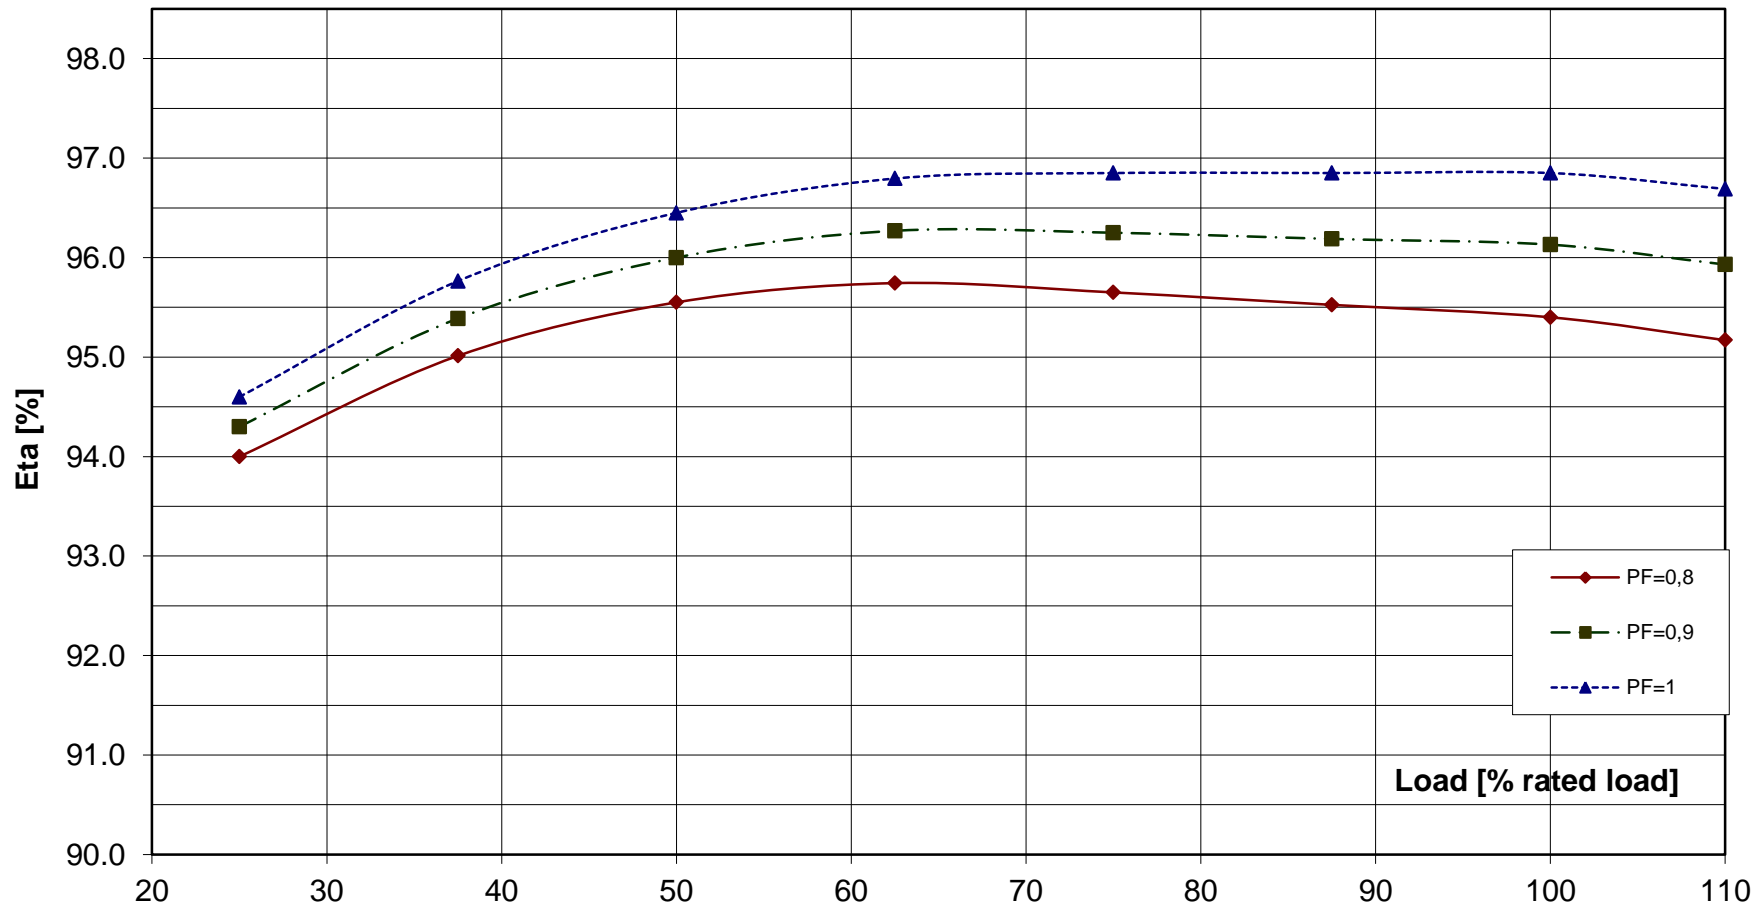

Alternator : DSG 99 L2/10

Rated output [kVA]	2000	Rated power factor:	0.8	Rated voltage [kV]:	0.69
Rated frequency [Hz]	50	Rated speed [rpm]	600		

Transient Voltage rise or drop for sudden load removal or application

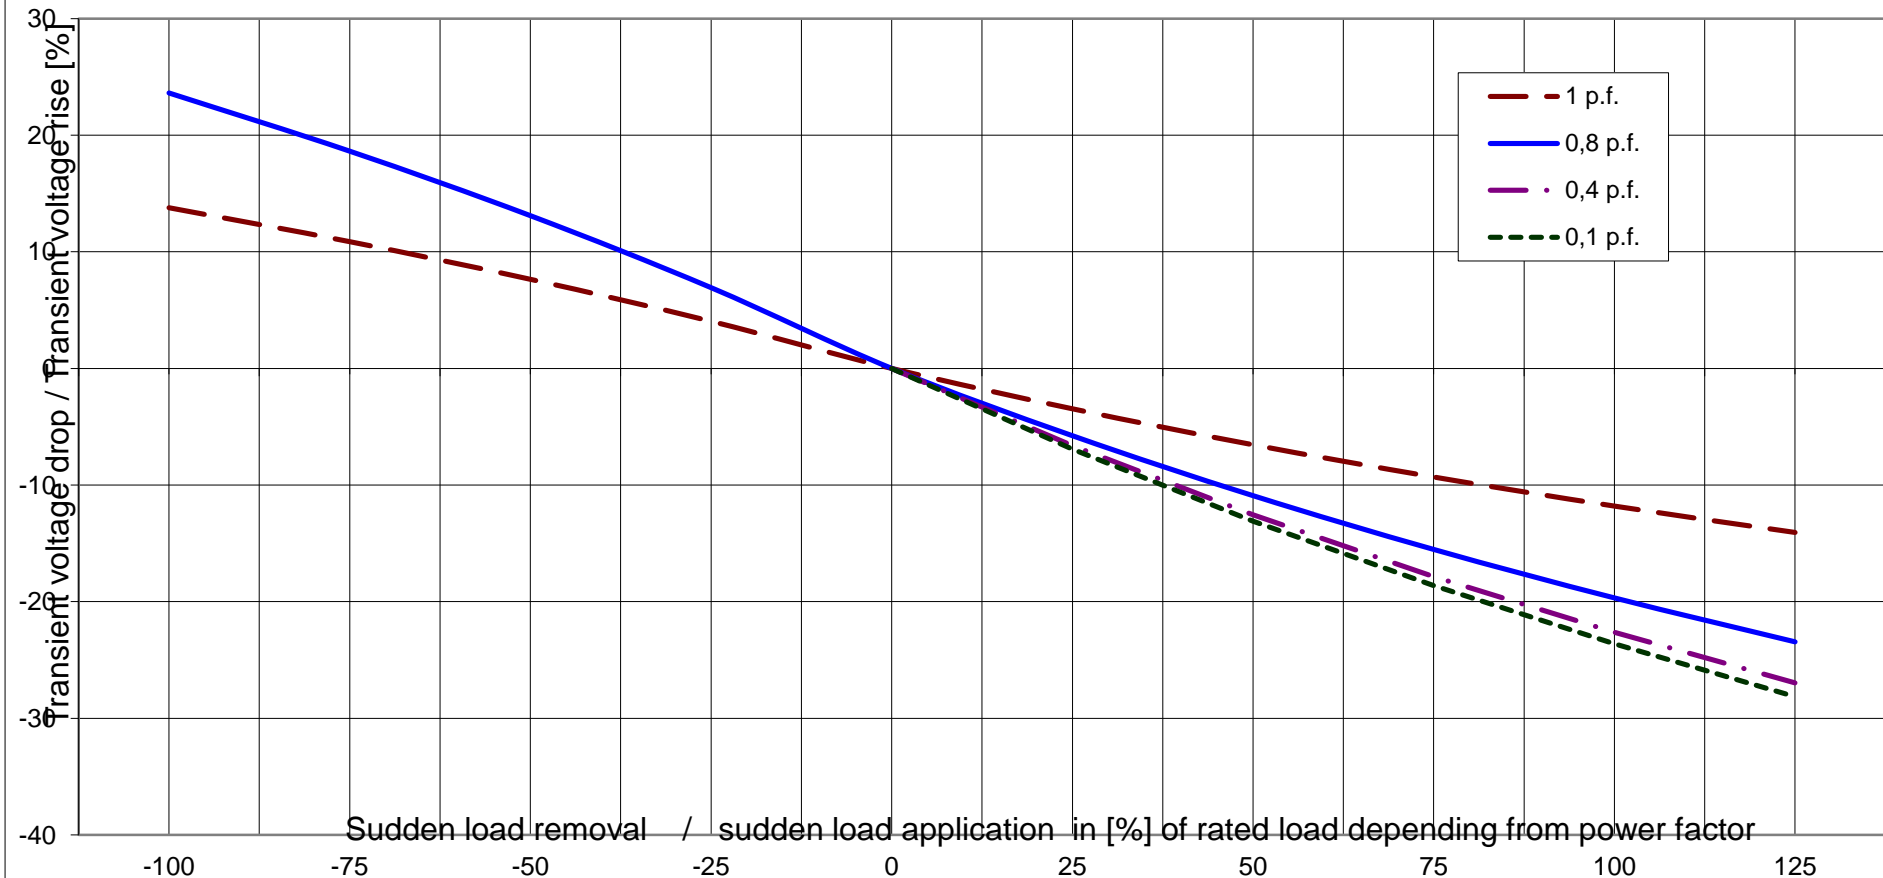




Technisches Datenblatt - Diagramme
Technical data sheet - Diagrams

ING-FCD-0112

Alternator :	DSG 99 L2/10			
Rated output [kVA]	2000	Rated power factor:	0.8	Rated voltage [kV]: 0.69
Rated frequency [Hz]	50	Rated speed [rpm]	600	MSN related to kVA: 31.83 KNm

Kurzschlußmomenten-Verlauf 2-poliger KS
Short circuit torque at 2-phase SC

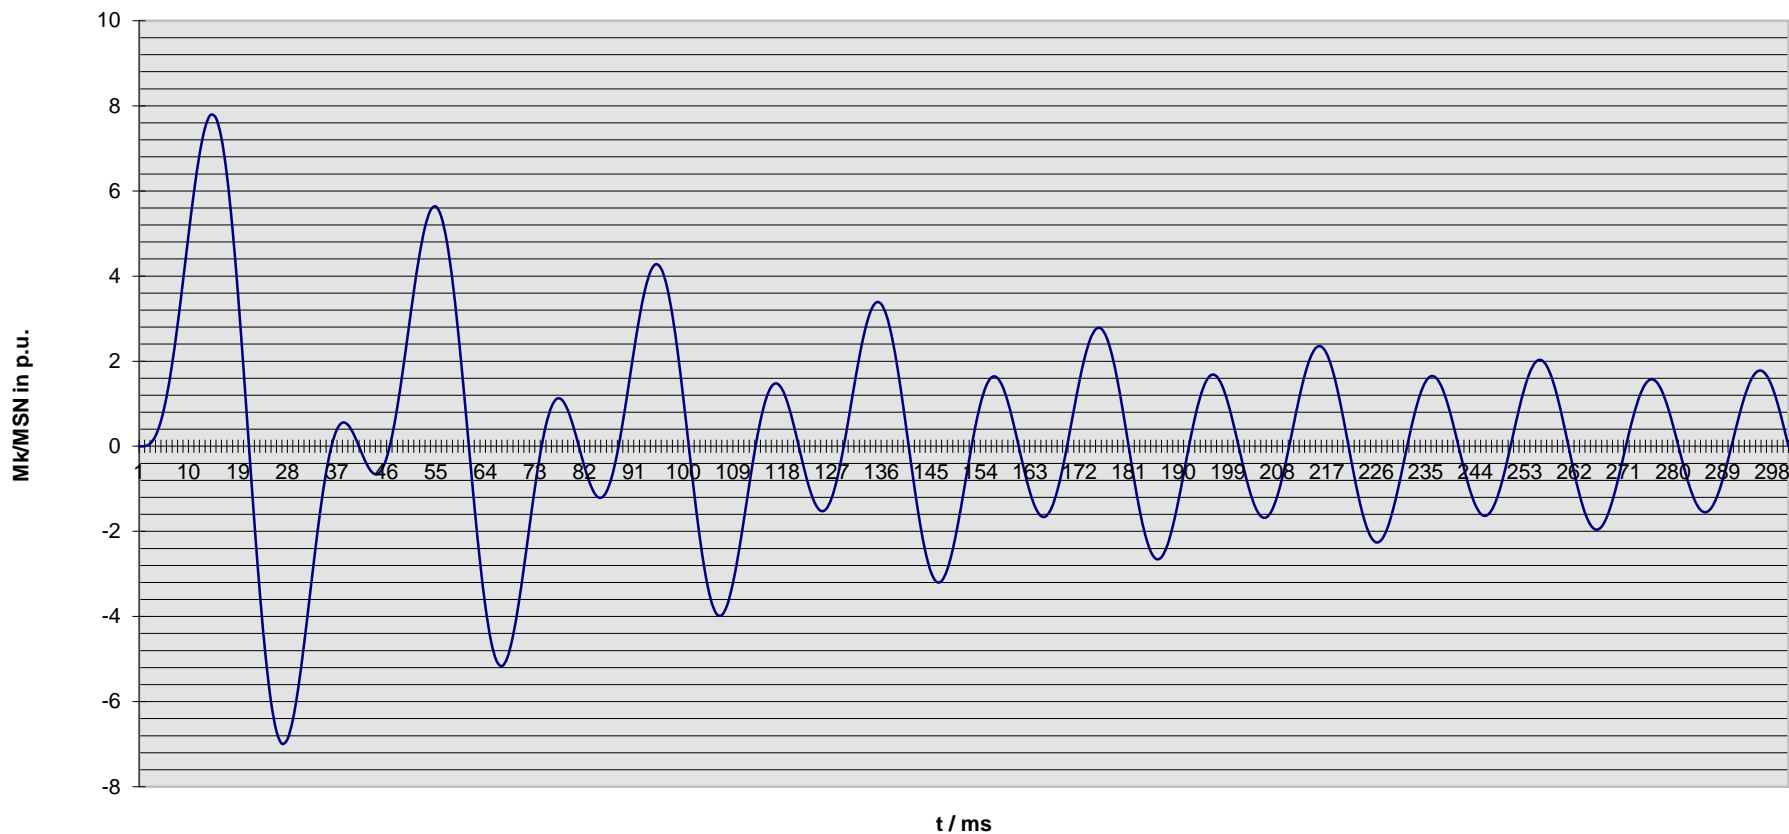

Nenndaten / nominal data

DSG 99 L2/10

Leistung S_N : **2000 kVA**

$\cos \varphi$: **0.80**

Rating

p.f.

Spannung U_N : **0.69 kV**

Strom I_N : **1673 A**

Voltage

Current

Frequenz f : **50 Hz**

Drehzahl n : **600 min⁻¹**

Frequency


Speed

Schutzart **IP23**

Protection

Kurzschlussstrom $I_{k3\text{phasig}} / I_N$ [p.u.]
Short-circuit current $I_{k3\text{phase}} / I_N$ [p.u.]

Stosskurzschluss-Strom, 3-phasig, asymmetrisch /
Sudden short circuit current, 3-phase, asymmetrical

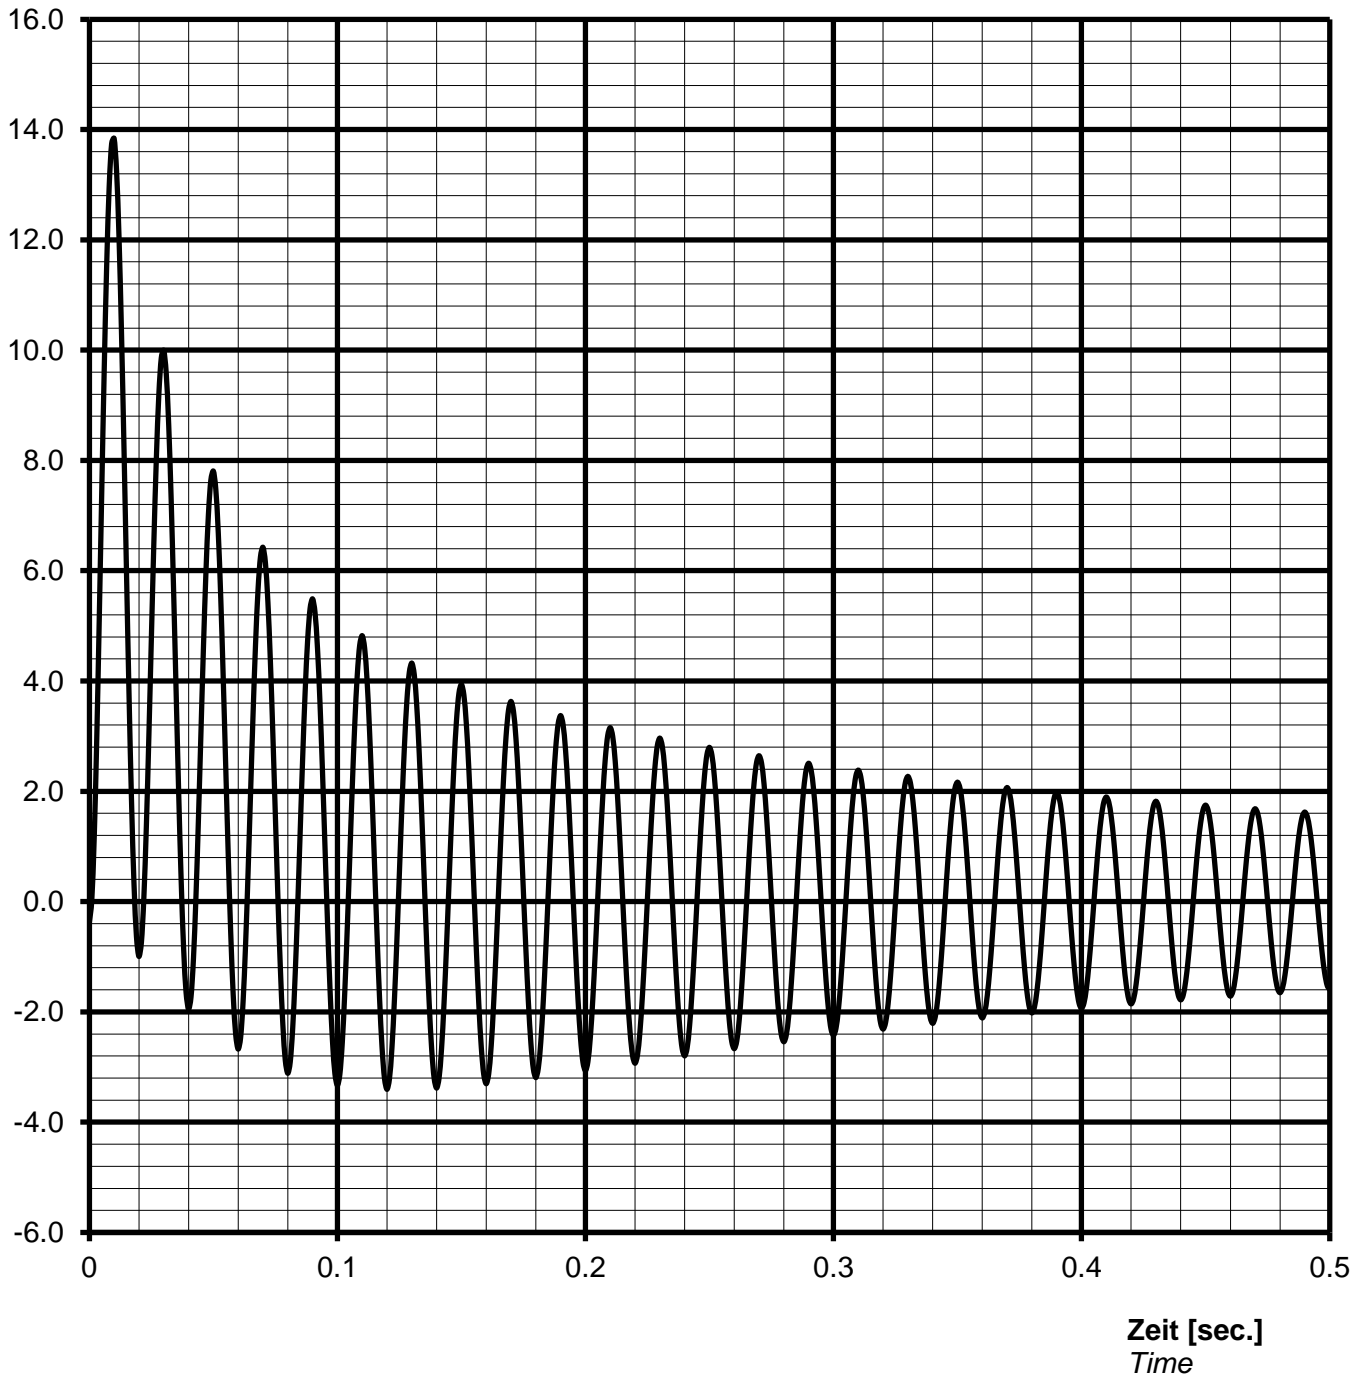

Notizen / remarks:

Maximum asymmetric peak value $I_{\text{peak}} =$ **23160 A** or **13.84 p.u.**

Nennwerte / nominal data

DSG 99 L2/10

Leistung S_N : **2000** kVA

$\cos \varphi$: **0.80**

Rating

p.f.

Spannung U_N : **0.69** kV

Strom I_N : **1673** A

Voltage

Current

Frequenz f: **50** Hz

Drehzahl n: **600** min⁻¹


Frequency

Speed

Schutzart **IP23**

Protection

Überlast Kennlinie Overload capability

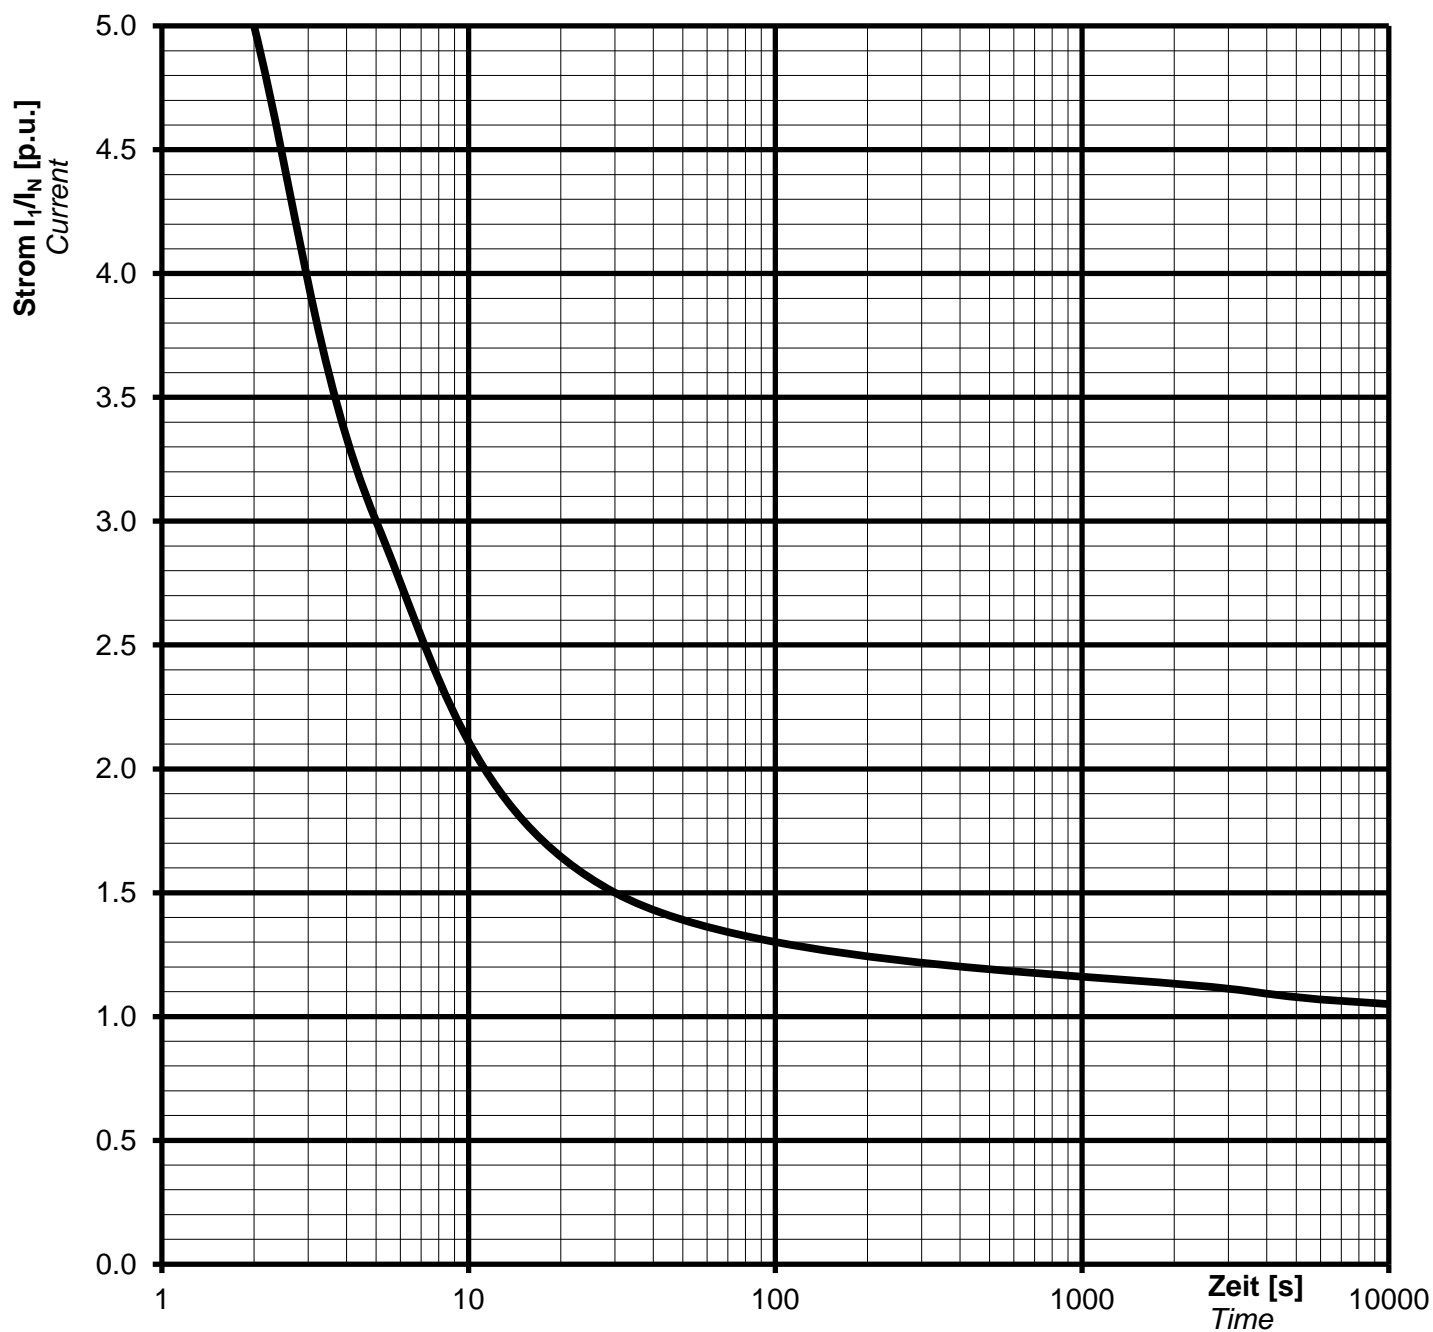

Notizen / remarks:

Strom / Zeit Kriterien:

$$(I / I_N)^2 \cdot t = 45s$$

Current/time characteristics:

1,5 * I_N for 30 s

1,1 * I_N for 1 h in 6h

Nennwerten / nominal data

DSG 99 L2/10

Rating S_N : **2000 kVA**

p.f. **0.80**

Bemessungsleistung

Leistungsfaktor $\cos \varphi$:

Nominal voltage U_N : **0.69 kV**

Nominal current I_N : **1673 A**

Bemessungsspannung

Bemessungsstrom

Frequency f_N : **50 Hz**

Speed n : **600 min⁻¹**

Frequenz

Drehzahl

Protection: **IP23**

Schutzart

Inverse current or unbalanced negative sequence current



Remarks / Notizen:



Technische Daten selbstregelnden Drehstrom-Synchrongenerator
technical data for self regulating three phase alternator

ING-FCD-0112


TYPE

DSG 99 L2/10

Projekt:

Order Nr.:

Capability (P-Q) Diagram

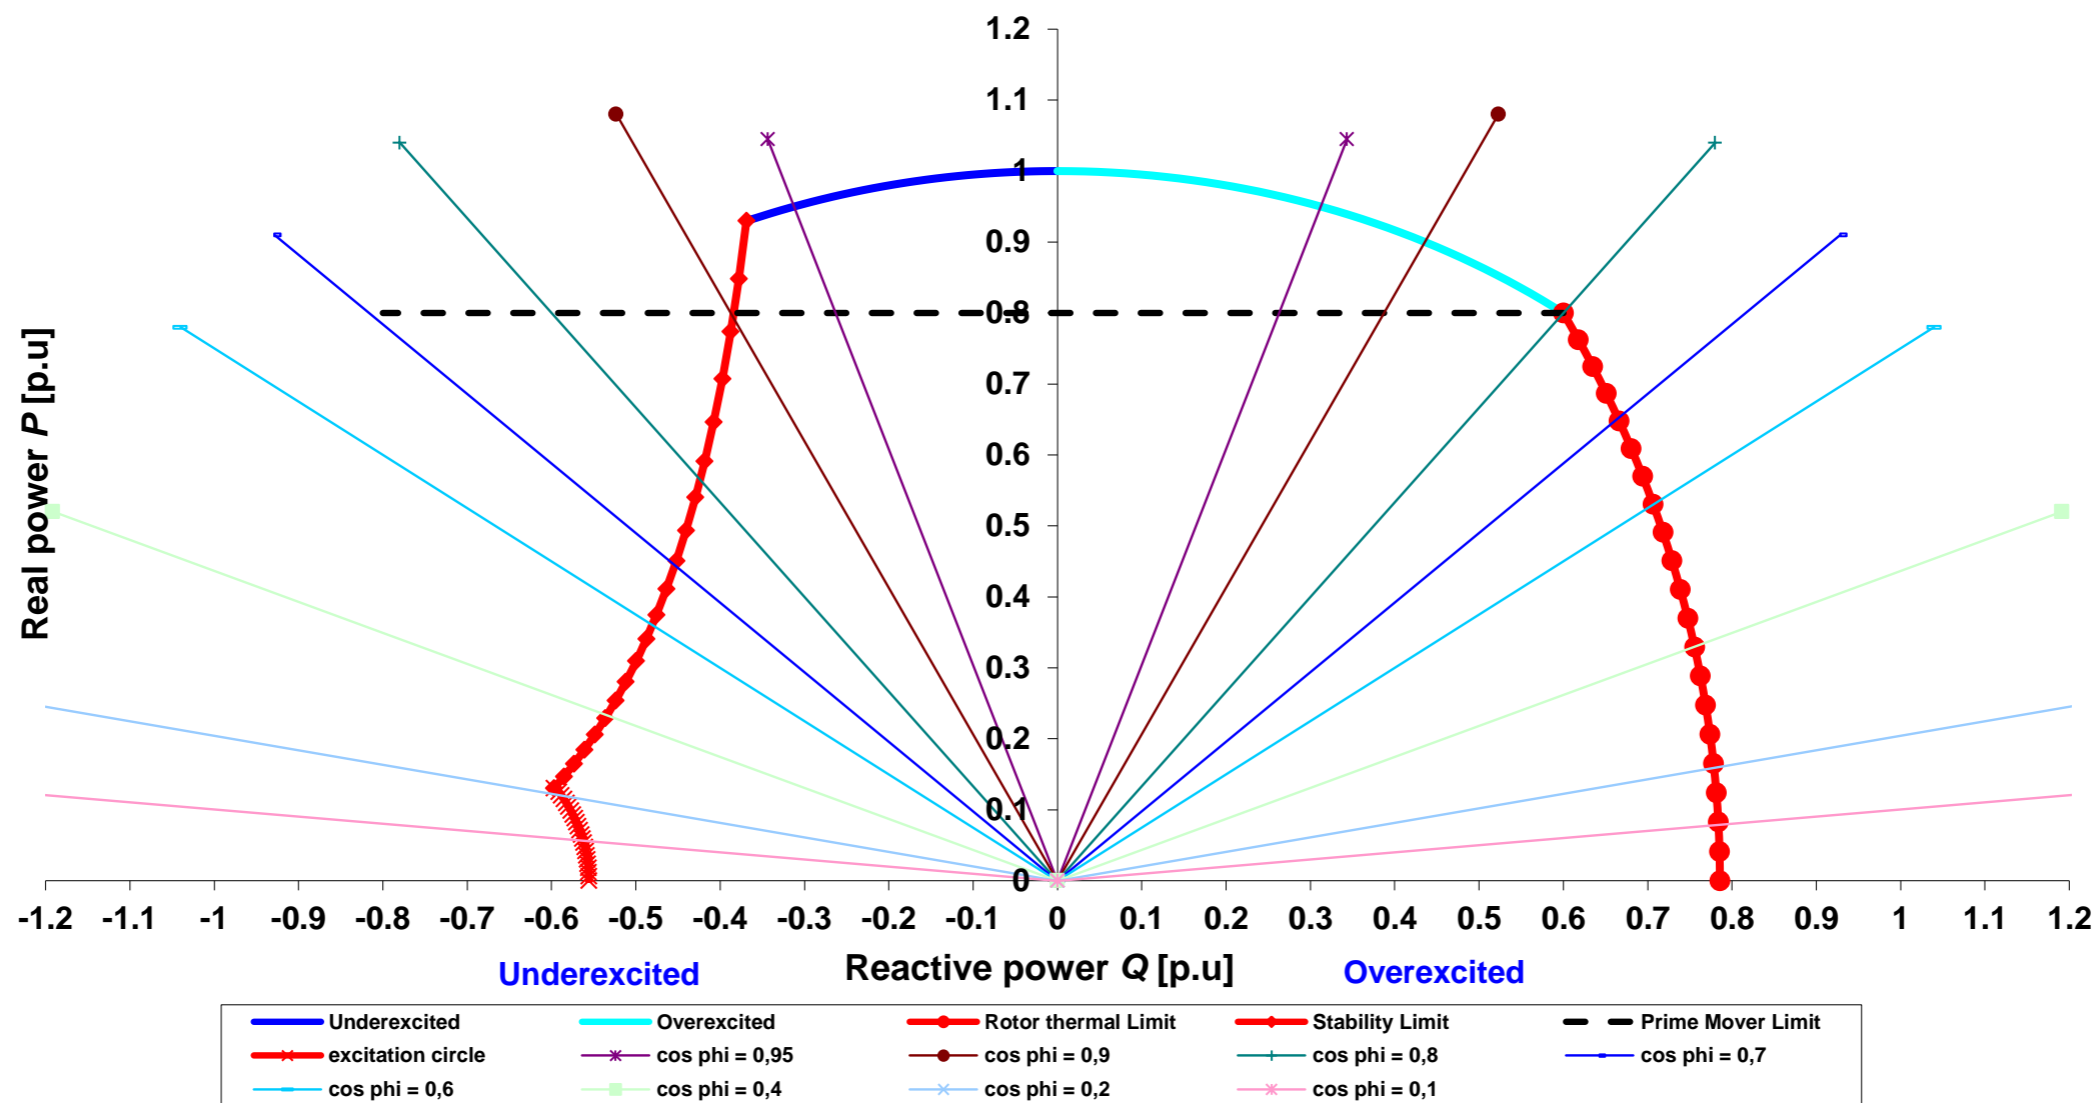


Cummins Generator Technologies

Datum / date:

21/01/2014

TYPE	DSG 99 L2/10	Projekt:		Order Nr.:	
------	--------------	----------	--	------------	--

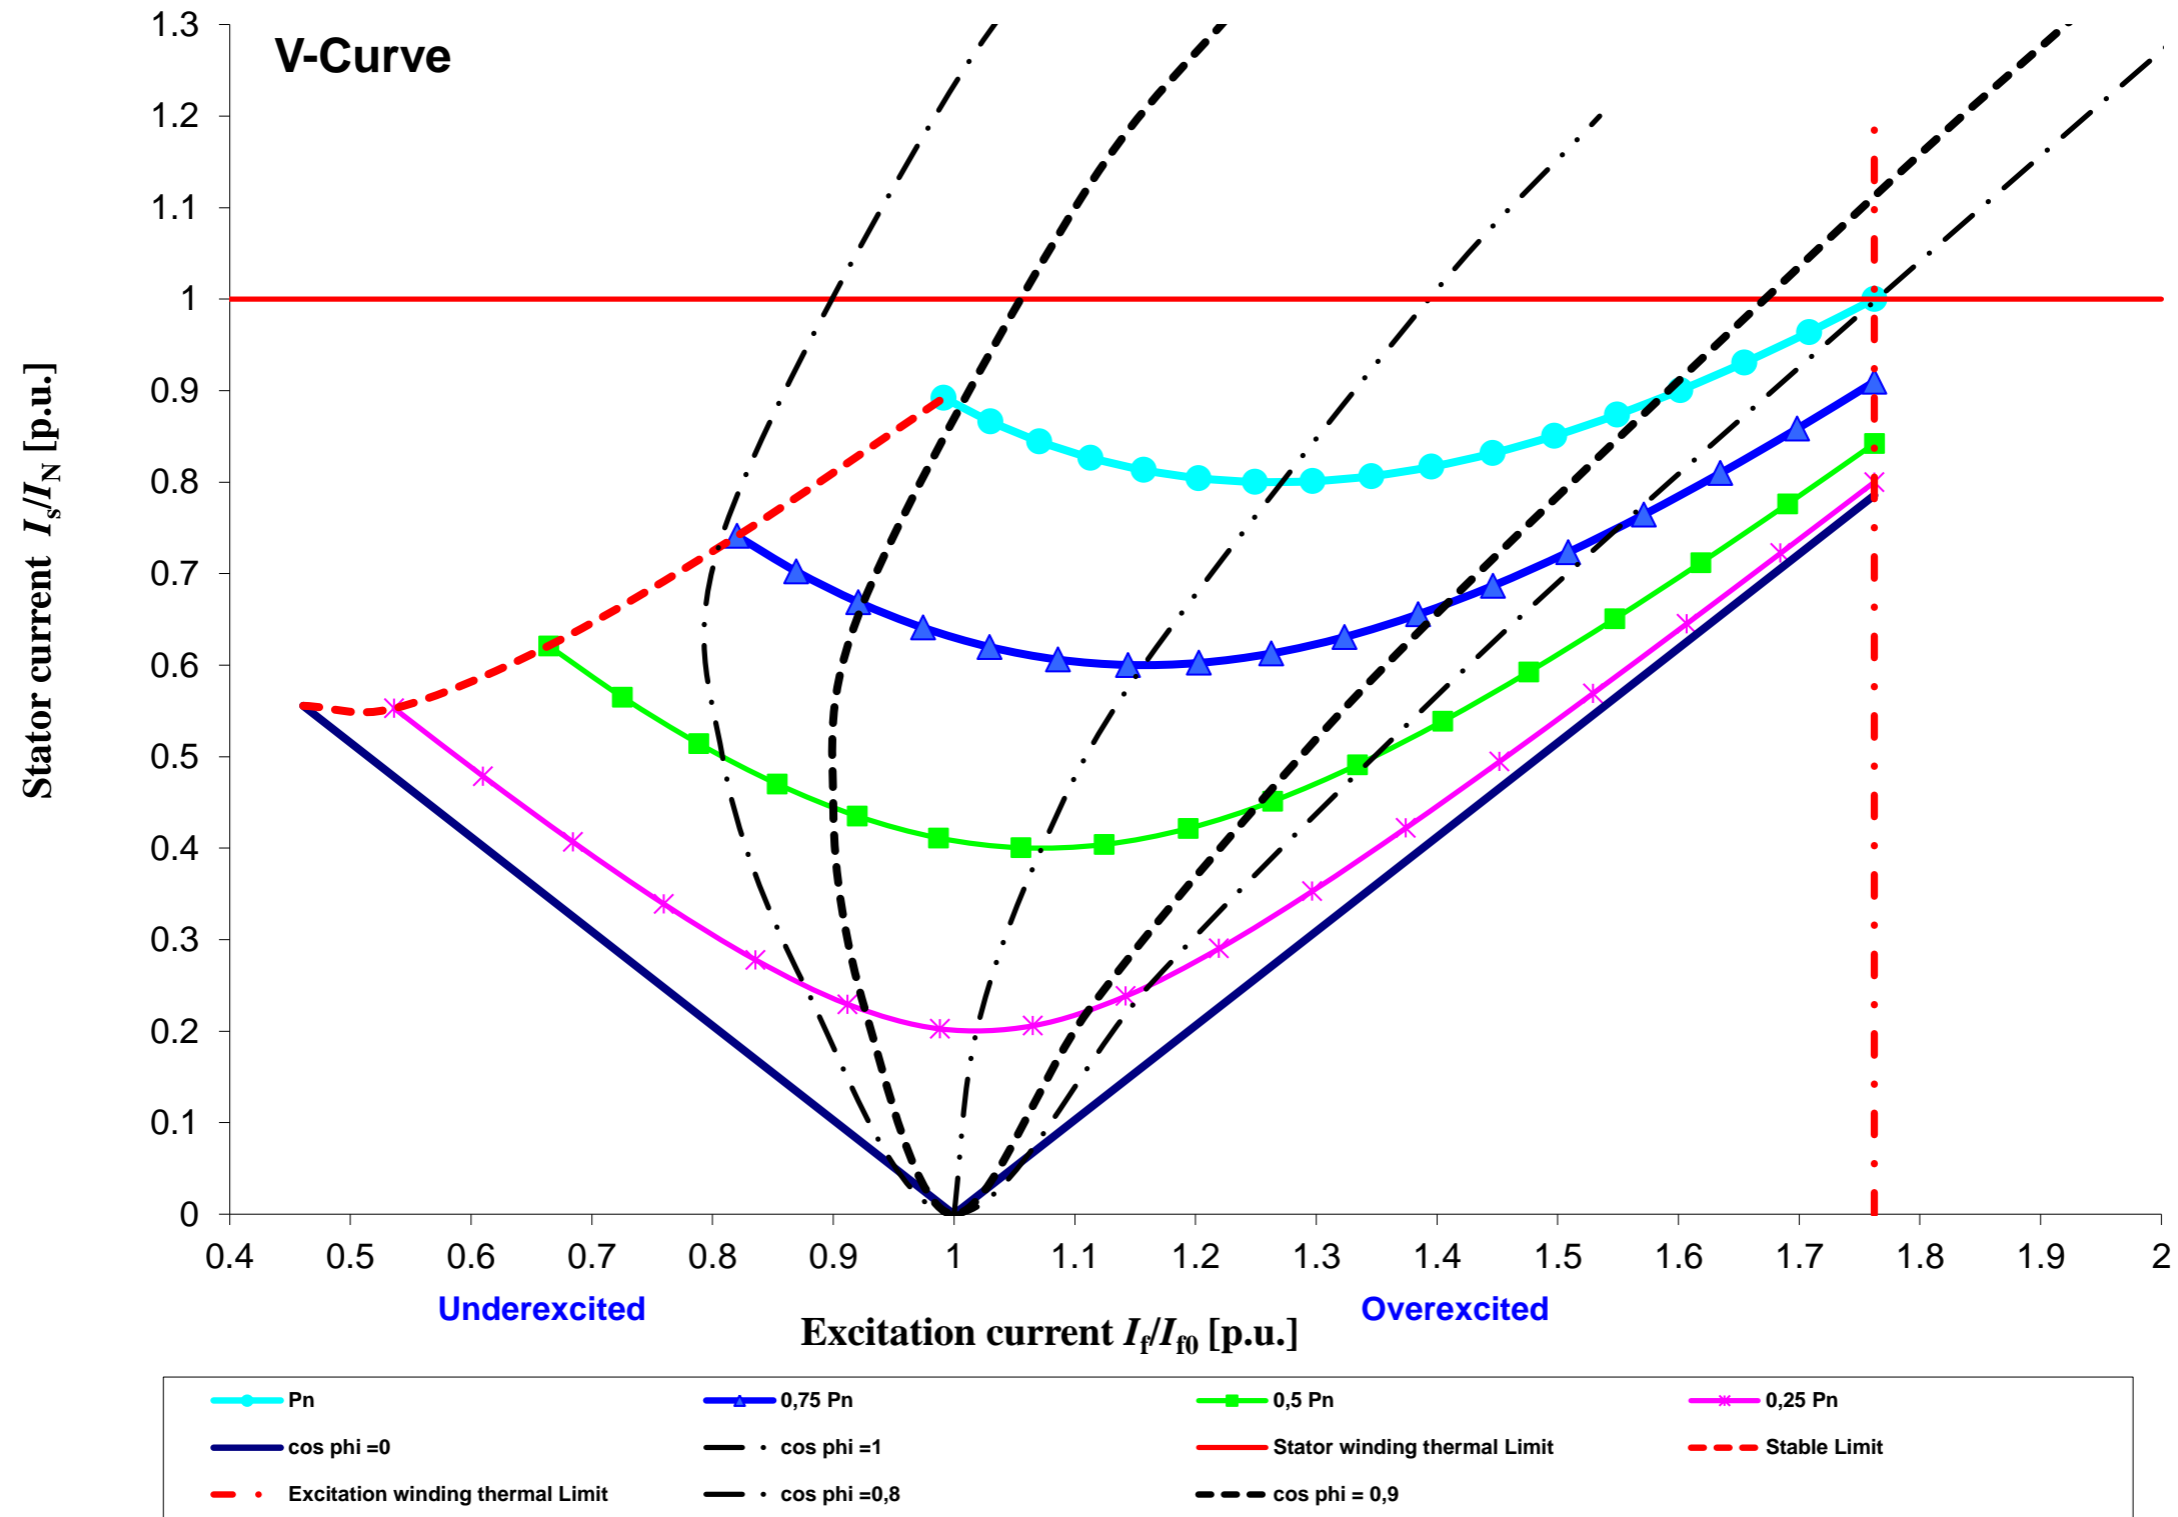

Cummins Generator Technologies	Datum / date:	
	21/01/2014	