
# STAMFORD

PI142H - Winding 06
Technical Data Sheet

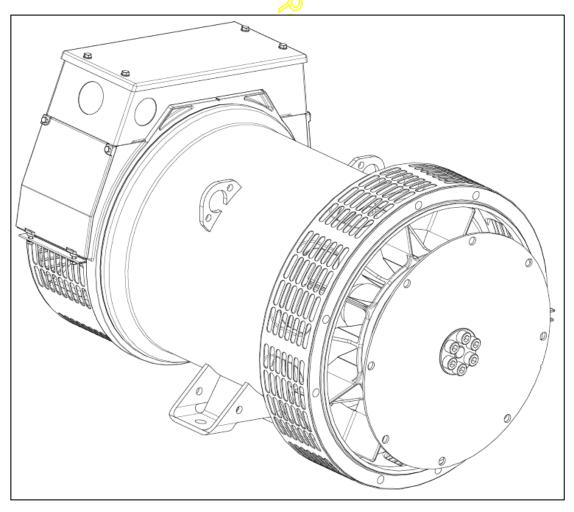

## STAMFORD

### **SPECIFICATIONS & OPTIONS**

#### **STANDARDS**

Stamford industrial generators meet the requirements of BS EN 60034 and the relevant section of other international standards such as BS5000, VDE 0530, NEMA MG1-32, IEC34, CSA C22.2-100, AS1359. Other standards and certifications can be considered on request.

#### **VOLTAGE REGULATOR**

#### AS480 AVR fitted as STANDARD

With this self-excited system the main stator provides power via the AVR to the exciter stator. The high efficiency semi-conductors of the AVR ensure positive build-up from initial low levels of residual voltage.

The exciter rotor output is fed to the main rotor through a three-phase full-wave bridge rectifier. The rectifier is protected by a surge suppressor against surges caused, for example, by short circuit or out-of-phase paralleling. The AS480 will support limited accessories, RFI suppession remote voltage trimmer and for the P1 range only a 'droop' Current Transformer (CT) to permit parallel operation with other ac generators.

The AVR is can be fitted to either side of the generator in its own housing in the non-drive end bracket.

#### **Excitation Boost System (EBS) (OPTIONAL)**

The EBS is a single, self-contained unit, attached to the non-drive end of the generator.

The EBS unit consists of the Excitation Boost Controller (EBC) and an Excitation Boost Generator (EBG). Under fault conditions, or when the generator is subjected to a large impact load such as a motor starting, the generator voltage will drop. The EBC senses the drop in voltage and engages the output power of the EBG. This additional power feeds the generator's excitation system, supporting the load until breaker discrimination can remove the fault or enable the generator to pick up a motor and drive the voltage recovery.

#### **WINDINGS & ELECTRICAL PERFORMANCE**

All generator stators are wound to 2/3 pitch. This eliminates triplen (3rd, 9th, 15th ...) harmonics on the voltage waveform and is found to be the optimum design for trouble-free supply of non-linear loads. The 2/3 pitch design avoids excessive neutral currents sometimes seen with higher winding pitches, when in parallel with the mains. A fully connected damper winding reduces oscillations during paralleling. This winding, with the 2/3 pitch and carefully selected pole and tooth designs, ensures very low waveform distortion.

#### **TERMINALS & TERMINAL BOX**

Dedicated Single Phase generators have 4 ends brought out to the terminals, which are mounted at the non-drive end of the generator. A sheet steel terminal box contains provides ample space for the customers' wiring and gland arrangements. Alternative terminal boxes are available for customers who want to fit additional components in the terminal box.

#### **SHAFT & KEYS**

All generator rotors are dynamically balanced to better than BS6861:Part 1 Grade 2.5 for minimum vibration in operation. Two bearing generators are balanced with a half key.

#### **INSULATION / IMPREGNATION**

The insulation system is class 'H'.

All wound components are impregnated with materials and processes designed specifically to provide the high build required for static windings and the high mechanical strength required for rotating components.

#### QUALITY ASSURANCE

Generators are manufactured using production procedures having a quality assurance level to BS EN ISO 9001.

The stated voltage regulation may not be maintained in the presence of certain radio transmitted signals. Any change in performance will fall within the limits of Criteria B' of EN 61000-6-2:2001. At no time will the steady-state voltage regulation exceed 2%.

#### DE RATES

All values tabulated on page 7 are subject to the following reductions

5% when air inlet filters are fitted.

3% for every 500 metres by which the operating altitude exceeds 1000 metres above mean sea level.

3% for every 5°C by which the operational ambient temperature exceeds 40°C.

Note: Requirement for operating in an ambient exceeding 60°C must be referred to the factory.

5% For reverse rotation

(Standard rotation CW when viewed from DE)

NB Continuous development of our products entitles us to change specification details without notice, therefore they must not be regarded as binding.

Front cover drawing typical of product range.




# **WINDING 06**


VOLTAGE REGULATION   \$1.0 %	CONTROL SYSTEM	STANDARD AS480 AVR (	SELF EX	(CITED)								
AS480 AVR WITH OPTIONAL EXCITATION BOOST SYSTEM (EBS)		· · · · · · · · · · · · · · · · · · ·										
SUSTAINED SHORT CIRCUIT   REFER TO SHORT CIRCUIT DECREMENT CURVE (page 6)	SUSTAINED SHORT CIRCUIT											
NSULATION SYSTEM	CONTROL SYSTEM	AS480 AVR WITH OPTIONAL EXCITATION BOOST SYSTEM (EBS)										
PROTECTION	SUSTAINED SHORT CIRCUIT	REFER TO SHORT CIRC	UIT DEC	REMENT CURVE	(page 6)							
STATOR WINDING   SINGLE LAYER CONCENTRIC	INSULATION SYSTEM	CLASS H										
SINGLE LAYER CONCENTRIC   TWO THIRDS   TWO	PROTECTION	IP23										
WINDING PITCH	RATED POWER FACTOR	0.8										
WINDING LEADS	STATOR WINDING	SINGLE LAYER CONCENTRIC										
STATOR WDG. RESISTANCE	WINDING PITCH	TWO THIRDS										
ROTOR WDG. RESISTANCE	WINDING LEADS	4										
EXCITER STATOR RESISTANCE EXCITER ROTOR RESISTANCE  EXCITER ROTOR RESISTANCE  ESS STATOR RESISTANCE  EBS STATOR RESISTANCE  EBS STATOR RESISTANCE  EBS STATOR RESISTANCE  12.9 Ohms at 22°C  13.9 Ohms at 22°C  14.0 Ohms at 22°C  14.0 Ohms at 22°C  15.9 Ohms at 2	STATOR WDG. RESISTANCE	0.054 Ohms AT 22°C SERIES CONNECTED										
EXCITER ROTOR RESISTANCE  EBS STATOR RESISTANCE  12.9 Ohms at 22°C  12	ROTOR WDG. RESISTANCE			1.59 Ohm	s at 22°C							
EBS STATOR RESISTANCE  R.F.I. SUPPRESSION  BS EN 61000-6-2 & BS EN 61000-6-4, VDE 0875G, VDE 0875N, refer to factory for others  WAVEFORM DISTORTION  NO LOAD 3 1.5% NON-DISTORTINO LINEAR LOAD < 5.0%  MAXIMUM OVERSPEED  BEARING DRIVE END  BEARING DRIVE END  BEARING DRIVE END  BEARING NON-DRIVE END  BEARING NON-DRIVE END  BEARING NON-DRIVE END  BEARING WITH EBS  WITHOUT EBS  WITHOUT EBS  WITHOUT EBS  WITHOUT EBS  WITHOUT EBS  WITHOUT EBS  WIGHT WOUND STATOR  85.1 kg  8	EXCITER STATOR RESISTANCE			20 Ohms	at 22°C							
R.F.I. SUPPRESSION  BS EN 61000-6-2 & BS EN 61000-6-4, VDE 08750, VDE 0875N. refer to factory for others  WAVEFORM DISTORTION  NO LOADS 1.5% NON-DISTORTING LINEAR LOAD < 5.0%  MAXIMUM OVERSPEED  BEARING DRIVE END  BEARING NON-DRIVE END  BEARING SOBREWIM:  BALL. 6300-2RS (ISO)  BEARING ON-DRIVE END  BEARING 2 BEARING  WITH EBS WITHOUT EBS WITH EBS WITHOUT EBS  WITHOUT EBS WITH EBS WITHOUT EBS  WEIGHT WOUND STATOR  BS.1 kg BS.1	EXCITER ROTOR RESISTANCE			0.105 Ohms PER	PHASE AT 22°C							
WAVEFORM DISTORTION   NO LOADS   1.5%   NON-DISTORTING LINEAR LOAD < 5.0%   MAXIMUM OVERSPEED   4500 Rev/Min   BEARING DRIVE END   BALL. 6310-2RS (ISO)   BAL	EBS STATOR RESISTANCE			12.9 Ohm	s at 22°C							
MAXIMUM OVERSPEED   4500 Rev/Min   BALL. 6310-2RS (ISO)   BEARING DRIVE END   BALL. 6310-2RS (ISO)   BALL. 6306-2RS (ISO)   BALL. 6306-	R.F.I. SUPPRESSION	BS EN 61000-6-2	& BS EN	I 61000-6-4,VDE 0	0875G, VDE 0875N	I. refer to	factory for others					
BEARING DRIVE END BEARING NON-DRIVE END BEARING ON-DRIVE END BEARING 2 BEARING  WITH EBS WITHOUT EBS WITH EBS WITHOUT EBS WHOUTH COMP. GENERATOR 172.5 kg 173.8 kg WEIGHT WOUND STATOR 85.1 kg	WAVEFORM DISTORTION											
BEARING NON-DRIVE END  1 BEARING  WITH EBS  WITHOUT EBS  WITH EBS  WITHOUT EBS  WITH EBS  WITHOUT EBS  WITHOUT EBS  WITHOUT EBS  WITHOUT EBS  WITHOUT EBS  ### ### ### ### ### ### ### ### ### #	MAXIMUM OVERSPEED	<del>-</del>										
BEARING	BEARING DRIVE END	La contraction de la contracti										
WITH EBS	BEARING NON-DRIVE END											
WEIGHT COMP, GENERATOR  172.5 kg WEIGHT WOUND STATOR  85.1 kg WEIGHT WOUND ROTOR  50.86 kg WEIGHT WOUND ROTOR  50.86 kg WR? INERTIA  0.1517 kgm² 0.155 kgm² 0.152 kgm² 0.1522 kgm² 0.1505 kgm² 199.3 kg PACKING CRATE SIZE  85 x 51 x 67 (cm)  TELEPHONE INTERFERENCE  THF<2 2 230  VOLTAGE SERIES  220  VOLTAGE SERIES  220  VOLTAGE PARALLEL  110  115  120  KVA BASE RATING FOR REACTANCE VALUES  X'd DIR. AXIS SYNCHRONOUS  2.44  2.23  2.05  X'd DIR. AXIS SYNCHRONOUS  2.44  2.23  2.05  X'd DIR. AXIS SUBTRANSIENT  0.15  0.14  0.13  Xq QUAD. AXIS REACTANCE 1.21  1.11  1.02  X'q QUAD. AXIS REACTANCE 0.23  0.21  X'q QUAD. AXIS REACTANCE 0.10  0.09  0.08  REACTANCES ARE SATURATED  VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED  T'd SUB-TRANSIENT IME CONST.  0.006 s  T'd SUB-TRANSIENT CONST.  0.004 s		1 BE <i>F</i>	ARING		2 BEARING							
WEIGHT WOUND STATOR		WITH EBS	WIT	HOUT EBS	WITH EB	S	WITHOUT EBS					
WEIGHT WOUND ROTOR         50.86 kg         49.16 kg         52.58 kg         50.88 kg           WR² INERTIA         0.1517 kgm²         0.15 kgm²         0.1522 kgm²         0.1505 kgm²           SHIPPING WEIGHTS in a crate         191 kg         189.3 kg         200 kg         198.3 kg           PACKING CRATE SIZE         85 x 51 x 67 kcm²         85 x 51 x 67 kcm²         TIF<50	WEIGHT COMP. GENERATOR	172.5 kg		170.8 kg	175.5 kg		173.8 kg					
WR² INERTIA         0.1517 kgm²         0.1518 kgm²         0.1522 kgm²         0.1505 kgm²           SHIPPING WEIGHTS in a crate         191 kg         189.3 kg         200 kg         198.3 kg           PACKING CRATE SIZE         85 x 51 x 67 (cm)         85 x 51 x 67 (cm)         85 x 51 x 67 (cm)           TELEPHONE INTERFERENCE         THF<2 (cm)	WEIGHT WOUND STATOR	85.1 kg		85.1 kg 85.1 kg		85.1 kg						
SHIPPING WEIGHTS in a crate   191 kg   189.3 kg   200 kg   198.3 kg     PACKING CRATE SIZE   85 x 51 x 67 (cm)   85 x 51 x 67 (cm)     TELEPHONE INTERFERENCE   THF<2   TIF<50     COOLING AIR   0.205 m³/sec 434 cfm     VOLTAGE SERIES   220   230   240     VOLTAGE PARALLEL   110   115   120     KVA BASE RATING FOR REACTANCE   32.0   32.0   32.0     Xd DIR. AXIS SYNCHRONOUS   2.44   2.23   2.05     Xd DIR. AXIS SYNCHRONOUS   2.44   2.23   0.21     X'd DIR. AXIS SUBTRANSIENT   0.25   0.23   0.21     X'd DIR. AXIS SUBTRANSIENT   0.15   0.14   0.13     Xq QUAD. AXIS REACTANCE   1.21   1.11   1.02     X'q QUAD. AXIS SUBTRANSIENT   0.29   0.26   0.24     XL LEAKAGE REACTANCE   0.10   0.09   0.08     X2 NEGATIVE SEQUENCE   0.23   0.21   0.19     X0 ZERO SEQUENCE   0.10   0.09   0.08     REACTANCES ARE SATURATED   VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED     T'd TRANSIENT TIME CONST.   0.006 s     T'd SUB-TRANSTIME CONST.   0.006 s     T'd SUB-TRANSTIME CONST.   0.007 s     T'd SUB-TRANSTIME CONST.   0.008 s     T'd ARMATURE TIME CONST.   0.004 s	WEIGHT WOUND ROTOR	50.86 kg		49.16 kg 52.58 kg		50.88 kg						
PACKING CRATE SIZE  85 x 51 x 67 (cm)  TELEPHONE INTERFERENCE  THF<22  COOLING AIR  VOLTAGE SERIES  VOLTAGE SERIES  VOLTAGE PARALLEL  110  115  120  kVA BASE RATING FOR REACTANCE VALUES  VAIDEN. AXIS SYNCHRONOUS  2.44  2.23  2.05  X'd DIR. AXIS TRANSIENT  0.25  0.23  0.21  X'd DIR. AXIS SUBTRANSIENT  0.15  0.14  0.13  Xq QUAD. AXIS REACTANCE  1.21  1.11  1.02  X'q QUAD. AXIS SUBTRANSIENT  0.29  0.26  0.24  XL LEAKAGE REACTANCE  0.10  0.09  0.08  X2 NEGATIVE SEQUENCE  0.23  0.21  0.19  X0 ZERO SEQUENCE  0.10  VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED  T'd TRANSIENT TIME CONST.  0.006 s  T'd SUB-TRANSTIME CONST.  1 ARMATURE TIME CONST.  0.004 s	WR² INERTIA	0.1517 kgm <sup>2</sup>		).15 kgm <sup>2</sup> 0.1522 kgm		1 <sup>2</sup>	0.1505 kgm <sup>2</sup>					
TELEPHONE INTERFERENCE  COOLING AIR  VOLTAGE SERIES  VOLTAGE SERIES  VOLTAGE PARALLEL  110  115  120  KVA BASE RATING FOR REACTANCE VALUES  VAIUES  VAIUES  VAIUES  VAIUES  VAIUES  VAIUES  VALUES  VAIUES  VALUES  VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED  T'd TRANSIENT TIME CONST.  VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED  T'd SUB-TRANSTIME CONST.  VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED  T'd SUB-TRANSTIME CONST.  VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED  T'd SUB-TRANSTIME CONST.  VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED  T'd SUB-TRANSTIME CONST.  VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED  T'd SUB-TRANSTIME CONST.  VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED  T'd SUB-TRANSTIME CONST.  VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED  T'd SUB-TRANSTIME CONST.  VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED  T'd SUB-TRANSTIME CONST.  VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED  T'd SUB-TRANSTIME CONST.  VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED  T'd SUB-TRANSTIME CONST.  VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED  T'D SUB-TRANSTIME CONST.  VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED  T'D SUB-TRANSTIME CONST.  VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED  T'D SUB-TRANSTIME CONST.  VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED  T'D SUB-TRANSTIME CONST.  VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED  T'D SUB-TRANSTIME CONST.  VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED  T'D SUB-TRANSTIME CONST.  VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED  T'D SUB-TRANSTIME CONST.  VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED  THE SUB-TRANSTIME CONST.  VALUES ARE PER UNIT AT RATING AND VOLTAGE IN	SHIPPING WEIGHTS in a crate											
COOLING AIR         0.205 m³/sec 434 cfm           VOLTAGE SERIES         220         230         240           VOLTAGE PARALLEL         110         115         120           KVA BASE RATING FOR REACTANCE VALUES         32.0         32.0         32.0           Xd DIR. AXIS SYNCHRONOUS         2.44         2.23         2.05           X'd DIR. AXIS SYNCHRONOUS         2.44         2.23         0.21           X'd DIR. AXIS SUBTRANSIENT         0.25         0.23         0.21           X'd DIR. AXIS SUBTRANSIENT         0.15         0.14         0.13           Xq QUAD. AXIS REACTANCE         1.21         1.11         1.02           X''q QUAD. AXIS SUBTRANSIENT         0.29         0.26         0.24           X, LEAKAGE REACTANCE         0.10         0.09         0.08           X2 NEGATIVE SEQUENCE         0.23         0.21         0.19           X0 ZERO SEQUENCE         0.10         0.09         0.08           REACTANCES ARE SATURATED         VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED           T'd TRANSIENT TIME CONST.         0.006 s           T'd SUB-TRANSTIME CONST.         0.006 s           T'do O.C. FIELD TIME CONST.         0.004 s	PACKING CRATE SIZE	85 x 51 x 67 (cm) 85 x 51 x 67 (cm)										
VOLTAGE SERIES         220         230         240           VOLTAGE PARALLEL         110         115         120           KVA BASE RATING FOR REACTANCE VALUES         32.0         32.0         32.0           VAD DIR. AXIS SYNCHRONOUS         2.44         2.23         2.05           X'd DIR. AXIS SYNCHRONOUS         2.44         2.23         0.21           X'd DIR. AXIS SYNCHRONOUS         2.44         2.23         0.21           X'd DIR. AXIS SUBTRANSIENT         0.25         0.23         0.21           X'd DIR. AXIS SUBTRANSIENT         0.15         0.14         0.13           Xq QUAD. AXIS REACTANCE         1.21         1.11         1.02           X''q QUAD. AXIS SUBTRANSIENT         0.29         0.26         0.24           X, LEAKAGE REACTANCE         0.10         0.09         0.08           X2 NEGATIVE SEQUENCE         0.23         0.21         0.19           X0 ZERO SEQUENCE         0.10         0.09         0.08           REACTANCES ARE SATURATED         VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED           T'd TRANSIENT TIME CONST.         0.006 s           T'd SUB-TRANSTIME CONST.         0.006 s           T'do O.C. FIELD TIME CONST.         0.004 s	TELEPHONE INTERFERENCE	THF<2%TIF<50										
VOLTAGE PARALLEL         110         115         120           kWA BASE RATING FOR REACTANCE VALUES         32.0         32.0         32.0           Xd DIR. AXIS SYNCHRONOUS         2.44         2.23         2.05           X'd DIR. AXIS TRANSIENT         0.25         0.23         0.21           X''d DIR. AXIS SUBTRANSIENT         0.15         0.14         0.13           Xq QUAD. AXIS REACTANCE         1.21         1.11         1.02           X''q QUAD. AXIS SUBTRANSIENT         0.29         0.26         0.24           XL LEAKAGE REACTANCE         0.10         0.09         0.08           X2 NEGATIVE SEQUENCE         0.23         0.21         0.19           X0 ZERO SEQUENCE         0.10         0.09         0.08           REACTANCES ARE SATURATED         VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED           T'd TRANSIENT TIME CONST.         0.006 s           T''d SUB-TRANSTIME CONST.         0.006 s           T''d SUB-TRANSTIME CONST.         0.43 s           Ta ARMATURE TIME CONST.         0.004 s	COOLING AIR	0.205 m³/sec 434 cfm										
VOLTAGE PARALLEL         110         113         120           VAUES         32.0         32.0         32.0           Xd DIR. AXIS SYNCHRONOUS         2.44         2.23         2.05           X'd DIR. AXIS TRANSIENT         0.25         0.23         0.21           X''d DIR. AXIS SUBTRANSIENT         0.15         0.14         0.13           Xq QUAD. AXIS REACTANCE         1.21         1.11         1.02           X''q QUAD. AXIS SUBTRANSIENT         0.29         0.26         0.24           XL LEAKAGE REACTANCE         0.10         0.09         0.08           X2 NEGATIVE SEQUENCE         0.23         0.21         0.19           X0 ZERO SEQUENCE         0.10         0.09         0.08           REACTANCES ARE SATURATED         VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED           T'd TRANSIENT TIME CONST.         0.023 s           T'd SUB-TRANSTIME CONST.         0.006 s           T'do O.C. FIELD TIME CONST.         0.43 s           Ta ARMATURE TIME CONST.         0.004 s	VOLTAGE SERIES	220 230 240										
VALUES         32.0         32.1         32.0         32.1         32.0         32.1         32.0         32.1         32.0         32.1         32.0         32.1         32.0         32.1         32.0         32.1         32.0         32.1         32.2         <	VOLTAGE PARALLEL	110		11	15	120						
X'd DIR. AXIS TRANSIENT       0.25       0.23       0.21         X"d DIR. AXIS SUBTRANSIENT       0.15       0.14       0.13         Xq QUAD. AXIS REACTANCE       1.21       1.11       1.02         X"q QUAD. AXIS SUBTRANSIENT       0.29       0.26       0.24         XL LEAKAGE REACTANCE       0.10       0.09       0.08         X2 NEGATIVE SEQUENCE       0.23       0.21       0.19         X0 ZERO SEQUENCE       0.10       0.09       0.08         REACTANCES ARE SATURATED       VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED         T'd TRANSIENT TIME CONST.       0.023 s         T'd SUB-TRANSTIME CONST.       0.006 s         T'do O.C. FIELD TIME CONST.       0.43 s         Ta ARMATURE TIME CONST.       0.004 s	kVA BASE RATING FOR REACTANCE VALUES	32.0		32	2.0	32.0						
X"d DIR. AXIS SUBTRANSIENT       0.15       0.14       0.13         Xq QUAD. AXIS REACTANCE       1.21       1.11       1.02         X"q QUAD. AXIS SUBTRANSIENT       0.29       0.26       0.24         XL LEAKAGE REACTANCE       0.10       0.09       0.08         X2 NEGATIVE SEQUENCE       0.23       0.21       0.19         X0 ZERO SEQUENCE       0.10       0.09       0.08         REACTANCES ARE SATURATED       VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED         T'd TRANSIENT TIME CONST.       0.023 s         T"d SUB-TRANSTIME CONST.       0.006 s         T'do O.C. FIELD TIME CONST.       0.43 s         Ta ARMATURE TIME CONST.       0.004 s	Xd DIR. AXIS SYNCHRONOUS	2.44		2	23	2.05						
Xq QUAD. AXIS REACTANCE       1.21       1.11       1.02         X"q QUAD. AXIS SUBTRANSIENT       0.29       0.26       0.24         XL LEAKAGE REACTANCE       0.10       0.09       0.08         X2 NEGATIVE SEQUENCE       0.23       0.21       0.19         X0 ZERO SEQUENCE       0.10       0.09       0.08         REACTANCES ARE SATURATED       VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED         T'd TRANSIENT TIME CONST.       0.023 s         T"d SUB-TRANSTIME CONST.       0.006 s         T'do O.C. FIELD TIME CONST.       0.43 s         Ta ARMATURE TIME CONST.       0.004 s	X'd DIR. AXIS TRANSIENT	0.25		0.:	23	0.21						
X"q QUAD. AXIS SUBTRANSIENT       0.29       0.26       0.24         XL LEAKAGE REACTANCE       0.10       0.09       0.08         X2 NEGATIVE SEQUENCE       0.23       0.21       0.19         X0 ZERO SEQUENCE       0.10       0.09       0.08         REACTANCES ARE SATURATED       VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED         T'd TRANSIENT TIME CONST.       0.023 s         T"d SUB-TRANSTIME CONST.       0.006 s         T'do O.C. FIELD TIME CONST.       0.43 s         Ta ARMATURE TIME CONST.       0.004 s	X''d DIR. AXIS SUBTRANSIENT	0.15		0.	14	0.13						
XL LEAKAGE REACTANCE       0.10       0.09       0.08         X2 NEGATIVE SEQUENCE       0.23       0.21       0.19         X0 ZERO SEQUENCE       0.10       0.09       0.08         REACTANCES ARE SATURATED       VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED         T'd TRANSIENT TIME CONST.       0.023 s         T"d SUB-TRANSTIME CONST.       0.006 s         T'do O.C. FIELD TIME CONST.       0.43 s         Ta ARMATURE TIME CONST.       0.004 s	Xq QUAD. AXIS REACTANCE	1.21		1.	11	1.02						
X2 NEGATIVE SEQUENCE         0.23         0.21         0.19           X0 ZERO SEQUENCE         0.10         0.09         0.08           REACTANCES ARE SATURATED         VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED           T'd TRANSIENT TIME CONST.         0.023 s           T'd SUB-TRANSTIME CONST.         0.006 s           T'do O.C. FIELD TIME CONST.         0.43 s           Ta ARMATURE TIME CONST.         0.004 s	X"q QUAD. AXIS SUBTRANSIENT	0.29		0	26	0.24						
X0 ZERO SEQUENCE 0.10 0.09 0.08  REACTANCES ARE SATURATED VALUES ARE PER UNIT AT RATING AND VOLTAGE INDICATED  T'd TRANSIENT TIME CONST. 0.023 s  T"d SUB-TRANSTIME CONST. 0.006 s  T'do O.C. FIELD TIME CONST. 0.43 s  Ta ARMATURE TIME CONST. 0.004 s	XL LEAKAGE REACTANCE	0.10		0.	09	0.08						
REACTANCES ARE SATURATED  T'd TRANSIENT TIME CONST.  T'd SUB-TRANSTIME CONST.  O.003 s  T'd O.C. FIELD TIME CONST.  O.43 s  Ta ARMATURE TIME CONST.  O.004 s	X2 NEGATIVE SEQUENCE	0.23		0	21	0.19						
T'd TRANSIENT TIME CONST.       0.023 s         T'd SUB-TRANSTIME CONST.       0.006 s         T'do O.C. FIELD TIME CONST.       0.43 s         Ta ARMATURE TIME CONST.       0.004 s	X <sub>0</sub> ZERO SEQUENCE	0.10 0.09 0.08										
T"d SUB-TRANSTIME CONST.         0.006 s           T'do O.C. FIELD TIME CONST.         0.43 s           Ta ARMATURE TIME CONST.         0.004 s	REACTANCES ARE SATUR	RATED	VALU	S ARE PER UNI	T AT RATING AND	VOLTA	GE INDICATED					
T'do O.C. FIELD TIME CONST.  0.43 s  Ta ARMATURE TIME CONST.  0.004 s	T'd TRANSIENT TIME CONST.			0.02	23 s							
Ta ARMATURE TIME CONST. 0.004 s	T"d SUB-TRANSTIME CONST.	0.006 s										
	T'do O.C. FIELD TIME CONST.			0.4	3 s							
SHORT CIRCUIT RATIO 1/Xd	Ta ARMATURE TIME CONST.			0.00	04 s							
	SHORT CIRCUIT RATIO			1/2	Xd							




# Winding 06

## SINGLE PHASE EFFICIENCY CURVES

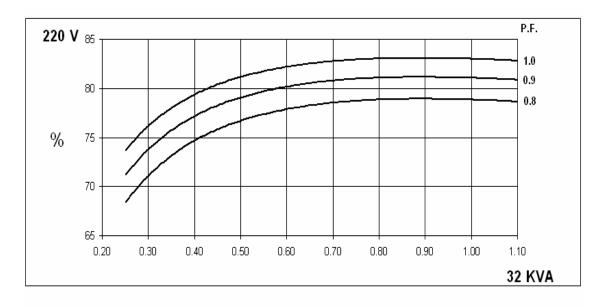

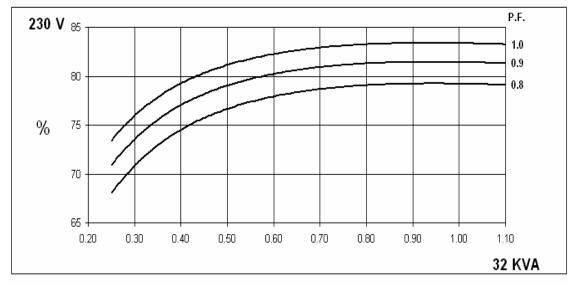


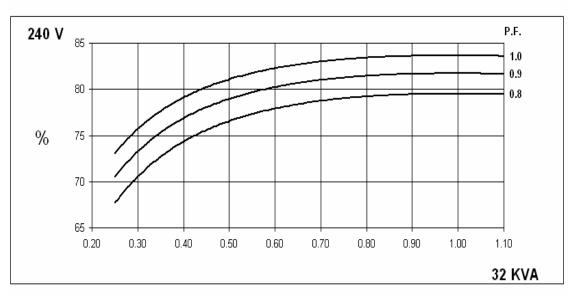




# Winding 06 Locked Rotor Motor Starting Curves

# **AS480 AVR Without EBS**

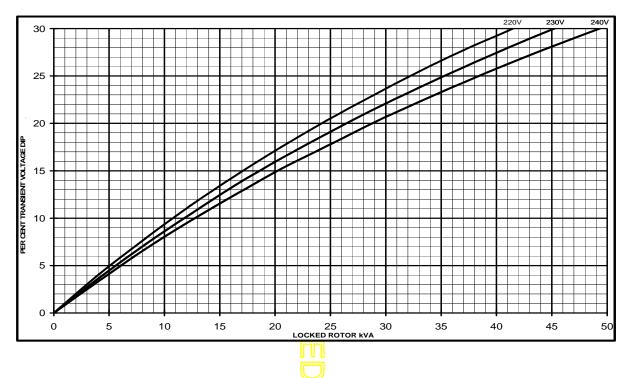


# AS480 AVR With EBS

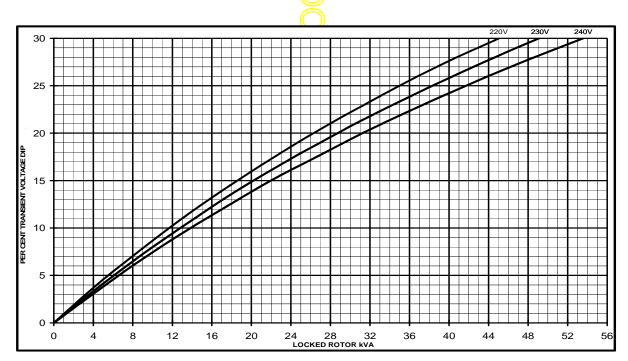

# **STAMFORD**

# Winding 06

# Short Circuit Decrement Curve. No-load Excitation at Rated Speed Based on series connection. WITH EBS FITTED

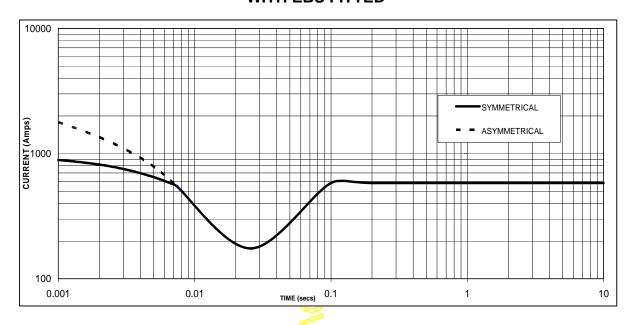

Sustained Short Circuit = 582 Amps

#### Note

The following multiplication factors' should be used to adjust the values from curve between time 0.001 seconds and the minimum current point in respect of nominal operating voltage:

	(( ))
Voltage	Factor
220V	X 1.00
230V	X 1 <mark>.05</mark>
240V	X 1.09

The sustained current value is constant irrespective of voltage level

# **STAMFORD**

# **PI142H**

# Winding 06


# **60**Hz

# **RATINGS**

Class Town Biss	Cont. F - 105/40°C		Cont. H - 125/40°C			Standby - 150/40°C			Standby - 163/27°C			
Class - Temp Rise	0.8pf			0.8pf			0.8pf			0.8pf		
Series (V)	220	230	240	220	230	240	220	230	240	220	230	240
Parallel (V)	110	115	120	110	115	120	110	115	120	110	115	120
kVA	28.8	28.8	28.8	32.0	32.0	32.0	34.5	34.5	34.5	35.2	35.2	35.2
kW	23.0	23.0	23.0	25.6	25.6	25.6	27.6	27.6	27.6	28.2	28.2	28.2
Efficiency (%)	78.9	79.2	79.5	78.8	79.2	79.5	78.7	79.1	79.5	78.6	79.1	79.4
kW Input	29.2	29.0	28.9	32.5	32.3	32.2	35.1	34.9	34.7	35.9	35.7	35.5

Class Town Biss	Cont. F - 105/40°C			Cont. H -125/40°C			Standby - 150/40°C			Standby - 163/27°C		
Class - Temp Rise	1.0pf			1. <mark>0p</mark> f			1.0pf			1.0pf		
Series (V)	220	230	240	220	230	240	220	230	240	220	230	240
Parallel (V)	110	115	120	110	115	120	110	115	120	110	115	120
kVA	28.8	28.8	28.8	32.0	32.0	32.0	34.5	34.5	34.5	35.2	35.2	35.2
kW	28.8	28.8	28.8	32.0	32.0	32.0	34.5	34.5	34.5	35.2	35.2	35.2
Efficiency (%)	83.1	83.4	83.6	83.0	83.4	83.6	82.9	83.3	83.6	82.8	83.2	83.6
kW Input	34.7	34.5	34.4	38.6	38.4	38.3	41.6	41.4	41.3	42.5	42.3	42.1

# DIMENSIONS

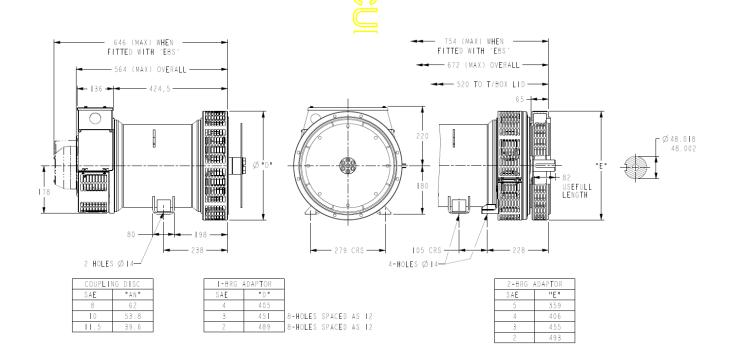

# APPROVED DOCUMENT

# **STAMFORD**

Head Office Address: Barnack Road, Stamford Lincolnshire, PE9 2NB United Kingdom

Tel: +44 (0) 1780 484000 Fax: +44 (0) 1780 484100

www.cumminsgeneratortechnologies.com

Copyright 2010, Cummins Generator Technologies Ltd, All Rights Reserved Stamford and AvK are registered trade marks of Cummins Generator Technologies Ltd Cummins and the Cummins logo are registered trade marks of Cummins Inc.