


S7L1M-G4 Wdg.26 - Technical Data Sheet

Standards

STAMFORD industrial alternators meet the requirements of the relevant parts of the IEC EN 60034 and the relevant section of other international standards such as BS5000, VDE 0530, NEMA MG1-32, IEC34, CSA C22.2-100 and AS1359. Other standards and certifications can be considered on request.

Quality Assurance

Alternators are manufactured using production procedures having a quality assurance level to BS EN ISO 9001.

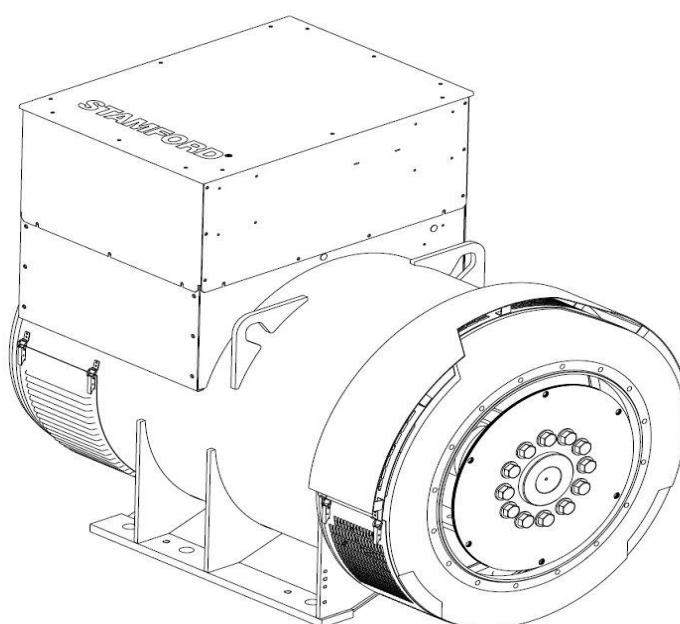

Excitation and Voltage Regulators

Excitation System					
AVR Type	MX322	DECS100	DECS150		
Voltage Regulation	± 0.5%	± 0.25%	± 0.25%		with 4% Engine Governing
AVR Power	PMG	PMG	PMG		

No Load Excitation Voltage (V)	17.44
No Load Excitation Current (A)	0.78
Full Load Excitation Voltage (V)	70
Full Load Excitation Current (A)	3.1
Exciter Time Constant (seconds)	0.125

STAMFORD®

S7L1M-G4 Wdg.26

Electrical Data		
Insulation System	H	
Stator Winding	Double Layer Concentric	
Winding Pitch	2/3	
Winding Leads	6	
Winding Number	26	
Number of Poles	4	
IP Rating	IP23	
RFI Suppression	BS EN 61000-6-2 & BS EN 61000-6-4, VDE 0875G, VDE 0875N. Refer to factory for others	
Waveform Distortion	NO LOAD < 1.5% NON-DISTORTING BALANCED LINEAR LOAD < 5.0%	
Short Circuit Ratio	1/Xd	
Steady State X/R Ratio	30.09	
50 Hz		
Telephone Interference	THF < 2%	
Cooling Air Flow	2.39 m³/sec	
Voltage Star (V)	660	690
Voltage Parallel Star (V)	-	-
Voltage Delta (V)	-	-
kVA Base Rating (Class H) for Reactance Values (kVA)	1830	1830
Saturated Values in Per Unit at Base Ratings and Voltages		
Xd Dir. Axis Synchronous	1.99	1.82
X'd Dir. Axis Transient	0.16	0.14
X''d Dir. Axis Subtransient	0.10	0.09
Xq Quad. Axis Reactance	1.68	1.54
X''q Quad. Axis Subtransient	0.18	0.17
XL Stator Leakage Reactance	0.06	0.06
X2 Negative Sequence Reactance	0.14	0.13
X0 Zero Sequence Reactance	0.03	0.03
Unsaturated Values in Per Unit at Base Ratings and Voltages		
Xd Dir. Axis Synchronous	2.39	2.19
X'd Dir. Axis Transient	0.18	0.16
X''d Dir. Axis Subtransient	0.12	0.11
Xq Quad. Axis Reactance	1.73	1.59
X''q Quad. Axis Subtransient	0.22	0.20
XL Stator Leakage Reactance	0.07	0.07
Xlr Rotor Leakage Reactance	0.18	0.16
X2 Negative Sequence Reactance	0.17	0.15
X0 Zero Sequence Reactance	0.04	0.03

STAMFORD

S7L1M-G4 Wdg.26



Time Constants (Seconds)		
T'd Transient Time Const.	0.156	
T''d Sub-Transient Time Const.	0.015	
T'do O.C. Field Time Const.	4.630	
Ta Armature Time Const.	0.034	
T''q Sub-Transient Time Const.	0.0102	
Resistances in Ohms (Ω) at 22°C		
Stator Winding Resistance (Ra), per phase for series connected	0.00202	
Rotor Winding Resistance (Rf)	2.15	
Exciter Stator Winding Resistance	22.3	
Exciter Rotor Winding Resistance per phase	0.065	
PMG Phase Resistance (Rpmg) per phase	1.91	
Positive Sequence Resistance (R1)	0.0025	
Negative Sequence Resistance (R2)	0.0029	
Zero Sequence Resistance (R0)	0.0025	
Saturation Factors		
	690V	
SG1.0	0.228	
SG1.2	2.369	
Mechanical Data		
Shaft and Keys	All alternator rotors are dynamically balanced to better than BS6861: Part 1 Grade 2.5 for minimum vibration in operation. Two bearing generators are balanced with a half key.	
	1 Bearing	2 Bearing
SAE Adaptor	SAE 0, 00	SAE 0, 00
Moment of Inertia	45.47 kgm ²	44.44 kgm ²
Weight Wound Stator	1725kg	1725kg
Weight Wound Rotor	1488kg	1445kg
Weight Complete Alternator	3637kg	3604kg
Shipping weight in a Crate	3689kg	3656kg
Packing Crate Size	220 x 105 x 155(cm)	220 x 105 x 155(cm)
Maximum Over Speed	2250 RPM for two minutes	
Bearing Drive End	-	BALL. 6232
Bearing Non-Drive End	BALL. 6319	BALL. 6319

STAMFORD®

S7L1M-G4 Wdg.26

THREE PHASE EFFICIENCY CURVES

50Hz

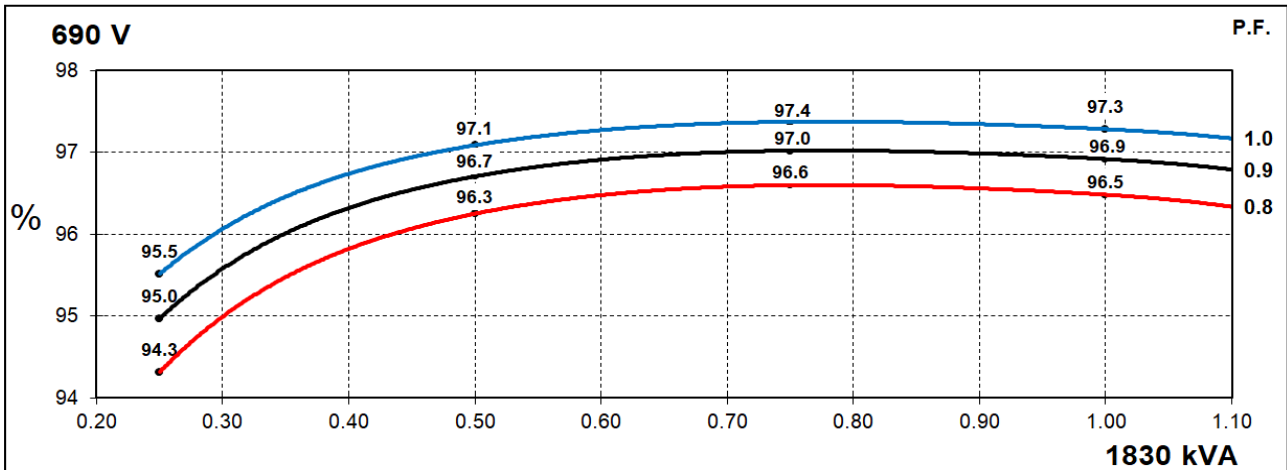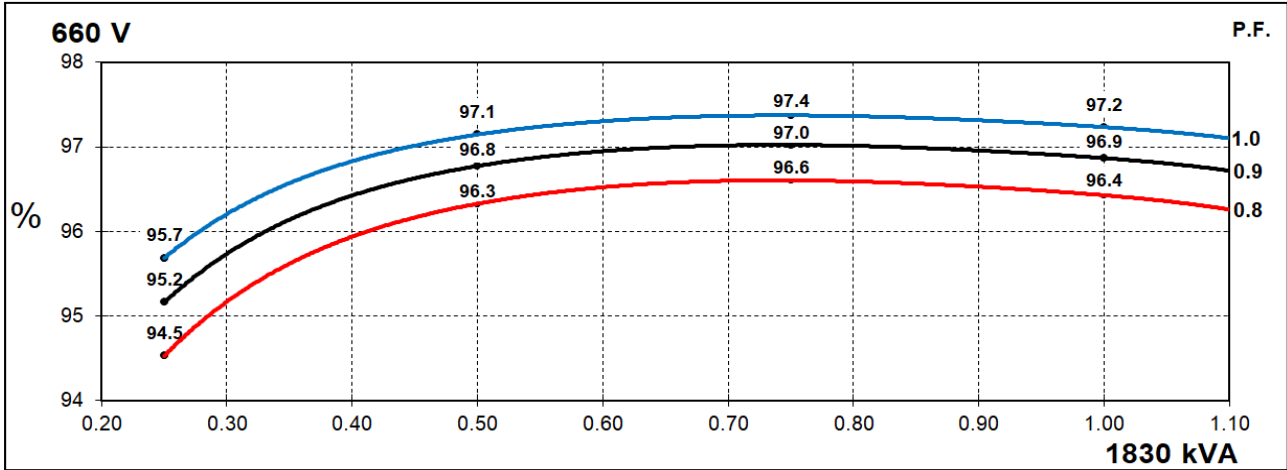


STAMFORD

S7L1M-G4 Wdg.26

Locked Rotor Motor Starting Curves - Separately Excited

50Hz

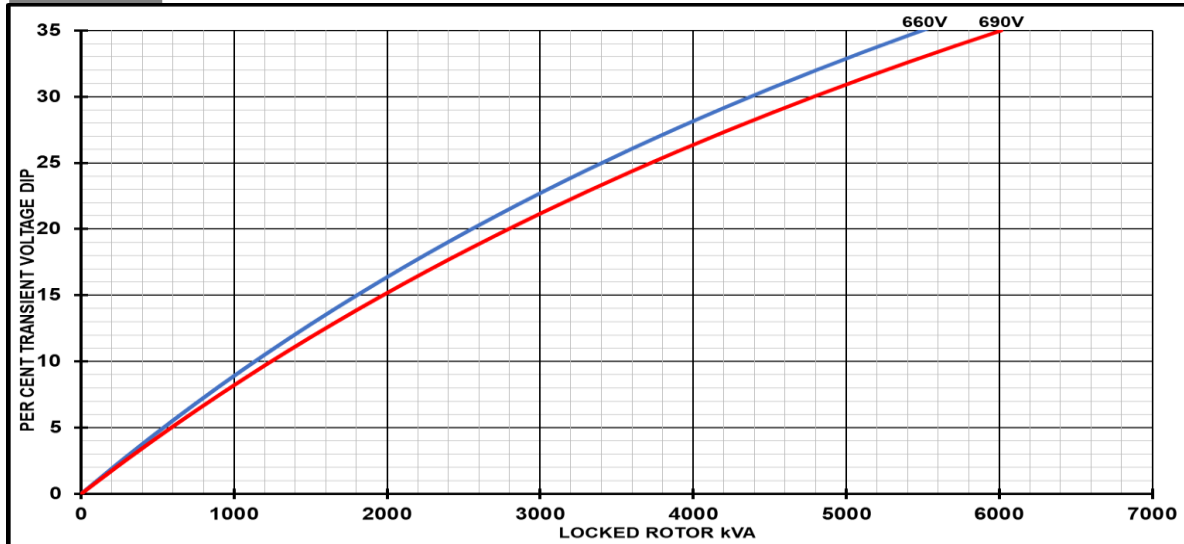

Transient Voltage Dip Scaling Factor		Transient Voltage Rise Scaling Factor	
Lagging PF	Scaling Factor	Lagging PF	Scaling Factor
<= 0.4	1.00	<= 0.4	1.25
0.5	0.95	0.5	1.20
0.6	0.90	0.6	1.15
0.7	0.86	0.7	1.10
0.8	0.83	> 0.7	1.00
0.9	0.75		
0.95	0.70		
1	0.65		


Note: To determine % Transient Voltage Dip or Voltage Rise at various PF, multiply the % Voltage Dip from the curve directly by the Scaling Factor.

STAMFORD®

S7L1M-G4 Wdg.26

Three-phase Short Circuit Decrement Curve - Separately Excited

50Hz

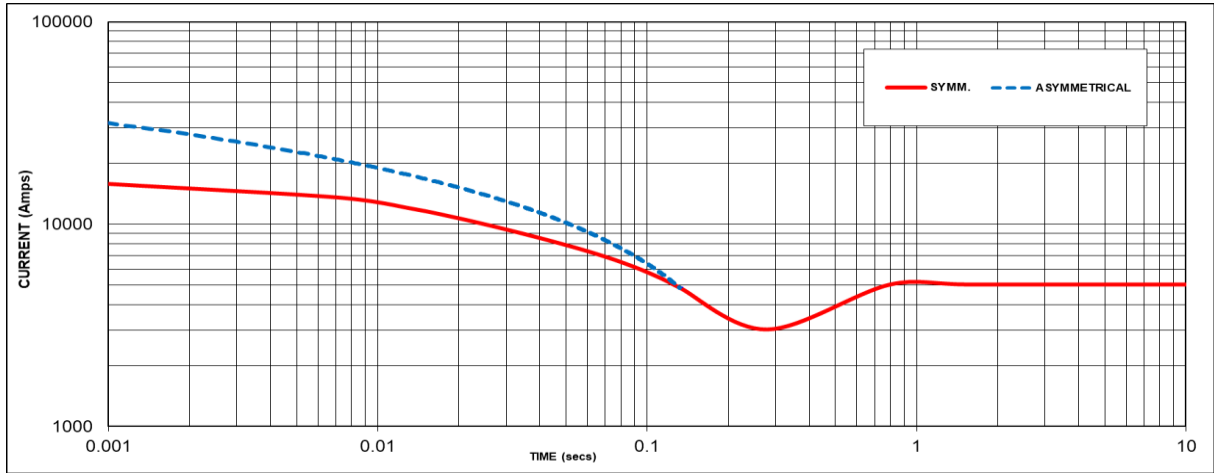

Sustained Short Circuit = 5028 Amps

Note 1

The following multiplication factors should be used to adjust the values from curve between time 0.001 seconds and the minimum current point in respect of nominal operating voltage :

50Hz		60Hz	
Voltage	Factor	Voltage	Factor
660V	X 1.00	-	-
690V	X 1.05	-	-
-	-	-	-
-	-	-	-

The sustained current value is constant irrespective of voltage level

Note 2

The following multiplication factor should be used to convert the values calculated in accordance with NOTE 1 to those applicable to the various types of short circuit :

	3-phase	2-phase L-L	1-phase L-N
Instantaneous	x 1.00	x 0.87	x 1.30
Minimum	x 1.00	x 1.80	x 3.20
Sustained	x 1.00	x 1.50	x 2.50
Max. sustained duration	10 sec.	5 sec.	2 sec.

Note 3

All other times are unchanged

Curves are drawn for Star connections under no-load excitation at rated speeds. For other connection (where applicable) the following multipliers should be applied to current values as shown :

Parallel Star = Curve current value X 2


Series Delta = Curve current value X 1.732

STAMFORD®

S7L1M-G4 Wdg.26

Typical Alternator Operating Charts

690V/50Hz

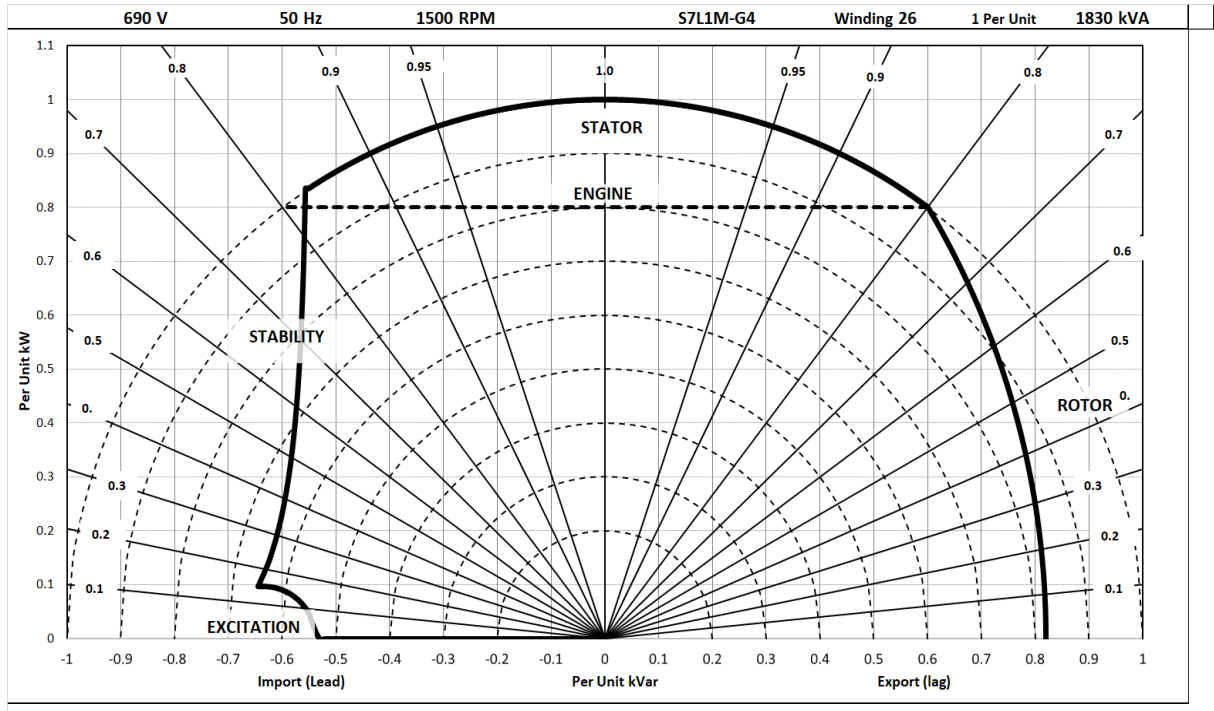

STAMFORD®

S7L1M-G4 Wdg.26

RATINGS AT 0.8 POWER FACTOR

Class - Temp Rise		Standby		Cont. H - 110/50°C		Cont. F - 90/50°C		Cont. B - 70/50°C	
50 Hz	Star (V)	660	690	660	690	660	690	660	690
	Parallel Star (V)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	Delta (V)	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A
	kVA	N/A	N/A	1830	1830	1690	1690	1500	1500
	kW	N/A	N/A	1464	1464	1352	1352	1200	1200
	Efficiency (%)	N/A	N/A	96.4	96.5	96.5	96.6	96.6	96.6
	kW Input	N/A	N/A	1518	1517	1401	1400	1242	1242

60 Hz	Star (V)	N/A	N/A	N/A	N/A	N/A
	Parallel Star (V)	N/A	N/A	N/A	N/A	N/A
	Delta (V)	N/A	N/A	N/A	N/A	N/A
	kVA	N/A	N/A	N/A	N/A	N/A
	kW	N/A	N/A	N/A	N/A	N/A
	Efficiency (%)	N/A	N/A	N/A	N/A	N/A
	kW Input	N/A	N/A	N/A	N/A	N/A

De-rates

All values tabulated above are subject to the following reductions:

- 5% when air inlet filters are fitted
- 3% for every 500 meters by which the operating altitude exceeds 1000 meters above mean sea level
- 3% for every 5°C by which the operational ambient temperature exceeds 40°C @ Class H temperature rise (please refer to applications for ambient temperature de-rates at other temperature rise classes)
- For any other operating conditions impacting the cooling circuit please refer to applications

Note: Requirement for operating in an ambient exceeding 60°C and altitude exceeding 4000 meters (for <690V) or 1500 meters (for >690V) must be referred to applications.

Dimensional and Torsional Drawing

For dimensional and torsional information please refer to the alternator General Arrangement and rotor drawings available on our website (<http://stamford-avk.com/>)

Note: Continuous development of our products means that the information contained in our data sheets can change without notice, and specifications should always be confirmed with Cummins Generator Technologies prior to purchase.



Follow us @stamfordavk



Cummins Generator Technologies



View our videos at youtube.com/stamfordavk

news.stamford-avk.com

**For Applications Support:
applications@cummins.com**

**For Customer Service:
emea.service@cummins.com**

**For General Enquiries:
Stamford-avk@cummins.com**

Copyright 2016. Cummins Generator Technologies Ltd. All rights reserved.
Cummins and the Cummins logo are registered trade marks of Cummins Inc.
STAMFORD is a registered trade mark of Cummins Generator Technologies Ltd.

