



## Technical Data Sheet for AvK-Alternators

FM 7.3-5

Date:	09/01/14	Customer:	GENERIC DATASHEET only
Project No.:		AvK Reference:	dig130k_6_50_10500_A048N009

### Object data:

Site:	Prime Mover:
Application: Stationary Power Plant	Manufacturer:

### Generator data:

Generator:	DIG 130 k/6	Poles:	6	Standards: IEC 60034
Rated power:	2100 kVA	1680 kWe	1755 kWm	
Power factor:	0.80			
Power at pf 1,0	1699 kVA	1699 kWe	1755 kWm	
Rated voltage:	10.5 kV			
Speed:	1000 1/min			
Frequency:	50 Hz		Voltage range / frequency range:	
Rated current:	115.5 A		Zone A according IEC 60034-1 (dU = +/-5%, df = +/-2%)	

Winding pitch:	ca. 5/6			
----------------	---------	--	--	--

Insulation class:	Stator: Class F	Rotor: Class F	Temperature rise:	F
-------------------	-----------------	----------------	-------------------	---

Ambient temperature:	Environment:
40 ° C	Standard environment

Site altitude:	Filter:
1000 m	

Enclosure:	IP23			
------------	------	--	--	--

Cooling:	IC 01 - Open-circuit ventilation			
----------	----------------------------------	--	--	--

Coolant:	Ambient Air	Temperature	40 ° C	Temperature Air inlet	40 ° C
----------	-------------	-------------	--------	-----------------------	--------

	Coolant:	Cooling air vol.:	2.5 m³/s	Cooling water quantity:	n/a
--	----------	-------------------	----------	-------------------------	-----

Moment of inertia (I):	144 kgm²	Weight:	7500 Kg	Losses (environment):	75 KW
------------------------	----------	---------	---------	-----------------------	-------

	Losses (cooling):	n/a			
--	-------------------	-----	--	--	--

Wires:	4 terminals, starpoint connected in terminal box			
--------	--	--	--	--

Operation mode:	Single mode			
-----------------	-------------	--	--	--

Regulators:				
-------------	--	--	--	--

Voltage regulator:	DECS 100			
--------------------	----------	--	--	--

### Electrical data: (acc. IEC)

Efficiencies:	110%	100%	75%	50%	25%
Power factor 0.8	95,49	95,7	95,7	95,3	93,2
Power factor 0.9	96,07	96,25	96,2	95,7	93,5
Power factor 1.0	96,64	96,8	96,7	96,1	93,8

### Reactances and time constants

	unsaturated		saturated			unsaturated		saturated			unsaturated		saturated	
$X_d$	1.70	1.53 p.u.	$X_q$	0.85	0.83 p.u.	$T_{d0'}$	2.1 s	$T_{d0''}$	0.02417 s					
$X_d'$	0.290	0.290 p.u.	$X_q'$	0.85	0.83 p.u.	$T_{d'}$	0.36 s	$T_{q0'}$	0.3 s					
$X_d''$	0.198	0.180 p.u.	$X_q''$	0.198	0.198 p.u.	$T_{d''}$	0.015 s	$T_{q0''}$	0.12879 s					
$X_2$	0.208	0.189 p.u.	$X_0$	0.059	0.054 p.u.	$T_a$	0.055 s	$T_{q'}$	0.3 s					
$X_{1s}$	n.a.	0.108 p.u.						$T_{q''}$	0.03 s					

Short circuit ratio saturated: 0.65	Z <sub>n</sub> 52.500 Ohm
-------------------------------------	---------------------------

### Short circuit data:

Initial short circuit current (3-phase):	$I_{k''}$	642 A	
Max. peak current (3-phase):	$I_s$	1634 A	
Sustained short circuit current:	$I_k$	346 A	Minimum 3 x rated current for max.10 s
Initial short circuit torque:	$M_{k2}$	144.8 kNm	
	$M_{k3}$	86.9 kNm	
Max. faulty synchron moment:	$M_f$	311.3 kNm	
Rated kVA torque:	$M_{SN}$	20.06 kNm	
Rated torque	$M_N$	16.05 kNm	
Shaft torque	$M_{Sh}$	16.77 kNm	


### Load application:

max. load application: 1086 kVA (corresponds to 51,72 % from 2100 kVA) for Power factor 0.4 15% transient voltage drop	Power: 2100 kVA Power factor: 0.8 transient voltage drop: -22.5 %
---	---

### Remarks:

<b>Alternator :</b>	<b>DIG 130 k/6</b>		
Rated output [kVA]	2100	Rated power factor:	0.8
Rated frequency [Hz]	50	Rated speed [rpm]	1000
			Rated voltage [kV]: 10.5


### Wirkungsgrad-Kennlinie - Efficiency Curve

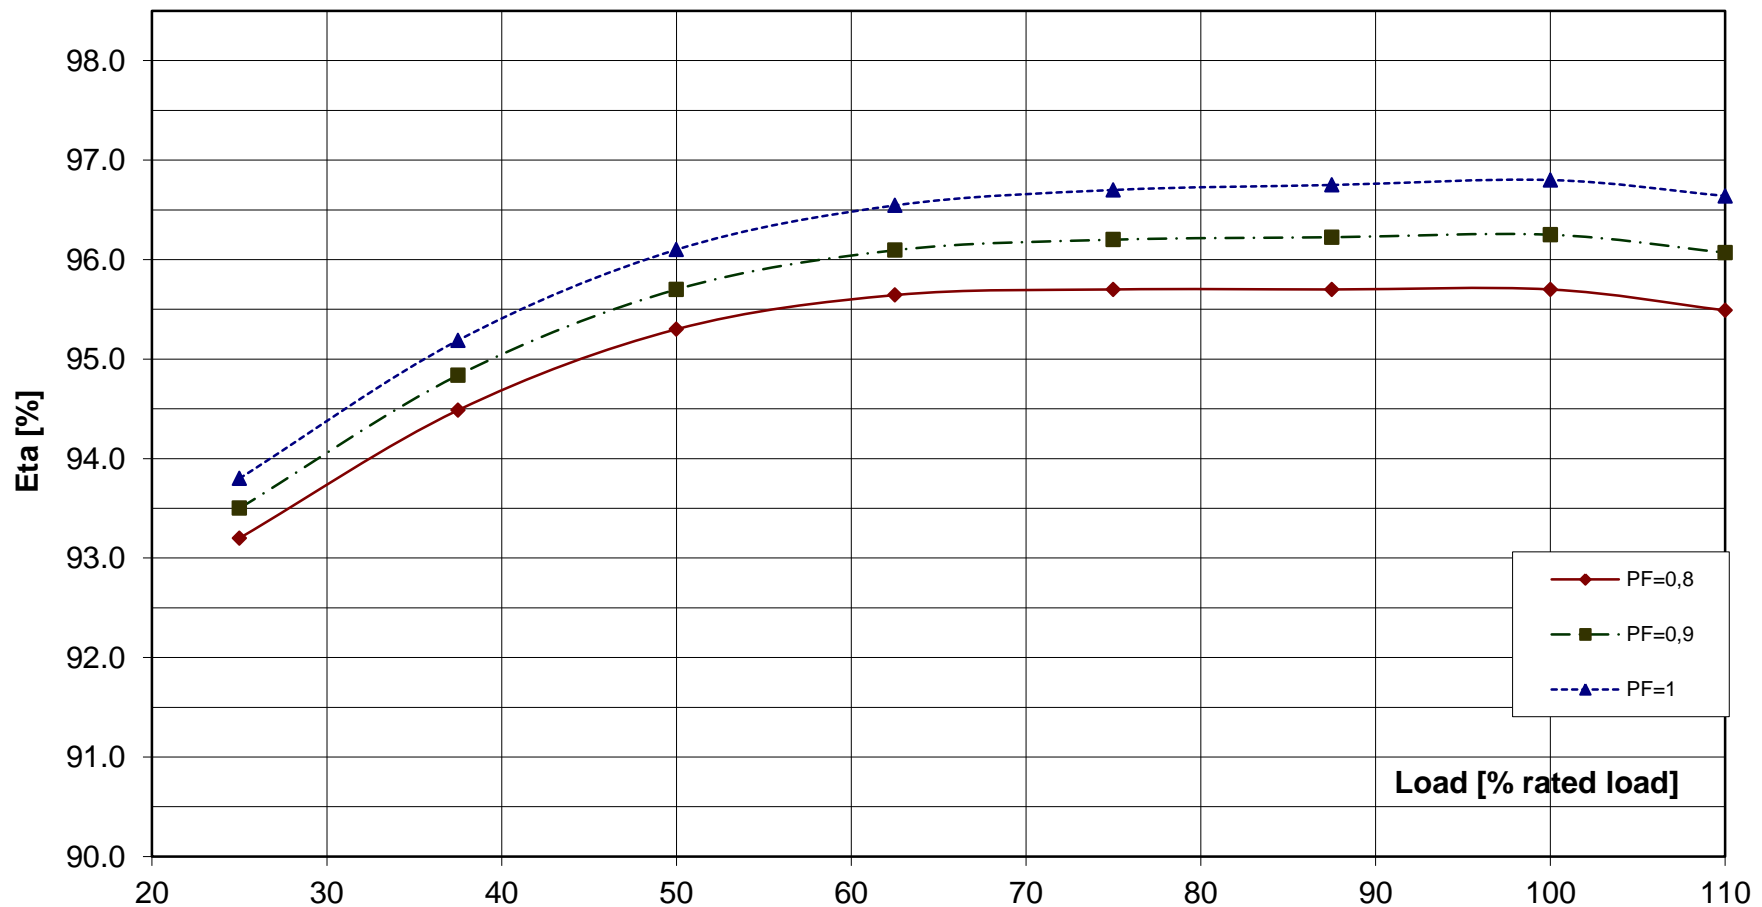

**Alternator : DIG 130 k/6**

Rated output [kVA]	2100	Rated power factor:	0.8	Rated voltage [kV]:	10.5
Rated frequency [Hz]	50	Rated speed [rpm]	1000		

**Transient Voltage rise or drop for sudden load removal or application**

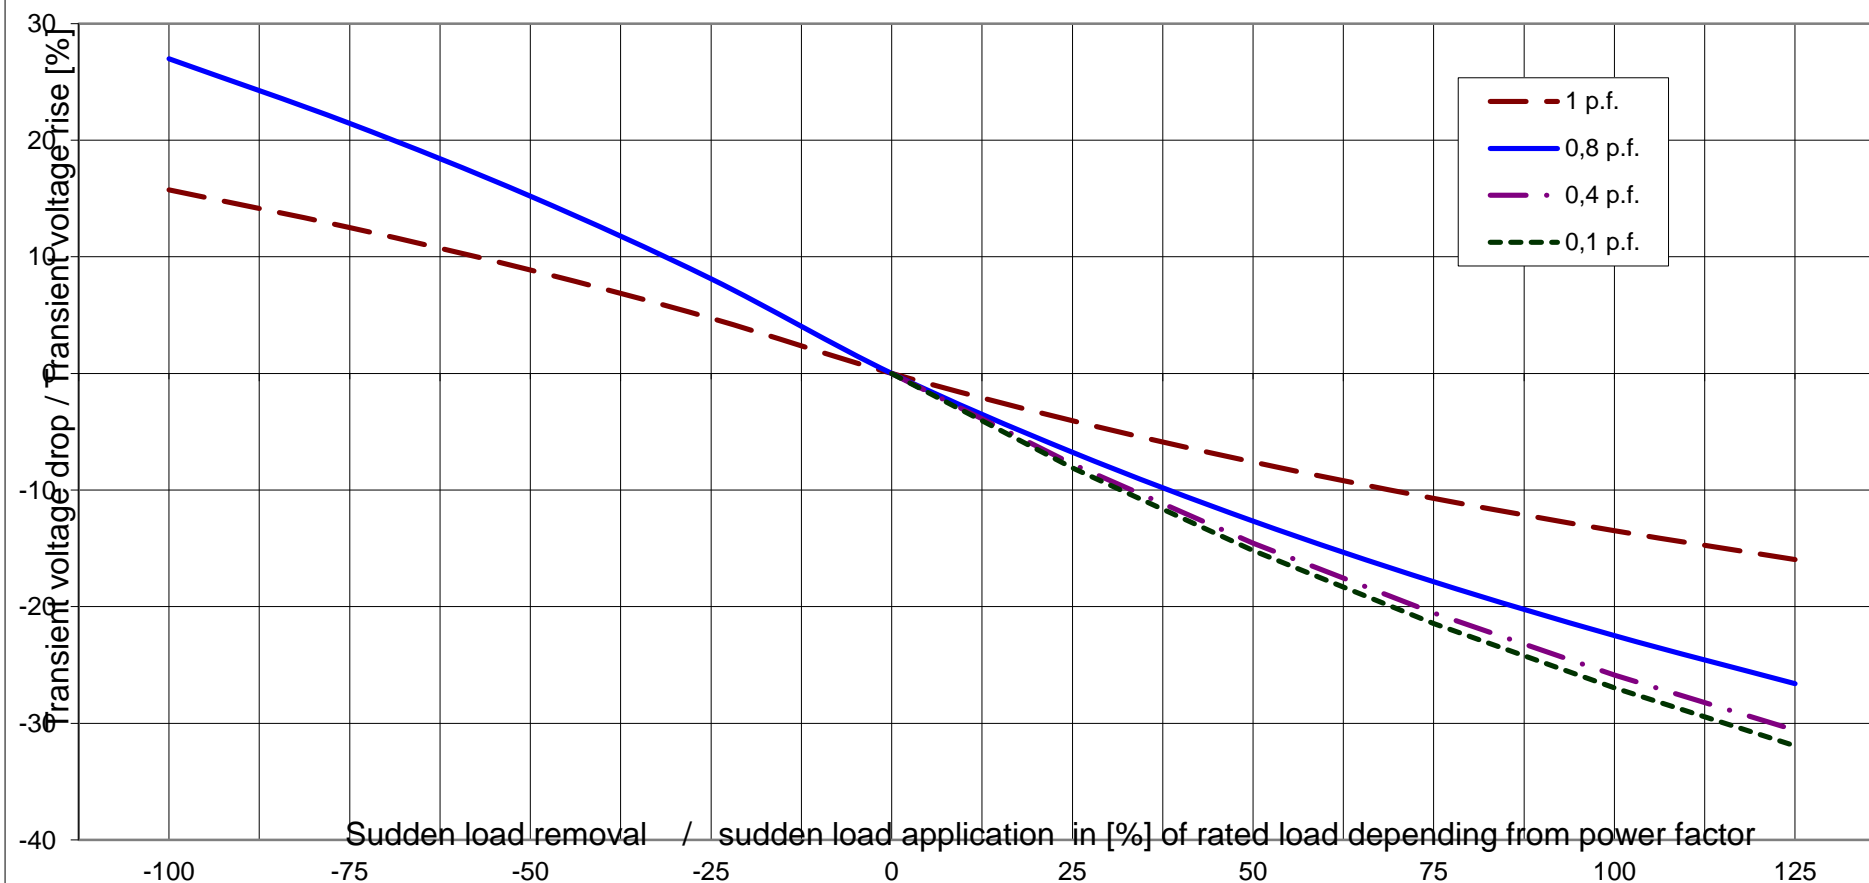




Technisches Datenblatt - Diagramme  
Technical data sheet - Diagrams

ING-FCD-0112

Alternator : **DIG 130 k/6**

Rated output [kVA]	2100	Rated power factor:	0.8	Rated voltage [kV]:	10.5
Rated frequency [Hz]	50	Rated speed [rpm]	1000	MSN related to kVA:	20.05 KNm

Kurzschlußmomenten-Verlauf 2-poliger KS  
Short circuit torque at 2-phase SC

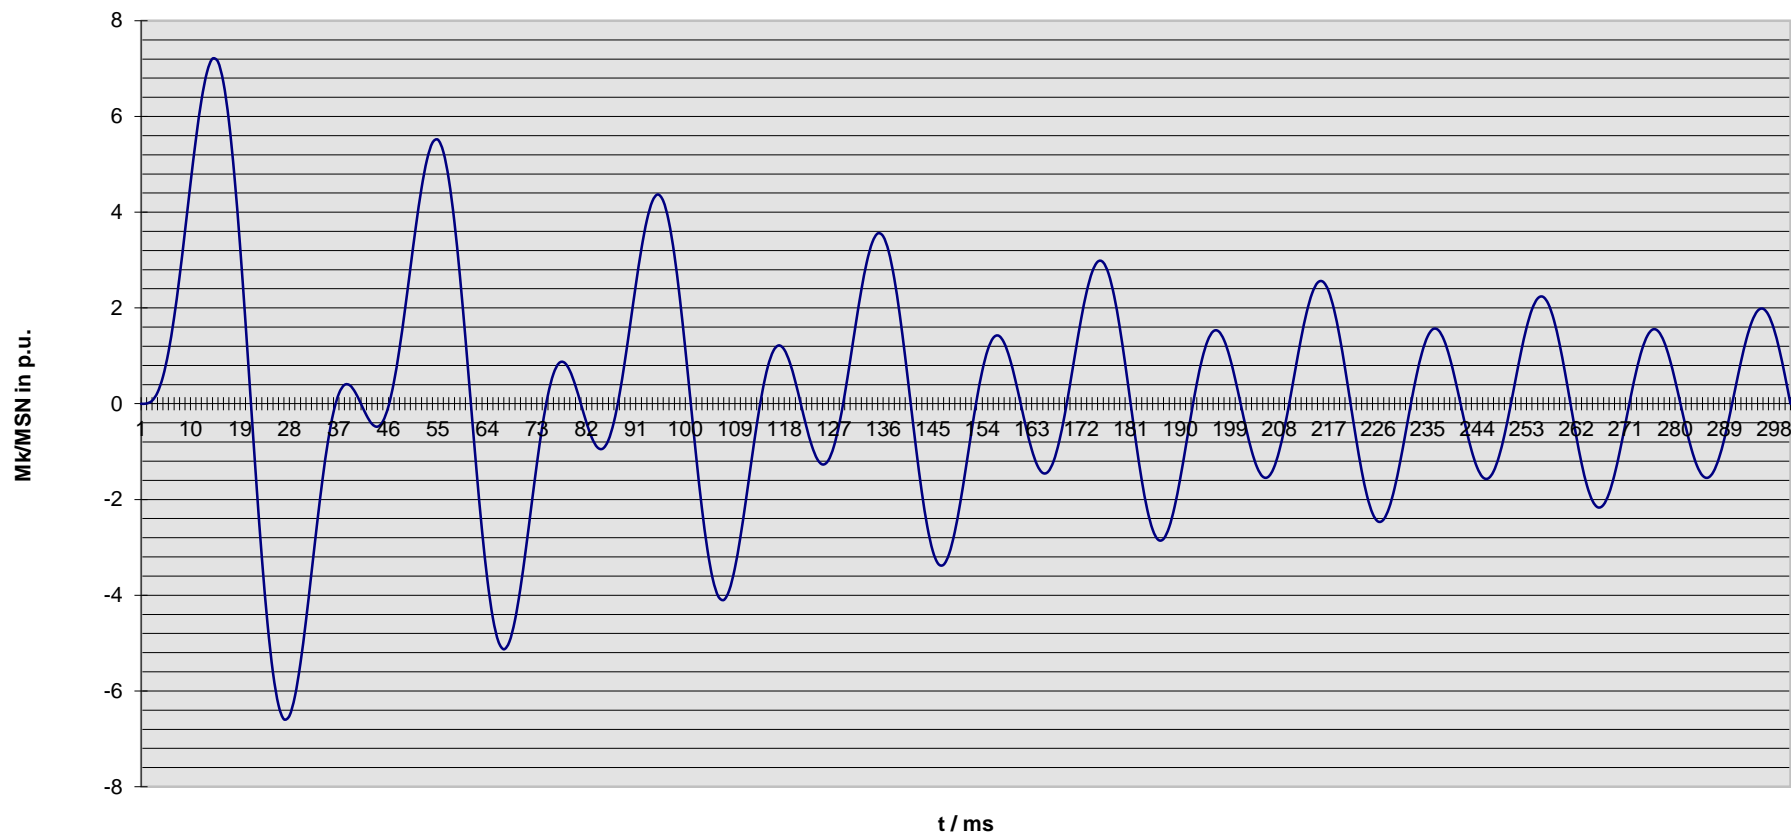

**Nenndaten / nominal data**

**DIG 130 k/6**

Leistung  $S_N$ : **2100 kVA**

$\cos \varphi$ : **0.80**

*Rating*

*p.f.*

Spannung  $U_N$ : **10.50 kV**

Strom  $I_N$ : **115 A**

*Voltage*

*Current*

Frequenz  $f$ : **50 Hz**

Drehzahl  $n$ : **1,000 min<sup>-1</sup>**

*Frequency*


*Speed*

Schutzart **IP23**

*Protection*

**Kurzschlussstrom  $I_{k3\text{phasig}} / I_N$  [p.u.]**  
**Short-circuit current  $I_{k3\text{phase}} / I_N$  [p.u.]**

**Stosskurzschluss-Strom, 3-phasig, asymmetrisch /**  
*Sudden short circuit current, 3-phase, asymmetrical*

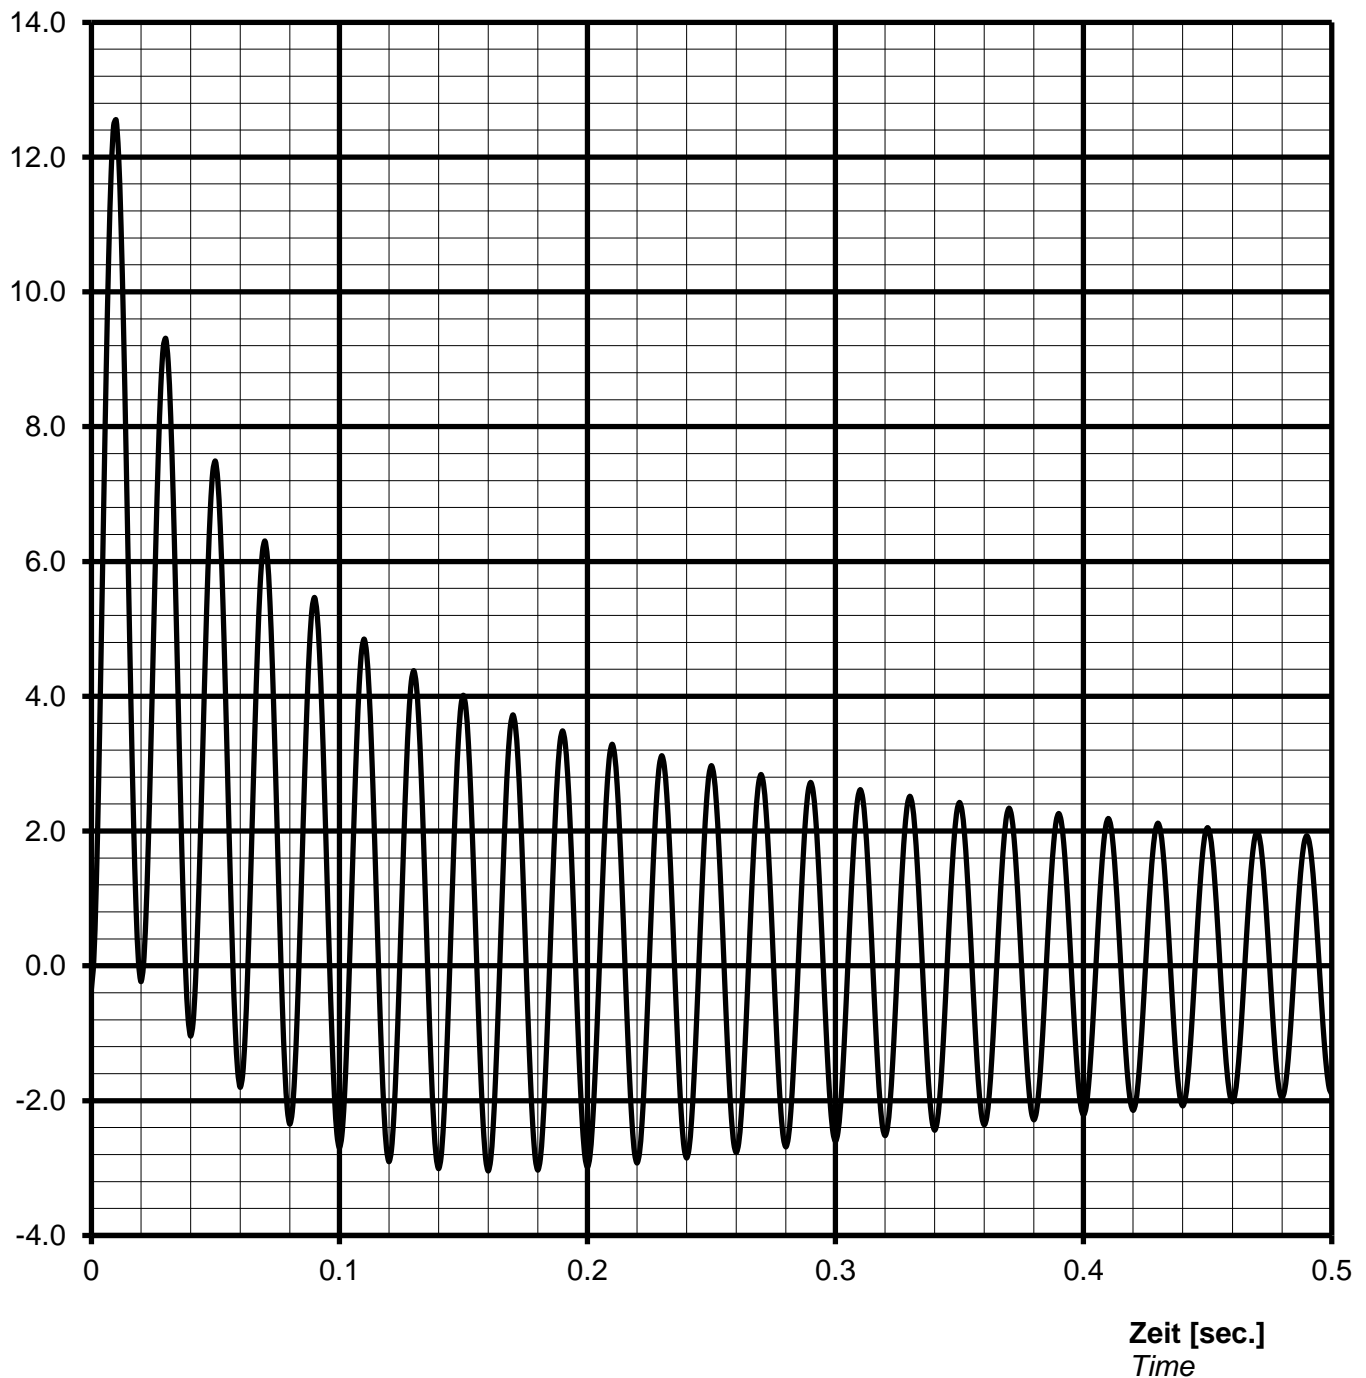

**Notizen / remarks:**

**Maximum asymmetric peak value  $I_{\text{peak}} = 1449 \text{ A}$  or  $12.55 \text{ p.u.}$**

#### Nennwerten / nominal data

DIG 130 k/6

Leistung  $S_N$ : **2100** kVA

$\cos \varphi$ : **0.80**

Rating

p.f.

Spannung  $U_N$ : **10.50** kV

Strom  $I_N$ : **115** A

Voltage

Current

Frequenz f: **50** Hz

Drehzahl n: **1000** min<sup>-1</sup>


Frequency

Speed

Schutzart **IP23**

Protection

#### Überlast Kennlinie Overload capability

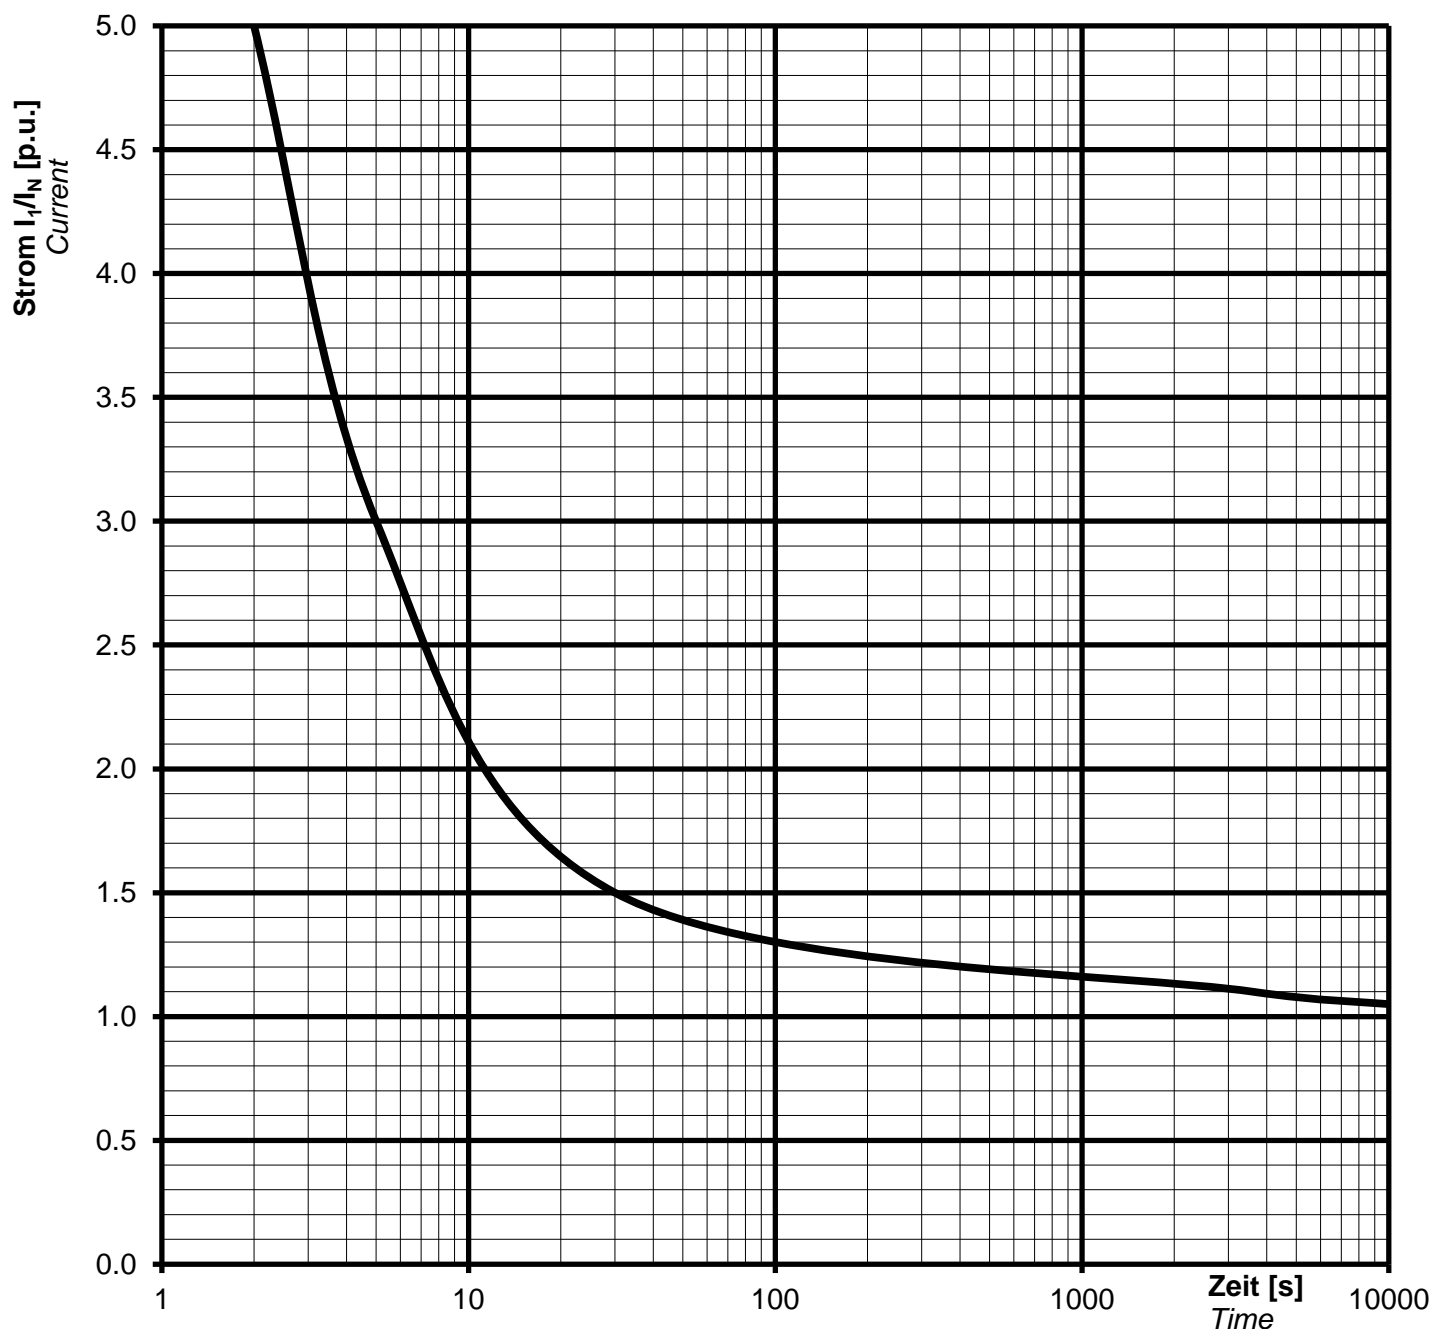

#### Notizen / remarks:

Strom / Zeit Kriterien:

$$(I / I_N)^2 \cdot t = 45s$$

Current/time characteristics:

1,5 \*  $I_N$  for 30 s

1,1 \*  $I_N$  for 1 h in 6h

#### Nennwerten / nominal data

**DIG 130 k/6**

Rating  $S_N$ : **2100 kVA**

*p.f.* **0.80**

*Bemessungsleistung*

Leistungsfaktor  $\cos \varphi$ :

Nominal voltage  $U_N$ : **10.50 kV**

Nominal current  $I_N$ : **115 A**

*Bemessungsspannung*

*Bemessungsstrom*

Frequency  $f_N$ : **50 Hz**

Speed  $n$ : **1000 min<sup>-1</sup>**


*Frequenz*

*Drehzahl*

Protection: **IP23**

*Schutzart*

#### Inverse current or unbalanced negative sequence current

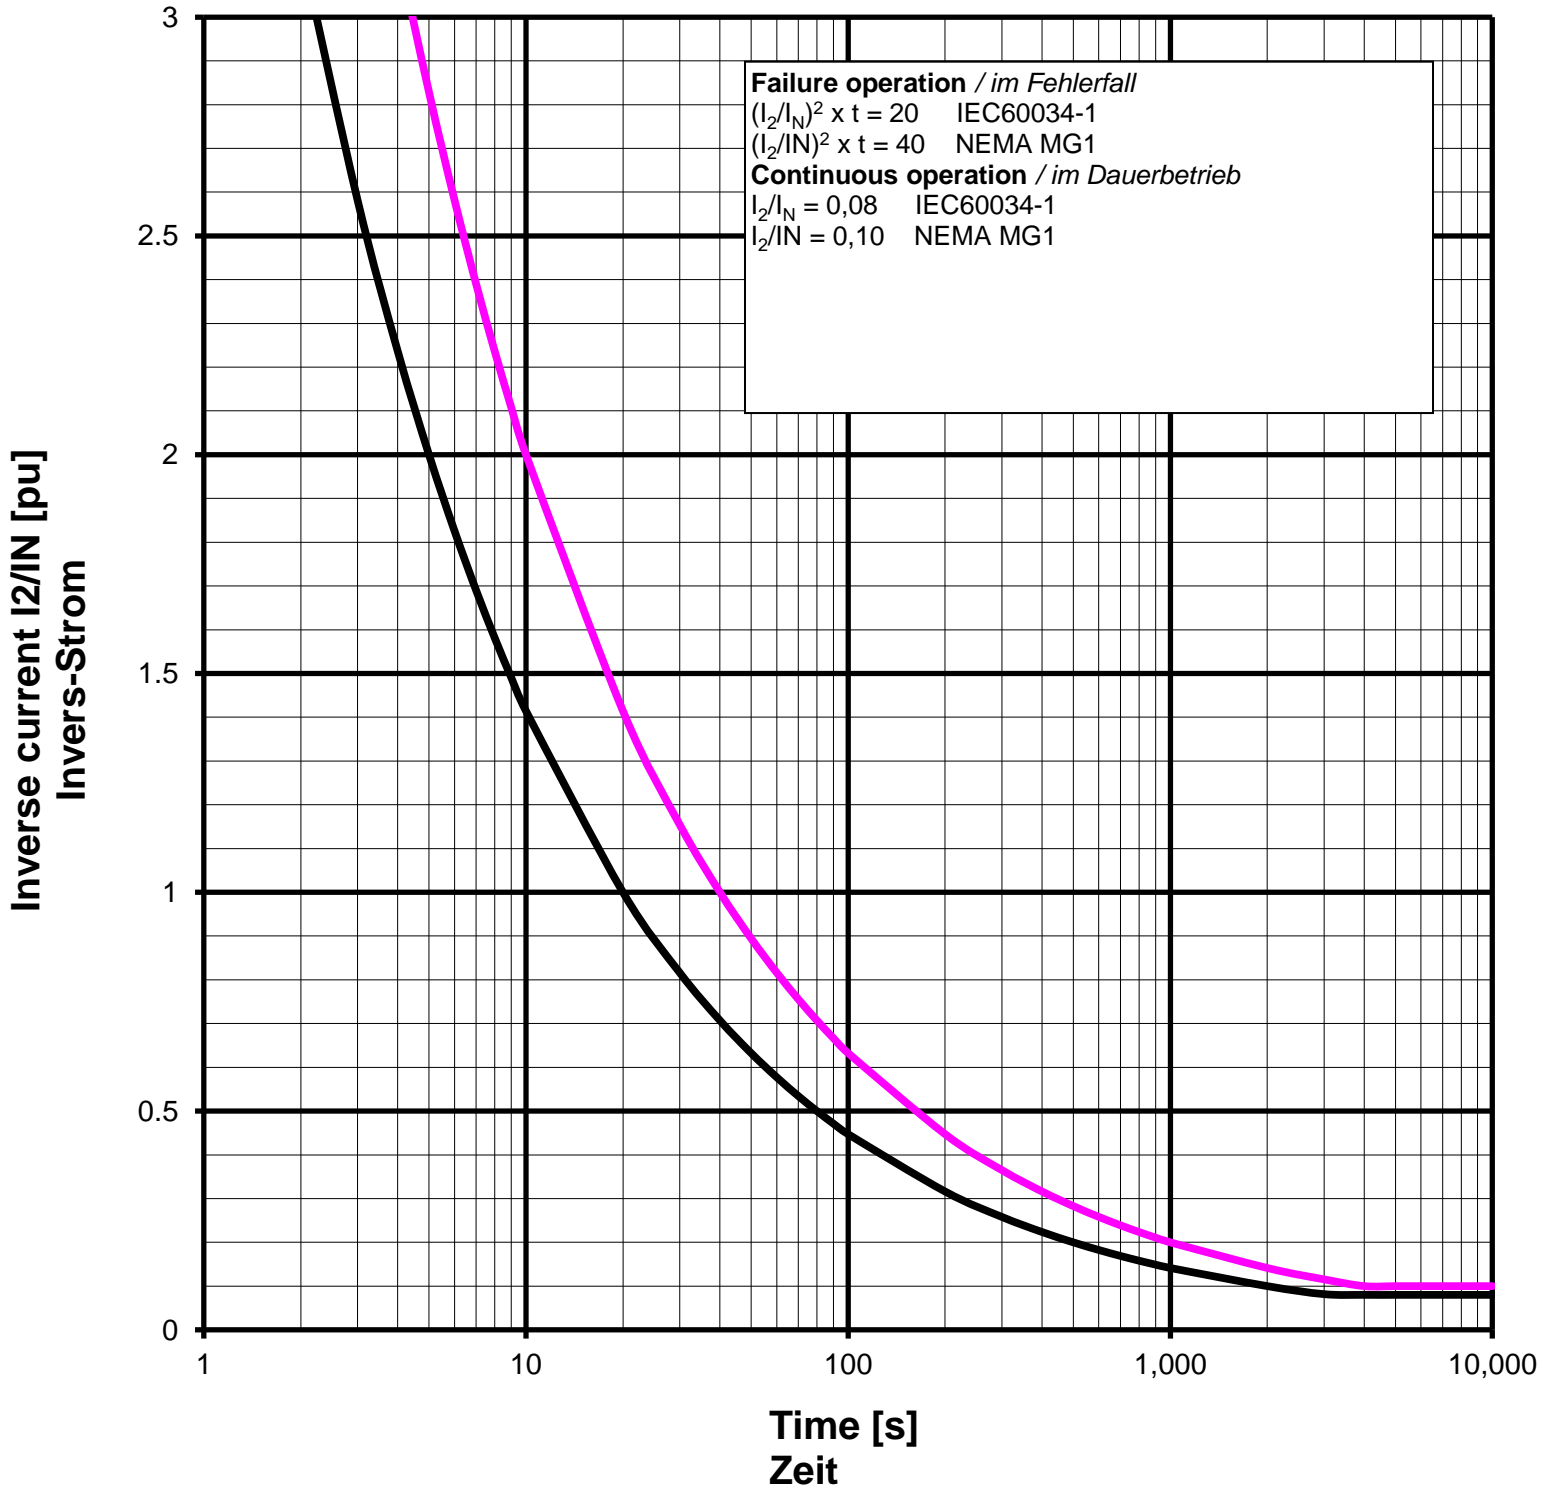

Remarks / Notizen:



Technische Daten selbstregelnden Drehstrom-Synchrongenerator  
technical data for self regulating three phase alternator

ING-FCD-0112


TYPE

DIG 130 k/6

Projekt:

Order Nr.:

### Capability (P-Q) Diagram

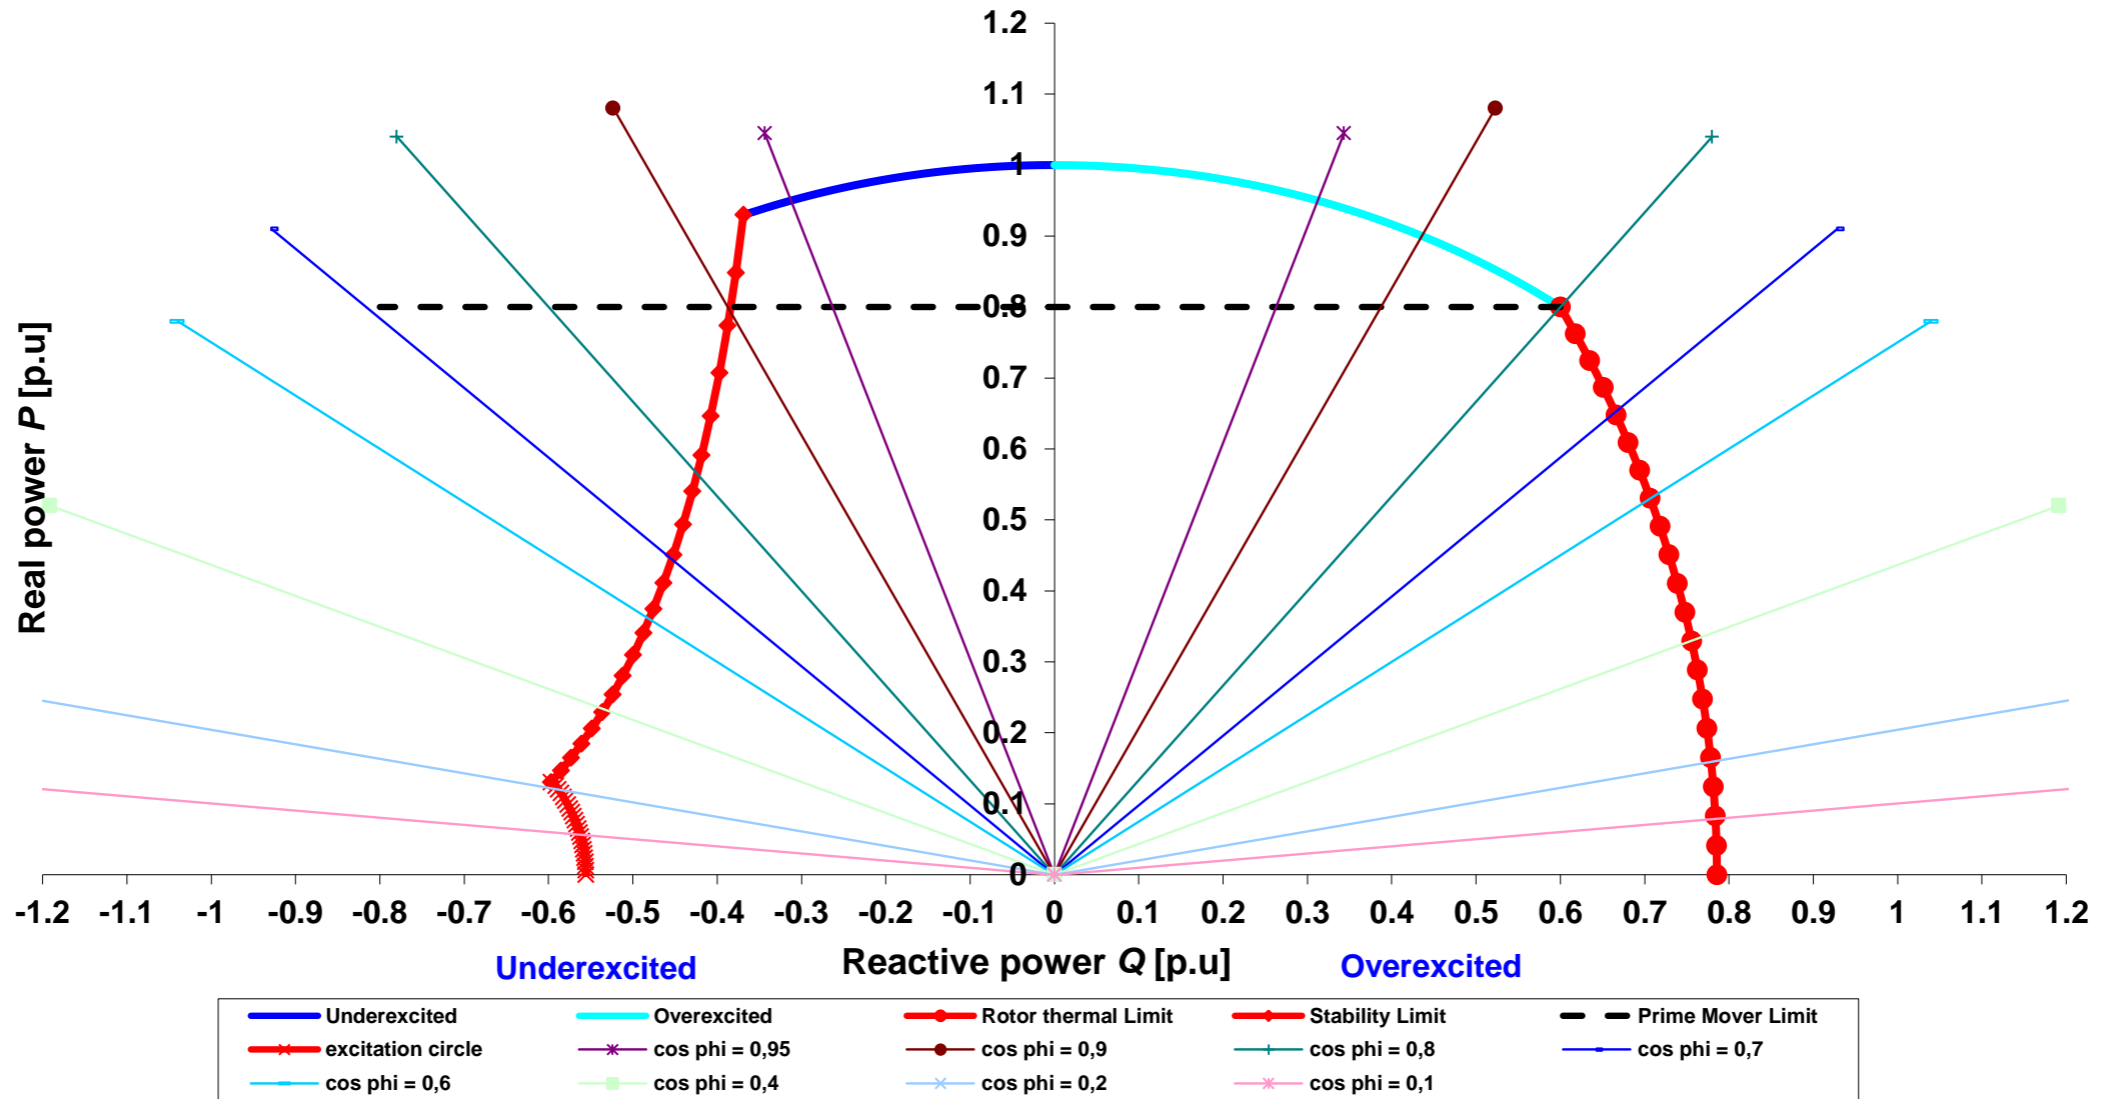


Cummins Generator Technologies

Datum / date:

21/01/2014



TYPE	DIG 130 k/6	Projekt:		Order Nr.:	
------	-------------	----------	--	------------	--

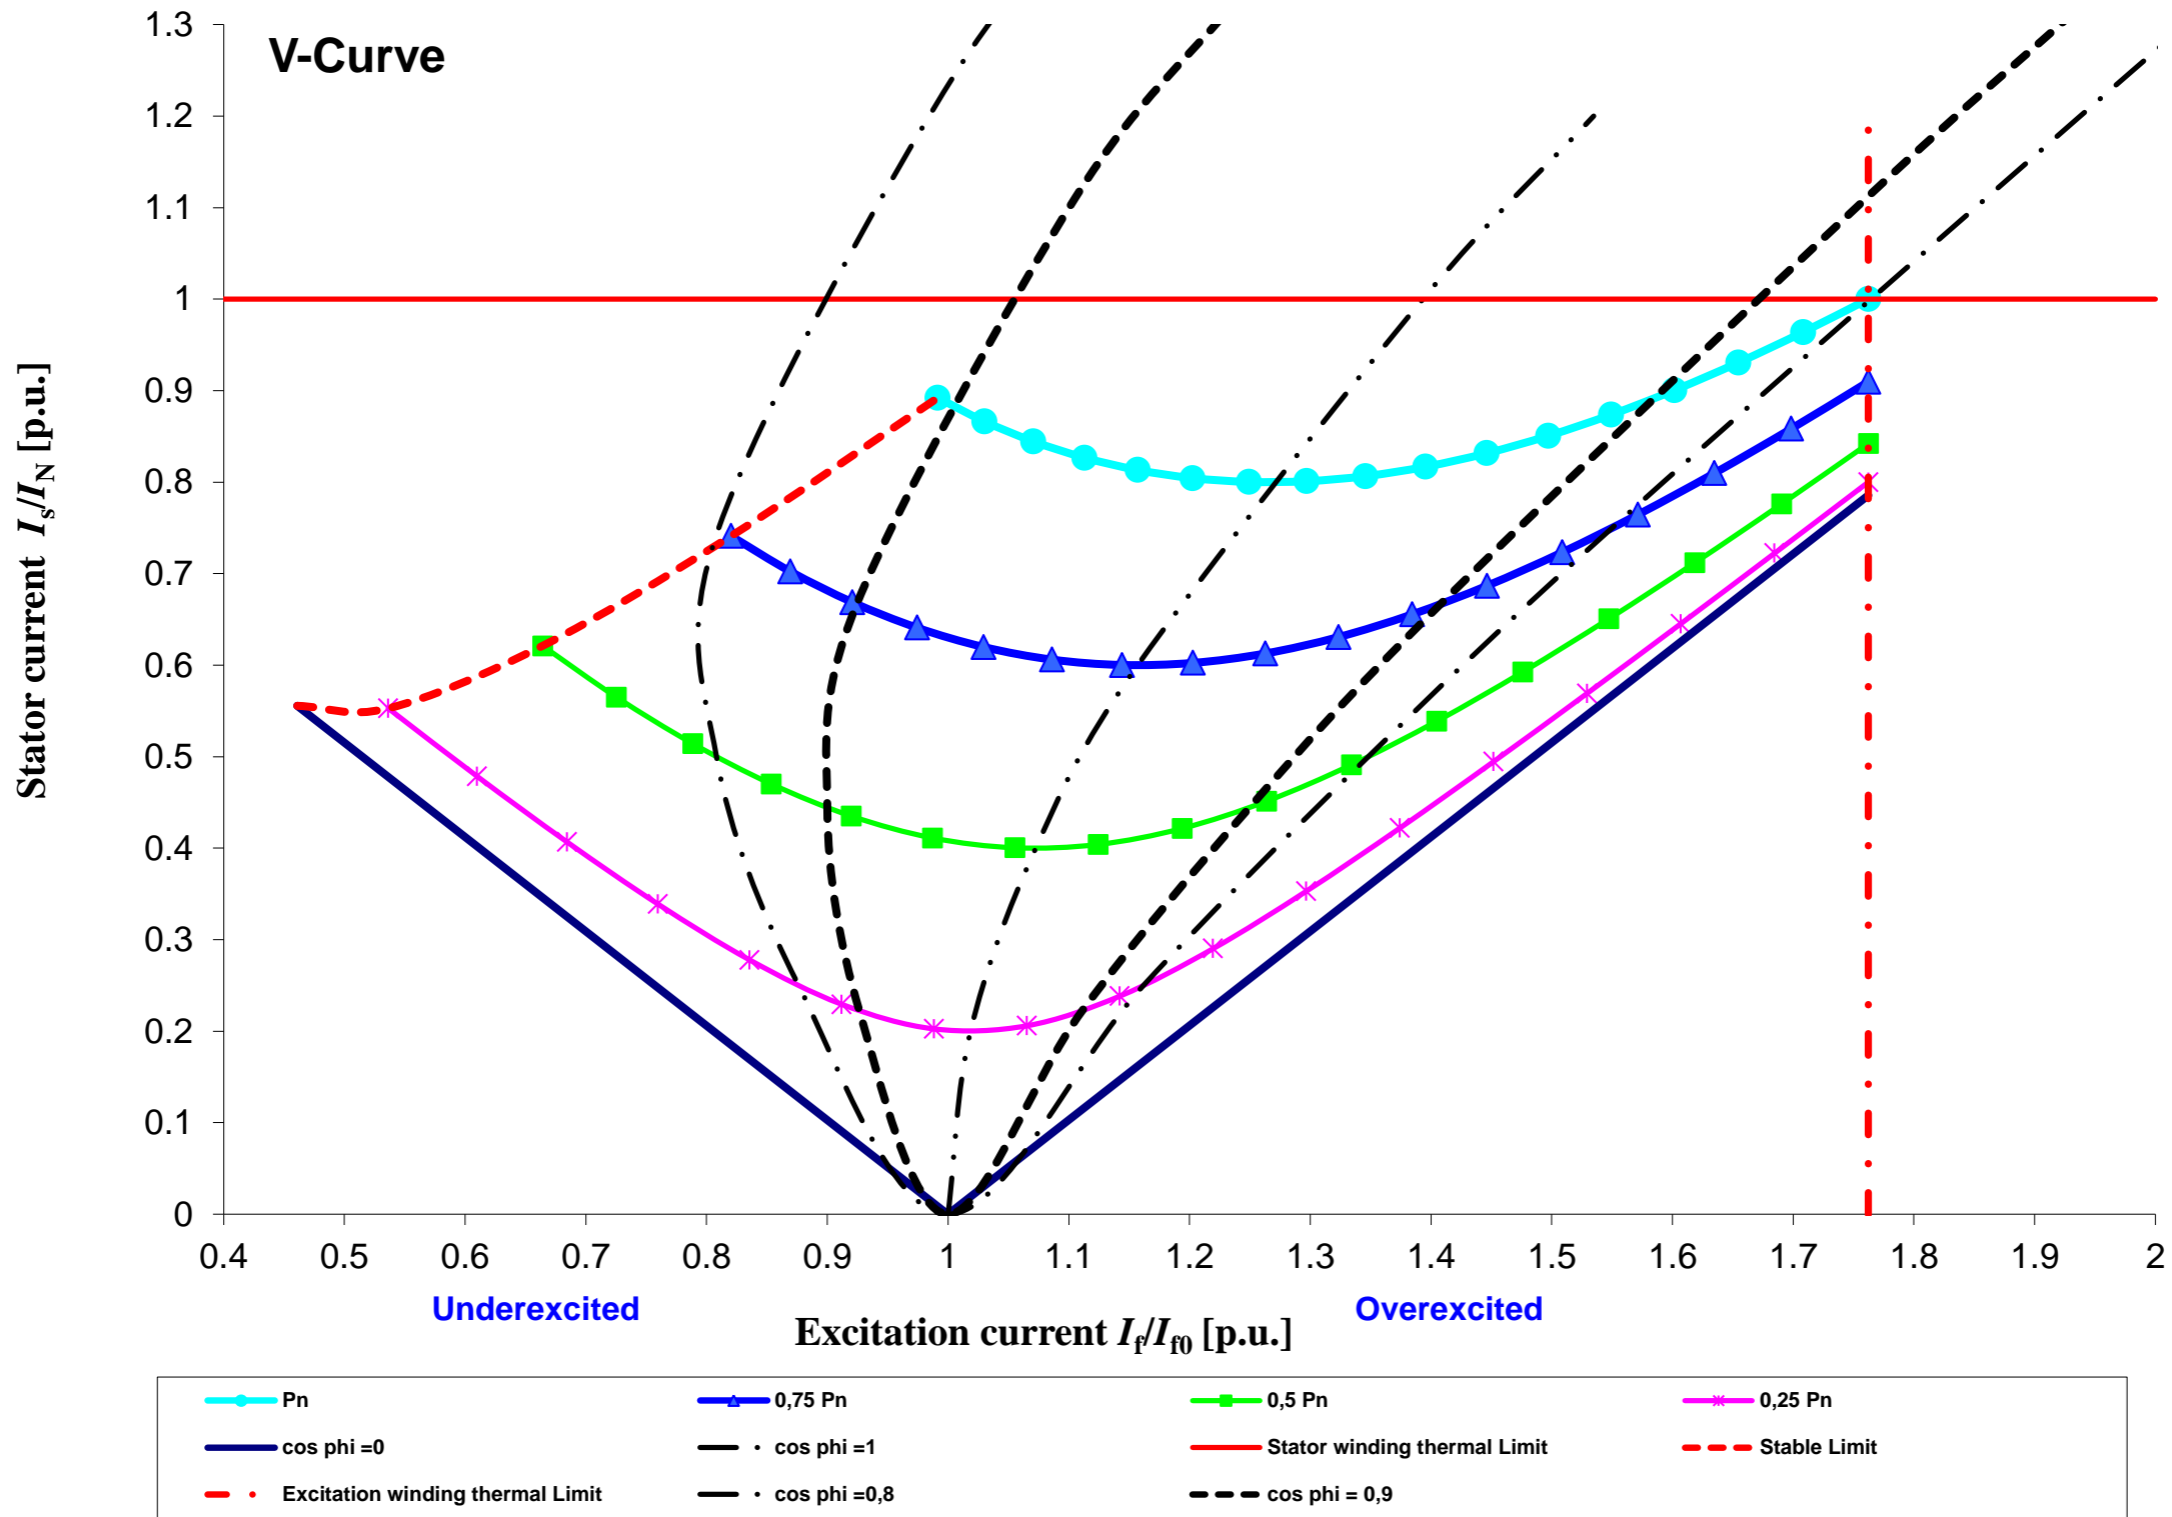

Cummins Generator Technologies	Datum / date:	
	21/01/2014	